Altivar 71

Variable speed drives
for synchronous and asynchronous motors

Programming manual

Software V6.5

02/2016



1755855

www.schneider-electric.com

Schneider Electric

Contents

Contents 3
Before you begin 4
Documentation structure 5
Software enhancements 6
Steps for setting up 9
Factory configuration 10
Application functions 11
Setup - Preliminary recommendations 15
Graphic display terminal 18
- Description of terminal 18
- Description of the graphic screen 19
- First power-up - [5. LANGUAGE] menu 22
- Subsequent power ups 23
- Programming: Example of accessing a parameter 24
- Quick navigation 25

Integrated display terminal 28
- Functions of the display and the keys 28
- Accessing menus 29
- Accessing menu parameters 30

[2. ACCESS LEVEL] (LAC-) 31
Structure of parameter tables 34
Interdependence of parameter values 35
Finding a parameter in this document 36
[1.1 SIMPLY START] (SIM-) 37
[1.2 MONITORING] (SUP-) 45
[1.3 SETTINGS] (SEt-) 54
[1.4 MOTOR CONTROL] (drC-) 69
[1.5 INPUTS / OUTPUTS CFG] (I-O-) 91
[1.6 COMMAND] (CtL-) 119
[1.7 APPLICATION FUNCT.] (FUn-) 132
[1.7 APPLICATION FUNCT.] (FUn-) 219
[1.8 FAULT MANAGEMENT] (FLt-) 221
[1.9 COMMUNICATION] (COM-) 245
[1.10 DIAGNOSTICS] 249
[1.11 IDENTIFICATION] 251
[1.12 FACTORY SETTINGS] (FCS-) 252
[1.13 USER MENU] (USr-) 255
[1.14 PROGRAMMABLE CARD] (PLC-) 256
[3. OPEN/SAVE AS] 257
[4. PASSWORD] (COd-) 259
[6 MONITORING CONFIG.] 261
[7 DISPLAY CONFIG.] 265
[MULTIPOINT SCREEN] 270
Maintenance 271
Faults - Causes - Remedies 272
User settings tables 278
Index of functions 280
Index of parameter codes 281

Read and understand these instructions before performing any procedure on this drive.

⚠ ⚠ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Only appropriately trained persons who are familiar with and understand the contents of this manual and all other pertinent product documentation and who have received safety training to recognize and avoid hazards involved are authorized to work on and with this drive system. Installation, adjustment, repair and maintenance must be performed by qualified personnel.
- The system integrator is responsible for compliance with all local and national electrical code requirements as well as all other applicable regulations with respect to grounding of all equipment.
- Many components of the product, including the printed circuit boards, operate with mains voltage. Do not touch. Use only electrically insulated tools.
- Do not touch unshielded components or terminals with voltage present.
- Motors can generate voltage when the shaft is rotated. Prior to performing any type of work on the drive system, block the motor shaft to prevent rotation.
- AC voltage can couple voltage to unused conductors in the motor cable. Insulate both ends of unused conductors of the motor cable.
- Do not short across the DC bus terminals or the DC bus capacitors or the braking resistor terminals.
- Before performing work on the drive system:
  - Disconnect all power, including external control power that may be present.
  - Place a "Do Not Turn On" label on all power switches.
  - Lock all power switches in the open position.
  - Wait 15 minutes to allow the DC bus capacitors to discharge. The DC bus LED is not an indicator of the absence of DC bus voltage that can exceed 800 Vdc.
  - Measure the voltage on the DC bus between the DC bus terminals using a properly rated voltmeter to verify that the voltage is < 42 Vdc.
  - If the DC bus capacitors do not discharge properly, contact your local Schneider Electric representative.
- Install and close all covers before applying voltage.

Failture to follow these instructions will result in death or serious injury.

⚠ CAUTION

DAMAGED EQUIPMENT

Do not operate or install any drive that appears damaged.

Failure to follow this instruction can result in equipment damage.

⚠ WARNING

LOSS OF CONTROL

- The designer of any control scheme must consider the potential failure modes of control paths and, for critical control functions, provide a means to achieve a safe state during and after a path failure. Examples of critical control functions are emergency stop, overtravel stop, power outage, and restart.
- Separate or redundant control paths must be provided for critical control functions.
- System control paths may include communication links. Consideration must be given to the implications of unanticipated transmission delays or failures of the link.
- Observe all accident prevention regulations and local safety guidelines.[a]
- Each implementation of the product must be individually and thoroughly tested for proper operation before being placed into service.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

a. For USA: Additional information, refer to NEMA ICS 1.1 (latest edition), “Safety Guidelines for the Application, Installation, and Maintenance of Solid State Control” and to NEMA ICS 7.1 (latest edition), “Safety Standards for Construction and Guide for Selection, Installation and Operation of Adjustable Speed Drive Systems.

Documentation structure

The following Altivar 71 technical documents are available on the Schneider-Electric website (www.schneider-electric.com).

Installation Manual

This bulletin contains complete mounting and wiring instructions.

Programming manual

This describes the functions, parameters and use of the drive terminal (integrated display terminal and graphic display terminal).
The communication functions are not described in this manual, but in the manual for the bus or network used.

Communication Parameters Manual

This manual describes:

- The drive parameters with specific information for use via a bus or communication network.
- The operating modes specific to communication (state chart).
- The interaction between communication and local control.

Manuals for Modbus®, CANopen®, Ethernet™, Profibus®, INTERBUS, Uni-Telway and Modbus® Plus, etc.

These manuals describe the assembly, connection to the bus or network, signaling, diagnostics, and configuration of the communication-specific parameters via the integrated display terminal or the graphic display terminal.
They also describe the communication services of the protocols.

ATV 58-58F/ATV 71 Migration Manual

This manual describes the differences between the Altivar 71 and the Altivar 58/58F and explains how to replace an Altivar 58 or 58F, including how to replace drives communicating on a bus or a network.

ATV 78/ATV 61/71 Migration Manual

This manual describes the differences between the Altivar 61/71 and Altivar 78 and explains how to replace an Altivar 78.

Software enhancements

Since the Altivar ATV 71 was first launched, it has benefited from the addition of several new functions. The software version has been updated to V6.5
Although this documentation relates to version V6.5, it can still be used with earlier versions.

Enhancements made to version V1.2 in comparison to V1.1

Factory setting

Note 1: In version V1.1, the analog input was 0 ± 10 V. For safety reasons, in the new version this input has been set to 0 + 10 V.
Note 2: In version V1.1, analog output AO1 was assigned to the motor frequency. In the new version, this output is not assigned at all.

With the exception of these two parameters, the factory settings of version V1.1 remain the same in the new version. The new functions are factory-set to disabled.

Motor frequency range

The maximum output frequency has been extended from 1000 to 1600 Hz (depending on the drive rating and control profile).

New parameters and functions

Menu [1.2 MONITORING] (SUP-)

Addition of internal states and values relating to the new functions described below.

Menu [1.3 SETTINGS] (SEt-)

- [High torque thd.] (ttH) page 67.
- [Low torque thd.] (ttL) page 67.
- [Pulse warning thd.] (FqL) page 68.
- [Freewheel stop Thd.] (FFt) page 68.

Menu[1.4 MOTOR CONTROL] (drC-)

- [rpm increment] (InSP) page 70.
- Extension of the following configurations to all drive ratings; previously limited to 45 kW (60 HP) for ATV71●●●M3X and to 75 kW (100 HP) for ATV71●●●N4:synchronous motor[Sync. mot.] (SYn) page 73, sinus filter [Sinus filter] (OFI) page 84, noise reduction [Noise reduction] (nrd) page 85, braking balance [Braking balance] (bbA) page 88.

Menu [1.5 INPUTS / OUTPUTS CFG] (I-O-)

- Input AI1 can now be configured to 0 +10 V or 0 ± 10 V via [AI1 Type] (AI1t) page 97.
- [AI net. channel] (AIC1) page 101.
- New methods of assigning relays and logic outputs page 106 : rope slack, high torque threshold, low torque threshold, motor in forward rotation, motor in reverse rotation, measured speed threshold reached, load variation detection.
- Analog output AO1 can now be used as a logic output and assigned to relay functions and logic outputs, page 111.
- New method of modifying the scale of analog outputs page 113 using the parameters [Scaling AOx min] (ASLx) and [Scaling AOx max] (ASHx).
- New methods of assigning logic outputs page 114: signed motor torque and measured motor speed.
- New methods of assigning alarm groups page 118 : rope slack, high torque threshold, low torque threshold, measured speed threshold reached, load variation detection.

Software enhancements

Menu [1.7 APPLICATION FUNCT.] (Fun-)

- The summing, subtraction and multiplication reference functions can now be assigned to virtual input [Network AI] (AIU1) page 139.
- New parameter [Freewheel stop Thd.] (FFt) page 144 used to set a threshold for switching to freewheel at the end of a stop on ramp or fast stop.
- Brake engage at regulated zero speed [Brake engage at 0] (bECd) page 165.
- Weight [Weight sensor ass.] (PES) page 171 can now be assigned to virtual input [Network AI] (AIU1).
- New "rope slack" function page 175, with the parameters [Rope slack config.] (rSd) and [Rope slack trq level] (rStL).
- Use of the ramp [Acceleration 2] (AC2) page 183 when starting and "waking up" the PID function.
- The torque limitation [TORQUE LIMITATION] (tOL-) page 190 can now be configured in whole % or in 0.1% increments using [Torque increment] (IntP) and assigned to virtual input [Network AI] (AIU1).
- New "stop at distance calculated after deceleration limit switch" function page 199, with the parameters [Stop distance] (Std), [Rated linear speed] (nLS) and [Stop corrector] (SFd).
- Positioning by sensors or limit switch [POSITIONING BY SENSORS] (LPO-) page 200 can now be configured in positive logic or negative logic using [Stop limit config. (SAL) and [Slowdown limit cfg.] (dAL).
- Parameter set switching [PARAM. SET SWITCHING] (MLP-) page 203 can now be assigned to the frequency thresholds attained [Freq. Th. att.] (FtA) and [Freq. Th. 2 attain.] (F2A).
- New half-floor: menu [HALF FLOOR] (HFF-) page 217.

Menu [1.8 FAULT MANAGEMENT] (FLt)

- Possibility of reinitializing the drive without turning it off, via [Product reset] (rP) page 224.
- Possibility of reinitializing the drive via a logic input without turning it off, using [Product reset assig.] (rPA) page 224.
- The possibility of configuring the "output phase loss" fault [Output Phase Loss] (OPL) page 228 to [Output cut] (OAC) has been extended to all drive ratings (previously limited to 45 kW (60 HP) for ATV71●●●M3X and 75 kW (100HP) for ATV71●●●N4).
- The external fault [EXTERNAL FAULT] (EtF-) page 231 can now be configured in positive or negative logic via [External fault config.] (LEt).
- New monitoring function based on speed measurement via "Pulse input" page 238, via the [FREQUENCY METER] menu (FqF-).
- New function for detecting load variation page 240, via the [DYNAMIC LOAD DETECT] menu (dLd-).
- Short-circuit faults on the braking unit can now be configured via[Brake res. fault Mgt] bUb) page 242.

Menu [7 DISPLAY CONFIG.]

- In [7.4 KEYPAD PARAMETERS] page 265, the [KEYPAD CONTRAST] and [KEYPAD STAND-BY] parameters to adjust the contrast and stand-by mode of the graphic display unit.

Enhancements made to version V1.6 in comparison to V1.2

Extension of the range with the addition of **ATV71●●●●Y** drives for 500 to 690 V supplies.
There are no new parameters, but the adjustment ranges and factory settings of some parameters have been adapted to the new voltages.

Menu [1.5 INPUTS / OUTPUTS CFG] (I-O-)

Increased adjustment range for the relay and logic output delay parameters: 0 to 60000 ms instead of 0 to 9999 ms.

Enhancements made to version V2.5 in comparison to V1.6

Menu [1.3 SETTINGS] (SEt-)

- New parameters [Skip Frequency] (JPF), [Skip Frequency 2] (JF2) and [3rd Skip Frequency] (JF3) page 68 allow to avoid critical speed which generate resonances.
- New parameter [Skip.Freq.Hysteresis] (JFH) page 68 to adjust the range of skip frequency.
- Possibility to adjust the parameter [Torque ratio] (trt) page 68 (visible too in [TORQUE CONTROL] (tOr-) menu page 187).

Important:
For V2.5 version, the behaviour of the following functions is different from the previous version when type of stop "freewheel" is selected (factory value):

- [LIMIT SWITCHES] (LSt-) function,
- [POSITIONING BY SENSORS] (LPO-) function,
- "shutdown" command by communication (see CiA402 state chart in communication parameters manual).

Actually, on previous versions, type of stop "freewheel" was not well done.

Software enhancements

Enhancements made to version V2.7 in comparison to V2.5

Menu [7 DISPLAY CONFIG.]

- Addition in [7.4 KEYPAD PARAMETERS] page 265 of [Power up menu]. This parameter allows to choose the menu which displays on the drive on power up.

Menu [1.3 SETTINGS] (SEt-)

The adjustment range of [Time to restart] (ttr) page 166 can now be configured between 0.00 and 15.00 seconds.

Enhancements made to version V3.3 in comparison to V2.7

[1.7 APPLICATION FUNCT.] (Fun-) menu

New parameters and functions

- New parameter [Regen. Conenction] (OIr) page 219 . With this parameter it is possible to retun the braking energy to the mains.
- New parameter [Dis. operat opt code] (dOtd) page 145.

Enhancements made to version V5.7 in comparison to V3.3

Motor frequency range

The maximum output frequency has been limited to 599 Hz

[1.5 INPUTS / OUTPUTS CFG] (I-O-) menu

New parameter and function

New assigning logic output, [R1 Assignment] (r1) page 106 : [Drive start] (Strt).

New factory setting

- New factory setting for [IGBT test] (Strt) page 233 has been modified, [No] (nO) to [Yes] (YES).
- New factory setting for [Dis. operat opt code] (dOtd) page 145 has been modified, [Freewheel] (nSt) to [Ramp stop] (rMp)

1.7 APPLICATION FUNCT.] (FUn-) menu

New parameter and function

- New parameter [Brake logic filter T] (FbCI) page 164
- New parameter [BRH_b4_freq] (bFtd) page 169
- New parameter [Pmax Motor] (tPMM) page 191
- New parameter [Pmax Generator] (tPMG) page 191

Enhancements made to version V6.1 in comparison to V5.7

[1.7 APPLICATION FUNCT.] (FUn-) menu

New parameter and function

- New parameter [+/-Speed reference] (Srt) page 153

[1.8 FAULT MANAGEMENT] (FLt-) menu

- New monitoring parameter [Freq. catch on fly] (FCAO) available with PC-Software, see [Catch on the fly] (FLr) page 226

Enhancements made to version V6.5 in comparison to V6.1

[1.7 APPLICATION FUNCT.] (FUn-) menu

Switching frequency

The minimum adjustment range of [Switching freq.] (SFr) depends on the product caliber, see page 61.

INSTALLATION

☐ **1 Consult the Installation Manual**



Tips:

- **Before you start programming, complete the user setting tables, page 278.**
- **Perform an auto-tuning operation to optimize performance, page 43.**
- **If you get lost, return to the factory settings, page 254.**

☞ ***Note: Check that the wiring of the drive is compatible with its configuration.***

PROGRAMMING

Procedure applicable if the factory configuration, page 10, and use of the [SIMPLY START] (SIM-) menu only are sufficient for the application.

■ 2 Power up without run command

- ☐ **If you are using a separate power supply for the control section, follow the instructions on page 15.**

■ 3 Select the language, if the drive has a graphic display terminal

■ 4 Configure the [SIMPLY START] (SIM-) menu

- ☐ **2-wire or 3-wire control**
- ☐ **Macro configuration**
- ☐ **Motor parameters**
  ☞ ***Perform an auto-tuning operation***
- ☐ **Motor thermal current**
- ☐ **Acceleration and deceleration ramps**
- ☐ **Speed variation range**

■ 5 Start

Factory configuration

Drive factory settings

The Altivar 71 is factory-set for the most common operating conditions:

- Macro configuration: Start/Stop
- **Motor** frequency: 50 Hz
- Constant torque application with asynchronous motor and sensorless flux vector control
- Normal stop mode on deceleration ramp
- Stop mode in the event of a fault: freewheel
- Linear, acceleration and deceleration ramps: 3 seconds
- Low speed: 0 Hz
- High speed: 50 Hz
- Motor thermal current = rated drive current
- Standstill injection braking current = 0.7 x rated drive current, for 0.5 seconds
- No automatic starts after a fault
- Switching frequency 2.5 kHz or 4 kHz depending on drive rating
- Logic inputs:
  - LI1: forward, LI2: Reverse (2 operating direction), 2-wire control on transition
  - L13, L14, LI5, LI6: inactive (not assigned)
- Analog inputs:
  - AI1: speed reference 0 +10 V
  - AI2: 0-20 mA, inactive (not assigned)
- Relay R1: The contact opens in the event of a fault (or drive off).
- Relay R2: Inactive (not assigned)
- Analog output AO1: 0-20 mA, inactive (not assigned)

If the above values are compatible with the application, the drive can be used without changing the settings.

Option card factory settings

The option card inputs/outputs are not factory-set.

Application functions

The tables on the following pages show the most common combinations of functions and applications, in order to guide your selection.
The applications in these tables relate to the following machines in particular:

- **Hoisting:** cranes, overhead cranes, gantries (vertical hoisting, translation, slewing), lifting platforms
- **Elevators:** elevators in retrofit up to 1.2 m/s
- **Handling:** palletizers/depalletizers, conveyors, roller tables
- **Packing:** carton packers, labeling machines
- **Textiles:** weaving looms, carding frames, washing machines, spinners, drawing frames
- **Wood:** automatic lathes, saws, milling
- **High inertia:** centrifuges, mixers, unbalanced machines (beam pumps, presses)
- **Process**

Each machine has its own special features, and the combinations listed here are neither mandatory nor exhaustive.

Some functions are designed specifically for a particular application. In this case, the application is identified by a tab in the margin on the relevant programming pages.

Motor control functions

Functions	Page	Applications							
		Hoisting	Lifts	Handling	Packing	Textiles	Wood	High inertia	Process
V/f ratio	73			■			■	■	
Sensorless flux vector control	73	■	■	■	■	■	■	■	■
Flux vector control with sensor	73	■	■	■	■	■	■	■	■
2-point vector control	73	■				■			
Open-loop synchronous motor	73					■			
Output frequency of up to 599 Hz	70					■	■		
Motor overvoltage limiting	85					■	■		
DC bus connection (see User's Manual)	-					■			■
Motor fluxing using a logic input	157	■		■	■				
Switching frequency of up to 16 kHz	84		■			■	■		
Auto-tuning	71	■	■	■	■	■	■	■	■

Functions on speed references

Functions	Page	Applications							
		Hoisting	Lifts	Handling	Packing	Textiles	Wood	High inertia	Process
Differential bipolar reference	94	■		■	■				
Reference delinearization (magnifying glass effect)	96	■		■					
Frequency control input	128					■			■
Reference switching	129 - 138				■				
Reference summing	137				■				
Reference subtraction	137				■				
Reference multiplication	137				■				
S ramps	140	■	■	■					
Jog operation	148			■		■			■
Preset speeds	149	■	■	■	■			■	
+ speed / - speed using single action pushbuttons (1 step)	152								■
+ speed / - speed using double action pushbuttons (2 steps)	152	■							
+/- speed around a reference	154					■			■
Save reference	156								■

Application-specific functions

Functions	Page	Applications							
		Hoisting	Lifts	Handling	Packing	Textiles	Wood	High inertia	Process
Fast stop	144						■	■	
Limit switch management	158	■	■	■					
Brake control	160	■	■	■					
Load measurement	170	■	■						
High-speed hoisting	172	■							
Rope slack	175	■							
PID regulator	177								■
Torque monitoring	186			■		■			■
Motor/generator torque limit	189			■		■		■	■
Load sharing	88	■		■					
Line contactor control	193	■		■			■		
Output contactor control	195		■						
Positioning by limit switches or sensors	197			■	■				
Stop at distance calculated after deceleration limit switch	199			■	■				
ENA system (mechanical with unbalanced load)	82							■	
Parameter switching	202	■	■	■	■	■	■	■	■
Motor or configuration switching	205	■		■	■				
Traverse control	209					■			
Stop configuration	144			■		■	■	■	
Evacuation	216		■						
Half floor	217		■						

Safety functions/fault management

Functions	Page	Applications							
		Hoisting	Lifts	Handling	Packing	Textiles	Wood	High inertia	Process
Power Removal (safety function, see User's Manual)	-	■	■	■	■	■	■	■	■
Deferred stop on thermal alarm	230		■						
Alarm handling	118	■	■	■	■	■	■	■	■
Fault management	222 to 244	■	■	■	■	■	■	■	■
IGBT tests	233	■	■	■	■	■	■	■	■
Catch a spinning load	226					■	■	■	
Braking resistor thermal protection	242	■	■	■	■				
Motor protection with PTC probes	222	■	■	■	■	■	■	■	■
Undervoltage management	232					■	■	■	
4-20mA loss	234	■	■	■		■	■		■
Uncontrolled output cut (output phase loss)	228			■					
Automatic restart	225			■					
Use of the "Pulse input" input to measure the speed of rotation of the motor.	238	■	■	■					
Load variation detection	240	■							

Turning on and configuring the drive

⚠ DANGER

UNINTENDED EQUIPMENT OPERATION

- Before turning on and configuring the Altivar 71, check that the PWR (POWER REMOVAL) input is deactivated (at state 0) in order to prevent unintended operation.
- Before turning on the drive, or when exiting the configuration menus, check that the inputs assigned to the run command are deactivated (at state 0) since they can cause the motor to start immediately.

Failure to follow these instructions will result in death or serious injury.

⚠ CAUTION

INCOMPATIBLE LINE VOLTAGE

Before turning on and configuring the drive, ensure that the line voltage is compatible with the supply voltage range shown on the drive nameplate. The drive may be damaged if the line voltage is not compatible.

Failure to follow this instruction can result in equipment damage.

Separate control section power supply

Only supply power to the power section the next time the drive is powered up when:
A) The drive control section is powered independently of the power section (P24 and 0V terminals).
B) Whenever an option card is added or replaced.

Power switching via line contactor

⚠ CAUTION

RISK OF EQUIPMENT DAMAGE

- Avoid operating the contactor frequently (premature ageing of the filter capacitors).
- Cycle times < 60 s may result in damage to the pre-charge resistor.

Failure to follow these instructions can result in equipment damage.

User adjustment and extension of functions

- The display unit and buttons can be used to modify the settings and to extend the functions described in the following pages.
- **Return to factory settings** is made easy by the [1.12 FACTORY SETTINGS] (FCS-) menu, see page 252.
- There are three types of parameter:
  - Display: Values displayed by the drive
  - Adjustment: Can be changed during operation or when stopped
  - Configuration: Can only be modified when stopped and no braking is taking place. Can be displayed during operation.

⚠ DANGER

UNINTENDED EQUIPMENT OPERATION

- Check that changes made to the settings during operation do not present any danger.
- We recommend stopping the drive before making any changes.

Failure to follow these instructions will result in death or serious injury.

Starting

Important:

- In factory settings mode, the motor can only be supplied with power once the “forward”, “reverse” and “DC injection stop” commands have been reset:
  - On power-up or a manual fault reset or after a stop command

  If they have not been reset, the drive will display "nSt" but will not start.
- If the automatic restart function has been configured ([Automatic restart] (Atr) parameter in the [1.8-FAULT MANAGEMENT] (FLt-) menu, see page 225), these commands are taken into account without a reset being necessary.

Test on a low power motor or without a motor

- In factory settings mode, [Output Phase Loss] detection (OPL) page 228 is active (OPL = YES). To check the drive in a test or maintenance environment without having to switch to a motor with the same rating as the drive (particularly useful in the case of high power drives), deactivate [Output Phase Loss] (OPL = no).
- Configure [Motor control type] (Ctt) = [V/F 2pts] (UF2) or [V/F 5pts] (UF5) ([1.4-MOTOR CONTROL] (drC-) menu, see page 73)

⚠ CAUTION

UNINTENDED EQUIPMENT OPERATION

Motor thermal protection will not be provided by the drive if the motor current is less than 0.2 times the rated drive current. Provide an alternative means of thermal protection.

Failure to follow this instruction can result in equipment damage.

Using motors in parallel

- Configure [Motor control type] (Ctt) = [V/F 2pts] (UF2) or [V/F 5pts] (UF5) ([1.4-MOTOR CONTROL] (drC-) menu, see page 73)

⚠ CAUTION

UNINTENDED EQUIPMENT OPERATION

Motor thermal protection is no longer provided by the drive. Provide an alternative means of thermal protection on every motor.

Failure to follow this instruction can result in equipment damage.

ATV71●●●Y - Network which presents often under voltage

To assure an optimal running of an ATV71●●●Y used on network which presents often under voltage (network voltage contained between 425 V and 446 V), it is necessary to adjust [Prevention level] (UPL) = 383 V ([1.8-FAULT MANAGEMENT] (FLt-) menu, see page 233).

Using motor with nominal voltage lower than drive supply voltage

- Configure [Vector Control 2pt] (UC2) = [Yes] (YES) ([1.4-MOTOR CONTROL] (drC-) menu, see page 75)

⚠ CAUTION

UNINTENDED EQUIPMENT OPERATION


- To protect a motor which has a nominal voltage lower than drive supply voltage, it is mandatory to use [Vector Control 2pt] (UC2) function in order to limit maximal voltage of the motor lower than network voltage.
- Nevertheless, it is necessary to check that instantaneous voltage applied to the motor (link to DC bus voltage) are compatible with characteristics of this one.

Failure to follow these instructions can result in equipment damage.

Graphic display terminal

Although the graphic display terminal is optional for low-power drives, it is a standard component on high-power drives (see catalog). The graphic display terminal can be disconnected and connected remotely (on the door of an enclosure for example) using the cables and accessories available as options (see catalog).


Description of terminal

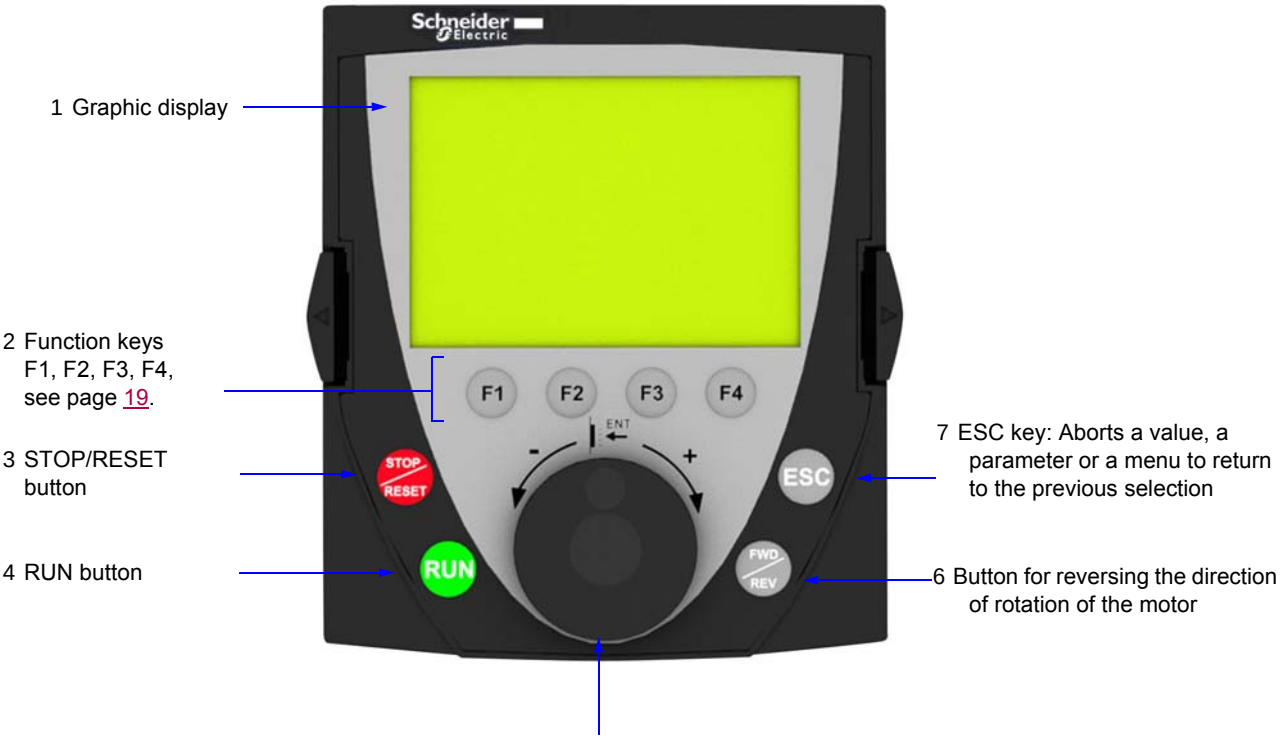


Note: Buttons **3**, **4**, **5** and **6** can be used to control the drive directly, if control via the terminal is activated.

Disconnected terminal

When the terminal is disconnected, 2 LEDs become visible:

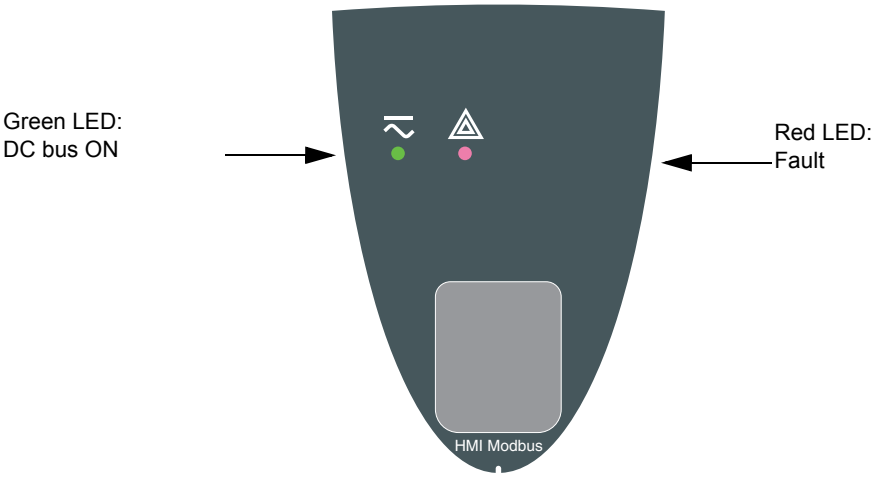

Description of the graphic screen

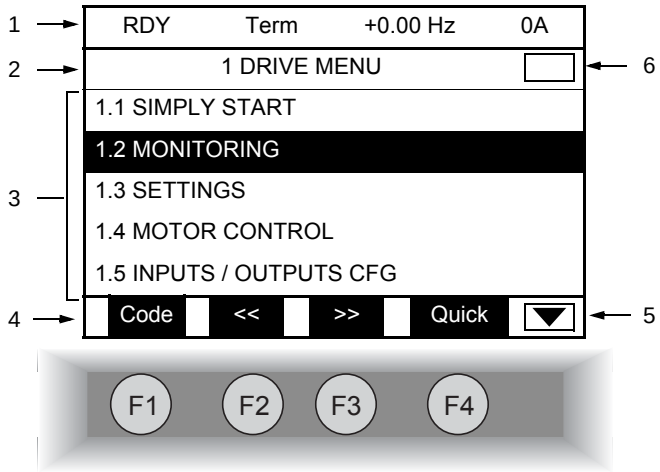

1. Display line. Its content can be configured; the factory settings show:
   - The drive state (see page 20)
   - The active control channel:
     - Term: Terminals
     - HMI: Graphic display terminal
     - MDB: Integrated Modbus
     - CAN: Integrated CANopen
     - NET: Communication card
     - APP: Controller Inside card
   - Frequency reference
   - Current in the motor

2. Menu line. Indicates the name of the current menu or submenu.

3. Menus, submenus, parameters, values, bar charts, etc., are displayed in drop-down window format on a maximum of 5 lines. The line or value selected by the navigation button is displayed in reverse video.

4. Section displaying the functions assigned to the F1 to F4 keys and aligned with them, for example:

   - Code F1 : Displays the code of the selected parameter, i.e., the code corresponding to the 7-segment display.
   - HELP F1 : Contextual help
   - << F2 : Navigate horizontally to the left, or go to previous menu/submenu or, for a value, go to the next digit up, displayed in reverse video (see the example on page 21).
   - >> F3 : Navigate horizontally to the right or go to next menu/submenu (going to the [2 ACCESS LEVEL] menu in this example) or, for a value, go to the next digit down, displayed in reverse video (see the example on page 21).
   - Quick F4 : Quick navigation, see page 25.

The function keys are dynamic and contextual.
Other functions (application functions) can be assigned to these keys via the [1.6 COMMAND] menu.
If a preset speed is assigned to a function key and if the function key is pressed, the motor will run at this preset speed until another preset speed or JOG is pressed, speed reference is changed, or Stop key is pressed.


5. Indicates that there are no more levels below this display window.
   Indicates that there are more levels below this display window.

6. Indicates that this display window does not scroll further up.
   Indicates that there are more levels above this display window.


Drive state codes:

- ACC: Acceleration
- CLI: Current limit
- CTL: Controlled stop on input phase loss
- DCB: DC injection braking in progress
- DEC: Deceleration
- FLU: Motor fluxing in progress
- FST: Fast stop
- NLP: No line power (no line supply on L1, L2, L3)
- NST: Freewheel stop
- OBR: Auto-adapted deceleration
- PRA: Power Removal function active (drive locked)
- RDY: Drive ready
- RUN: Drive running
- SOC: Controlled output cut in progress
- TUN: Auto-tuning in progress
- USA: Undervoltage alarm

Example configuration windows:

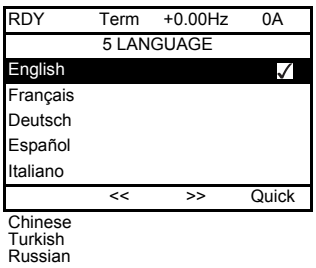


When only one selection is possible, the selection made is indicated by ✓
Example: Only one language can be chosen.

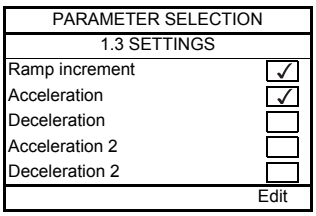

When multiple selection is possible, the selections made are indicated by ☑
Example: A number of parameters can be chosen to form the [USER MENU].


Example configuration window for one value:

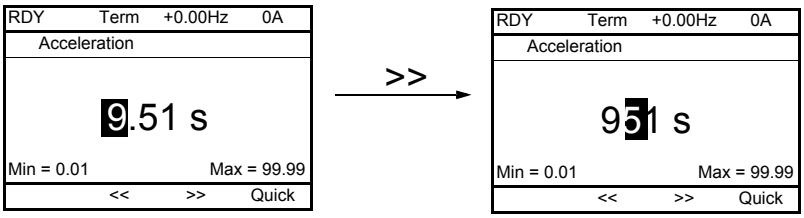

The << and >> arrows (keys F2 and F3) are used to select the digit to be modified, and the navigation button is rotated to increase or decrease this number.

First power-up - [5. LANGUAGE] menu

The first time the drive is powered up, the user will automatically be guided through the menus as far as [1. DRIVE MENU].
The parameters in the [1.1 SIMPLY START] submenu must be configured and auto-tuning performed before the motor is started up.

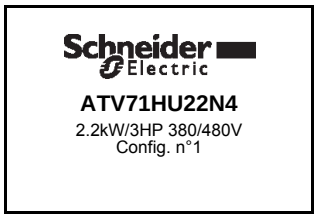


Display for 3 seconds following power-up


3 seconds



Automatically switches to [5 LANGUAGE] menu 3 seconds later.
Select the language and press ENT.

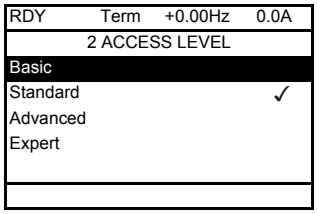


Switches to [2 ACCESS LEVEL] menu (see page 31)
Select the access level and press ENT.

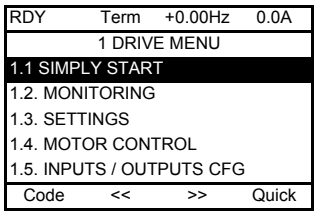


Switches to [1 DRIVE MENU] (see page 27)

ESC

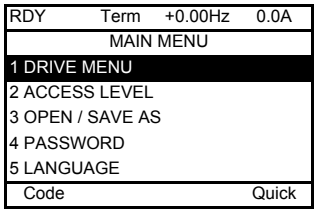

Press ESC to return to [MAIN MENU]

Subsequent power ups

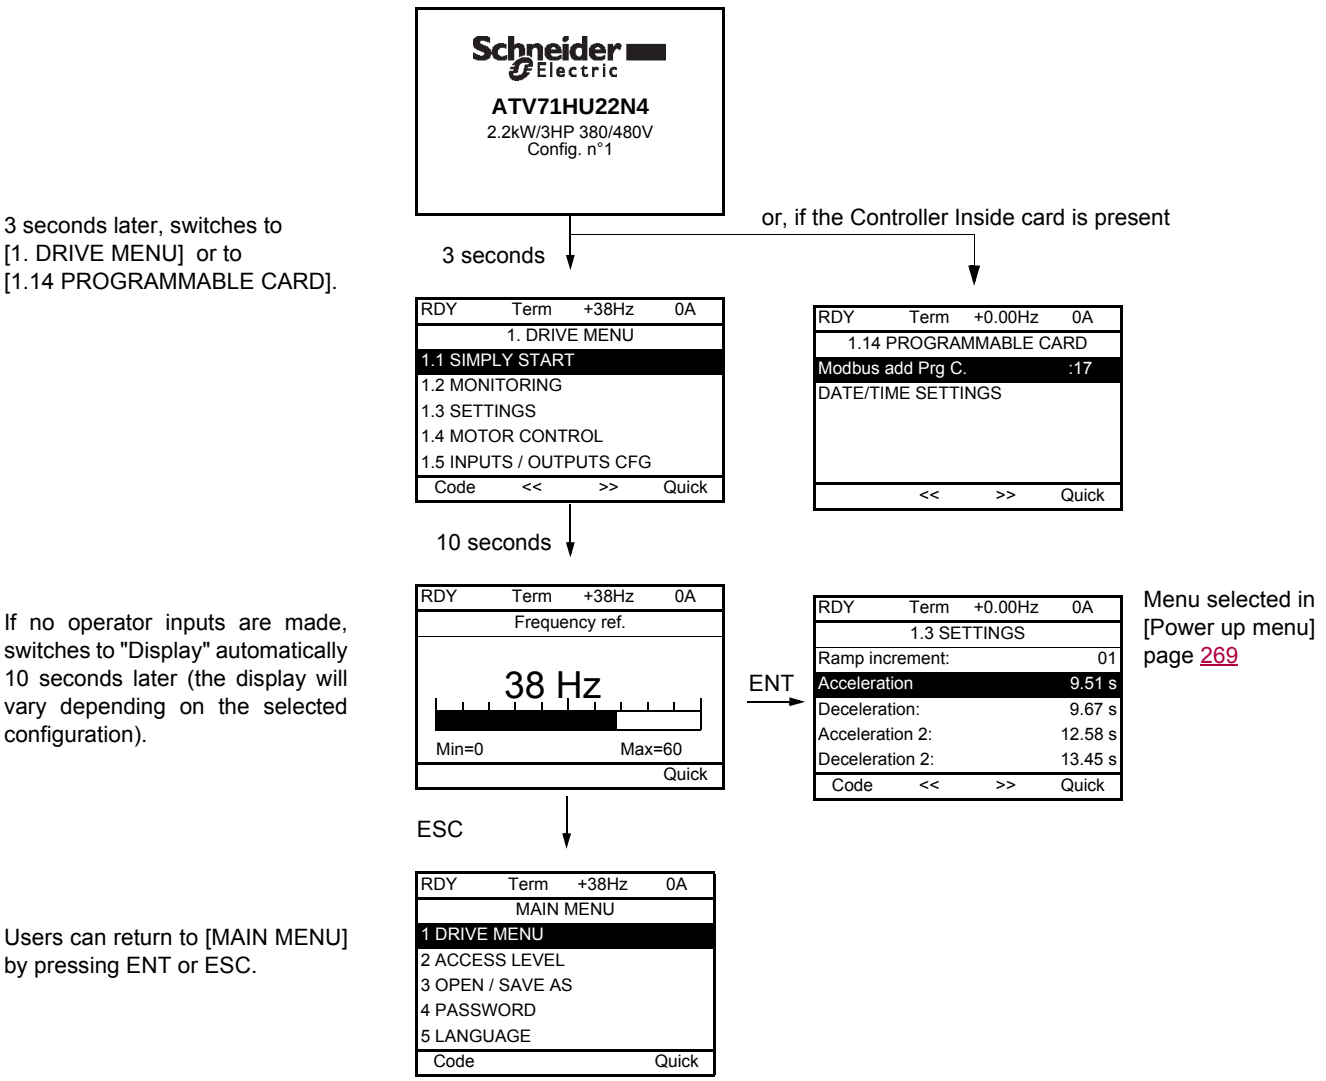

3 seconds later, switches to [1. DRIVE MENU] or to [1.14 PROGRAMMABLE CARD].


If no operator inputs are made, switches to "Display" automatically 10 seconds later (the display will vary depending on the selected configuration).

Users can return to [MAIN MENU] by pressing ENT or ESC.

Menu selected in [Power up menu] page 269

Programming: Example of accessing a parameter

Accessing the acceleration ramp

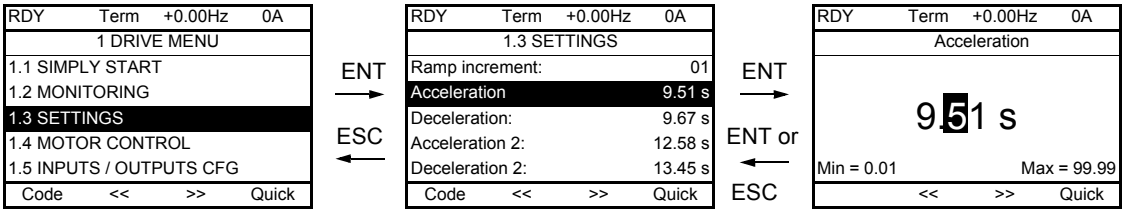


Note:

- To select a parameter:
  - Turn the navigation button to scroll vertically.
- To modify a parameter:
  - Use the << and >> keys (F2 and F3) to scroll horizontally and select the digit to be modified (the selected digit changes to white on a black background).
  - Turn the navigation button to modify the digit.
- To cancel the modification:
  - Press ESC.
- To save the modification:
  - Press the navigation button (ENT).


Quick navigation

If the "Quick" function is displayed above the F4 key, you can gain quick access to a parameter from any screen.


Example:

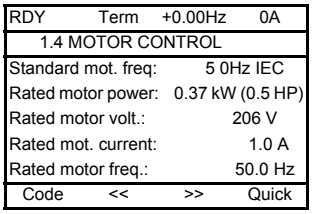

Press F4 to access the Quick screen, which contains 4 selection options.

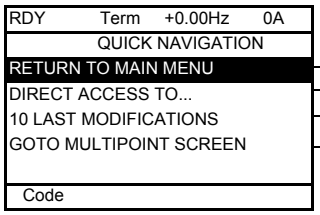


ENT

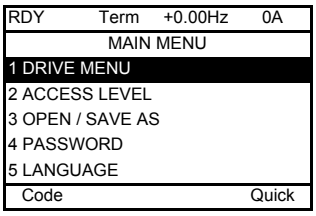


See page 270


- [HOME]: Return to [MAIN MENU].
- [DIRECT ACCESS TO...] : Opens the direct access window, which will contain the text "1". The function keys << and >> (F2 and F3) can be used to select each of the numbers and the navigation button to increment or decrement the numbers: 1.3 in the example below.

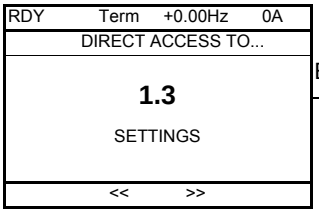

ENT

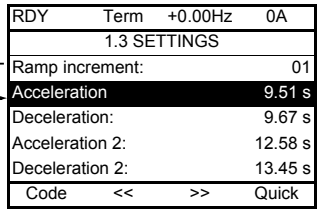


- [10 LAST MODIFICATIONS]: Opens a window in which the last 10 parameters modified can be accessed directly.

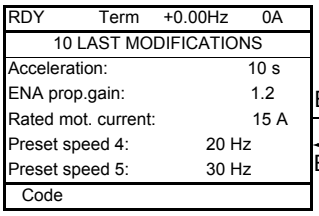


ENT

ESC

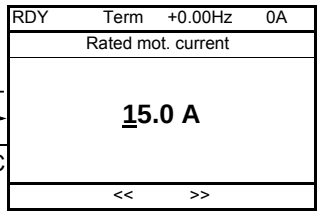


[MAIN MENU] - Menu mapping

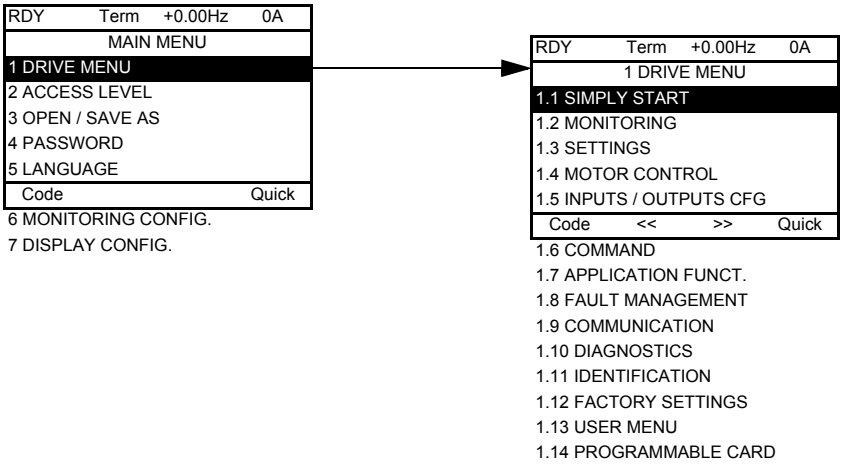

Content of [MAIN MENU] menus

[1 DRIVE MENU]	See next page
[2 ACCESS LEVEL]	Defines which menus can be accessed (level of complexity)
[3 OPEN / SAVE AS]	Can be used to save and recover drive configuration files
[4 PASSWORD]	Provides password protection for the configuration
[5 LANGUAGE]	Language selection
[6 MONITORING CONFIG.]	Customization of information displayed on the graphic display terminal during operation
[7 DISPLAY CONFIG.]	• Customization of parameters • Creation of a customized user menu • Customization of the visibility and protection mechanisms for menus and parameters

[1 DRIVE MENU]

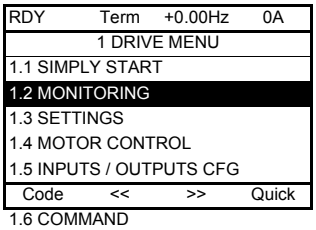

1.6 COMMAND
1.7 APPLICATION FUNCT.
1.8 FAULT MANAGEMENT
1.9 COMMUNICATION
1.10 DIAGNOSTICS
1.11 IDENTIFICATION
1.12 FACTORY SETTINGS
1.13 USER MENU
1.14 PROGRAMMABLE CARD

Content of [1. DRIVE MENU] menus:

[1.1 SIMPLY START]:	Simplified menu for a quick start
[1.2 MONITORING]:	Visualization of current, motor and input/output values
[1.3 SETTINGS]:	Accesses the adjustment parameters, which can be modified during operation
[1.4 MOTOR CONTROL]:	Motor parameters (motor nameplate, auto-tuning, switching frequency, control algorithms, etc.)
[1.5 INPUTS / OUTPUTS CFG]:	I/O configuration (scaling, filtering, 2-wire control, 3-wire control, etc.)
[1.6 COMMAND]:	Configuration of command and reference channels (graphic display terminal, terminals, bus, etc.)
[1.7 APPLICATION FUNCT.] :	Configuration of application functions (e.g., preset speeds, PID, brake logic control, etc.)
[1.8 FAULT MANAGEMENT]:	Configuration of fault management
[1.9 COMMUNICATION]:	Communication parameters (fieldbus)
[1.10 DIAGNOSTICS]:	Motor/drive diagnostics
[1.11 IDENTIFICATION]:	Identifies the drive and the internal options
[1.12 FACTORY SETTINGS]:	Access to configuration files and return to factory settings
[1.13 USER MENU]:	Specific menu set up by the user in the [7. DISPLAY CONFIG.] menu
[1.14 PROGRAMMABLE CARD]: :	Configuration of optional Controller Inside card

Integrated display terminal

Low-power Altivar 71 drives (see catalog) feature an integrated display terminal with a 7-segment 4-digit display. The graphic display terminal described on the previous pages can also be connected to these drives as an option.

Functions of the display and the keys



- 2 Modbus status LEDs
- Four 7-segment displays
- Returns to the previous menu or parameter, or increases the displayed value
- Goes to the next menu or parameter, or decreases the displayed value
- 2 CANopen status LEDs
- Exits a menu or parameter, or aborts the displayed value to return to the previous value in the memory
- Enters a menu or parameter, or saves the displayed parameter or value

Note: **• Pressing ▲ or ▼ does not store the selection.**

• Press and hold down (>2 s) ▲ or ▼ to scroll through the data quickly.

Save and store the selection: ENT


The display flashes when a value is stored.

Normal display, with no fault present and no startup:

- 43.0 : Display of the parameter selected in the SUP menu (default selection: motor frequency)
- CLI: Current limit
- CtL: Controlled stop on input phase loss
- dCb: DC injection braking in progress
- FLU: Motor fluxing in progress
- FSt: Fast stop.
- nLP: No line power (no line supply on L1, L2, L3)
- nSt: Freewheel stop
- Obr: Auto-adapted deceleration
- PrA: Power Removal function active (drive locked)
- rdY = Drive ready
- SOC: Controlled output cut in progress
- tUn: Auto-tuning in progress
- USA: Undervoltage alarm

The display flashes to indicate the presence of a fault.

Accessing menus

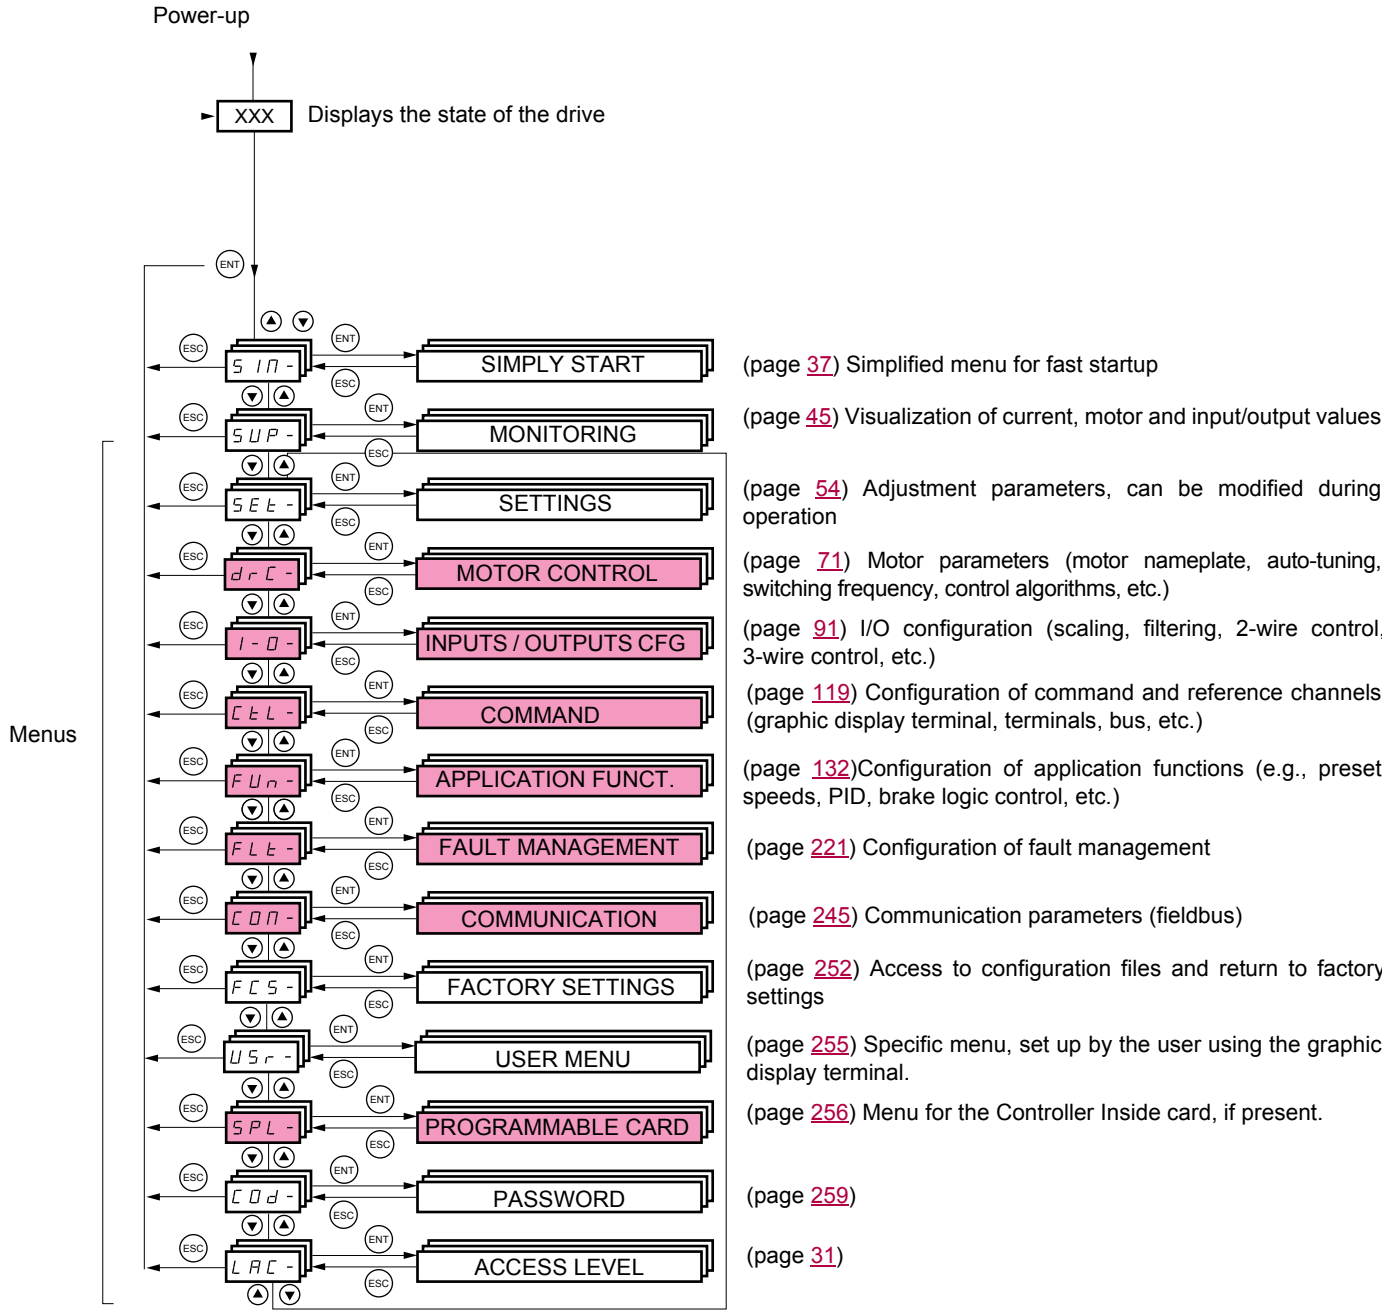

(page 37) Simplified menu for fast startup

(page 45) Visualization of current, motor and input/output values

(page 54) Adjustment parameters, can be modified during operation

(page 71) Motor parameters (motor nameplate, auto-tuning, switching frequency, control algorithms, etc.)

(page 91) I/O configuration (scaling, filtering, 2-wire control, 3-wire control, etc.)

(page 119) Configuration of command and reference channels (graphic display terminal, terminals, bus, etc.)

(page 132)Configuration of application functions (e.g., preset speeds, PID, brake logic control, etc.)

(page 221) Configuration of fault management

(page 245) Communication parameters (fieldbus)

(page 252) Access to configuration files and return to factory settings

(page 255) Specific menu, set up by the user using the graphic display terminal.

(page 256) Menu for the Controller Inside card, if present.

(page 259)


(page 31)

A dash appears after menu and submenu codes to differentiate them from parameter codes.
Examples: FUn- menu, ACC parameter.


The grayed-out menus may not be accessible depending on the control access (LAC) configuration.

Accessing menu parameters

Save and store the displayed selection : (ENT)

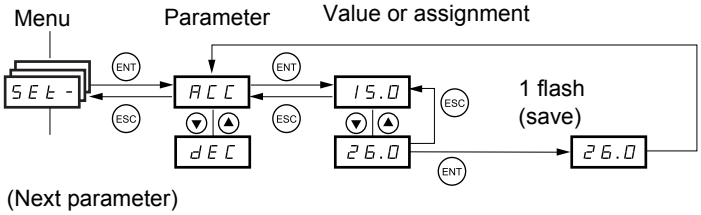


The display flashes when a value is stored.

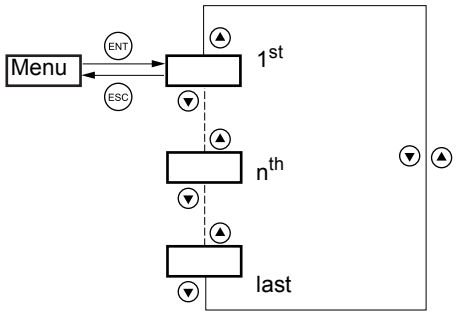

All the menus are "drop-down" type menus, which means that after the last parameter, if you continue to press ▼ , you will return to the first parameter and, conversely, you can switch from the first parameter to the last parameter by pressing ▲ .

Selection of multiple assignments for one parameter

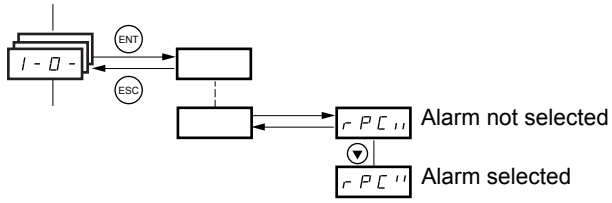


Example: List of group 1 alarms in [INPUTS / OUTPUTS CFG] menu (I-O-)
A number of alarms can be selected by "checking" them as follows.

The digit on the right indicates:  selected

 not selected.

The same principle is used for all multiple selections.

With graphic display terminal

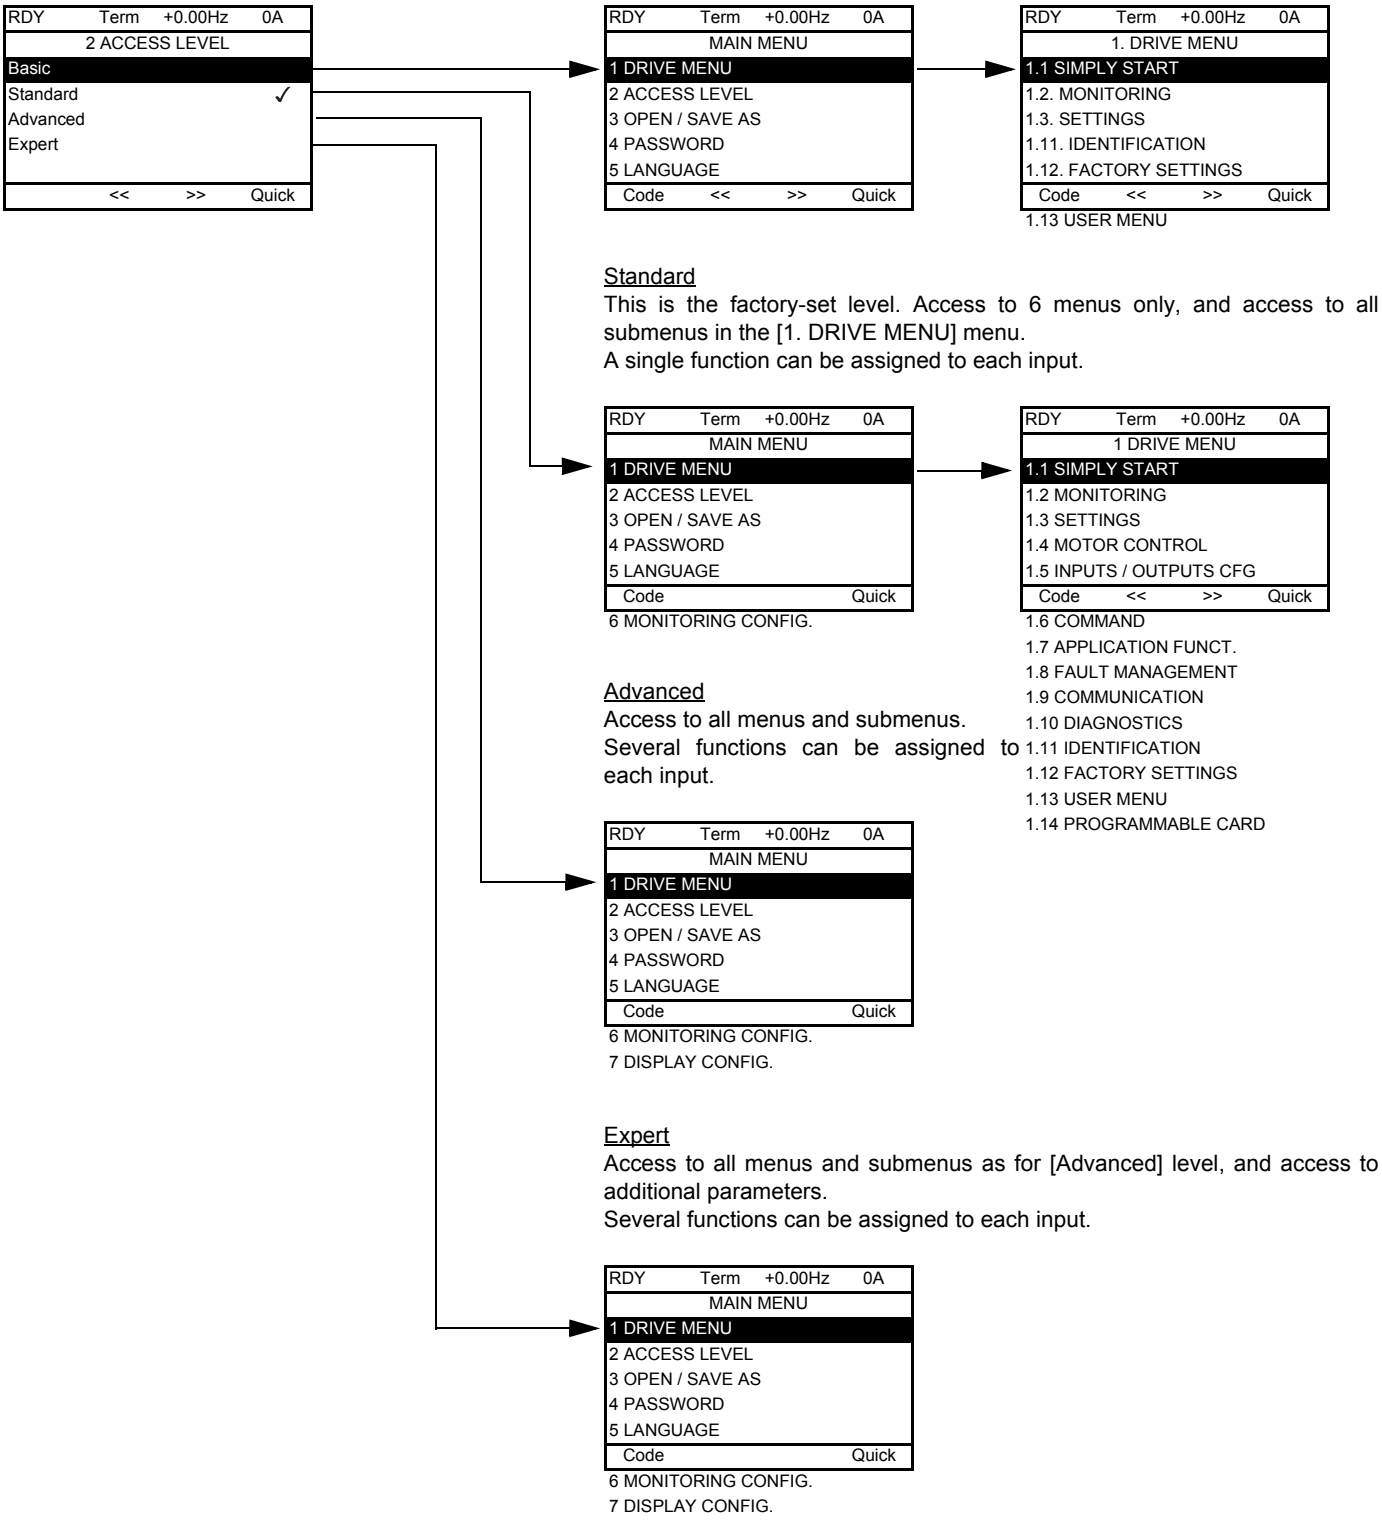

Basic

Access to 5 menus only, and access to 6 submenus only in the [1. DRIVE MENU] menu.

A single function can be assigned to each input.

Standard

This is the factory-set level. Access to 6 menus only, and access to all submenus in the [1. DRIVE MENU] menu.

A single function can be assigned to each input.

Advanced

Access to all menus and submenus.

Several functions can be assigned to each input.


Expert

Access to all menus and submenus as for [Advanced] level, and access to additional parameters.

Several functions can be assigned to each input.

[2. ACCESS LEVEL] (LAC-)

With integrated display terminal:

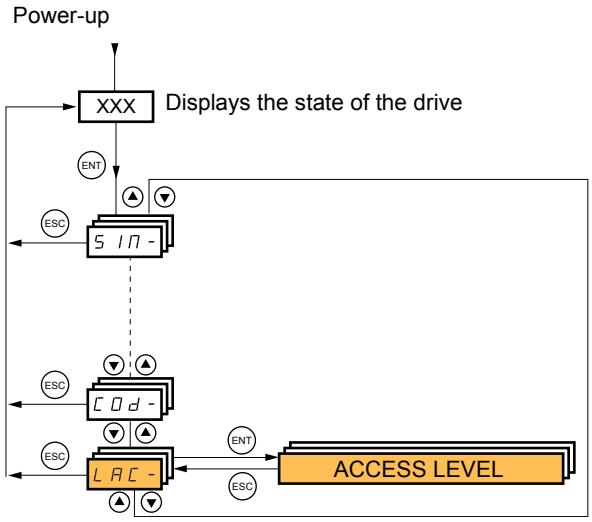

Code	Name/Description	Factory setting
LAC -		Std
bAS	• bAS: Limited access to SIM, SUP, SEt, FCS, USr, COd and LAC menus. Only one function can be assigned to each input.	
Std	• Std: Access to all menus on the integrated display terminal. Only one function can be assigned to each input.	
AdU	• AdU: Access to all menus on the integrated display terminal. Several functions can be assigned to each input.	
EPr	• EPr: Access to all menus on the integrated display terminal and access to additional parameters. Several functions can be assigned to each input.	

Comparison of the menus that can be accessed on the graphic display terminal/ integrated display terminal


Graphic display terminal		Integrated display terminal	Access level
[2 ACCESS LEVEL]		LAC - (Access level)	Basic bAS / Standard Std (factory setting) / Advanced Adu / Expert EPr
[3 OPEN/SAVE AS]		-	
[4 PASSWORD]		Cod - (Password)	
[5 LANGUAGE]		-	
[1 DRIVE MENU]	[1.1 SIMPLY START]	SIM - (Simply start)	
	[1.2 MONITORING]	SUP - (Monitoring)	
	[1.3 SETTINGS]	SET - (Settings)	
	[1.11 IDENTIFICATION]	-	
	[1.12 FACTORY SETTINGS]	FCS - (Factory settings)	
	[1.13 USER MENU]	usr - (User menu)	
A single function can be assigned to each input.		A single function can be assigned to each input.	
	[1.4 MOTOR CONTROL]	drC - (Motor control)	
	[1.5 INPUTS / OUTPUTS CFG]	I-O - (I/O configuration)	
	[1.6 COMMAND]	CtL - (Command)	
	[1.7 APPLICATION FUNCT.]	Fun - (Application functions)	
	[1.8 FAULT MANAGEMENT]	FLt - (Fault management)	
	[1.9 COMMUNICATION]	CoM - (Communication)	
	[1.10 DIAGNOSTICS]	-	
	[1.14 PROGRAMMABLE CARD] (1)	PLC - (Controller Inside card) (1)	
[6 MONITORING CONFIG.]		-	
A single function can be assigned to each input.		A single function can be assigned to each input.	
[7 DISPLAY CONFIG.]		-	
Several functions can be assigned to each input.		Several functions can be assigned to each input.	
Expert parameters		Expert parameters	
Several functions can be assigned to each input.		Several functions can be assigned to each input.	

(1) Can be accessed if the Controller Inside card is present.

Structure of parameter tables

The parameter tables in the descriptions of the various menus can be used with both the graphic display terminal and the integrated display terminal. They, therefore, contain information for these two terminals in accordance with the description below.

Example:

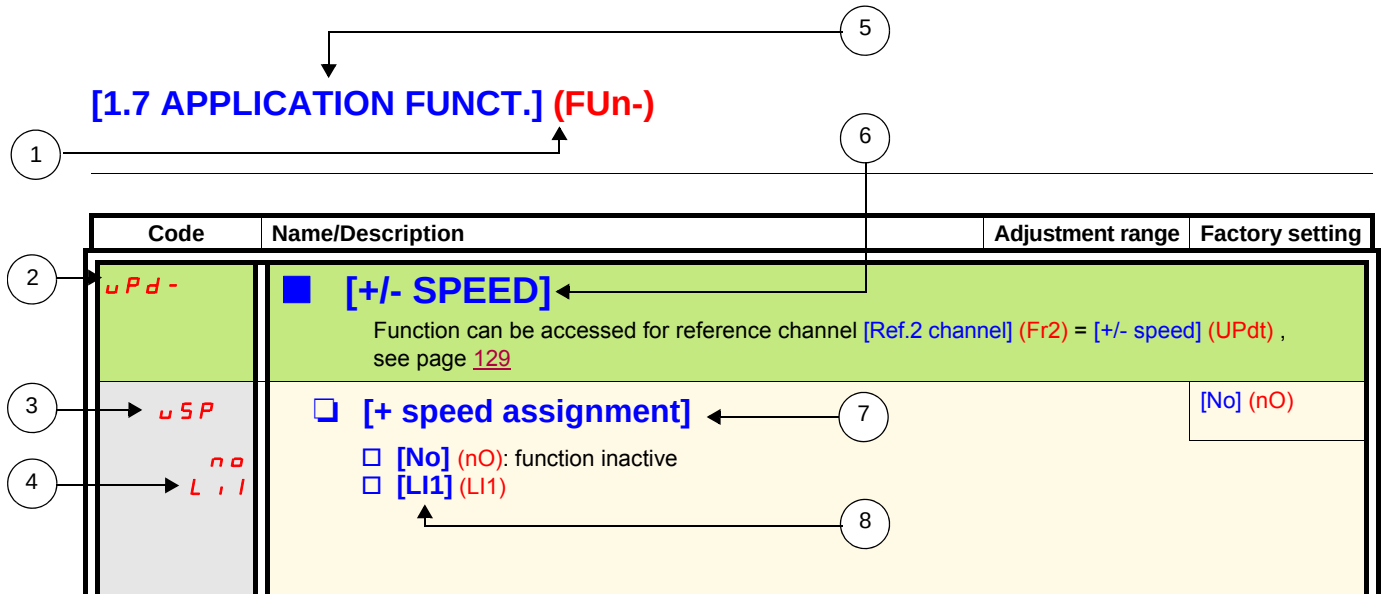

1. Name of menu on 4-digit 7-segment display.
2. Submenu code on 4-digit 7-segment display.
3. Parameter code on 4-digit 7-segment display.
4. Parameter value on 4-digit 7-segment display.
5. Name of menu on graphic display terminal.
6. Name of submenu on graphic display terminal.
7. Name of parameter on graphic display terminal.
8. Value of parameter on graphic display terminal.

Note :

- The text in square brackets [ ] indicates what you will see on the graphic display terminal.
- The factory settings correspond to [Macro configuration] (CFG) = [Start/Stop] (StS). This is the macro configuration set at the factory.

Interdependence of parameter values

The configuration of certain parameters modifies the adjustment range of other parameters, in order to reduce the risk of errors. **This may result in the modification of a factory setting or a value you have already selected.**

Example:

1. [Current Limitation] (CLI) page 61 set to 1.6 In or left at its factory setting, 1.5 In
2. [Switching freq.] (SFr) page 61 set to 1 kHz (and confirmed with "ENT") restricts [Current Limitation] (CLI) to 1.36 In
3. If [Switching freq.] (SFr) is increased to 4 kHz, [Current limitation] (CLI) is no longer restricted, **but remains at 1.36 In**. If you require 1.6 In, you must **reset** [Current Limitation] (CLI).

Finding a parameter in this document

The following assistance with finding explanations on a parameter is provided:

- **With the integrated display terminal:** Direct use of the parameter code index, page 281, to find the page giving details of the displayed parameter.
- **With the graphic display terminal:** Select the required parameter and press F1 : [Code]. The parameter code is displayed instead of its name while the key is held down.

  Example: ACC

RDY	Term	+0.00Hz	0A
1.3 SETTINGS			
Ramp increment:			01
Acceleration			9.51 s
Deceleration:			9.67 s
Acceleration 2:			12.58 s
Deceleration 2:			13.45 s
Code	<<	>>	Quick


Code →

RDY	Term	+0.00Hz	0A
1.3 SETTINGS			
Ramp increment:			01
ACC			9.51 s
Deceleration:			9.67 s
Acceleration 2:			12.58 s
Deceleration 2:			13.45 s
Code	<<	>>	Quick


Then use the parameter code index, page 281, to find the page giving details of the displayed parameter.

[1.1 SIMPLY START] (SIM-)

With graphic display terminal:

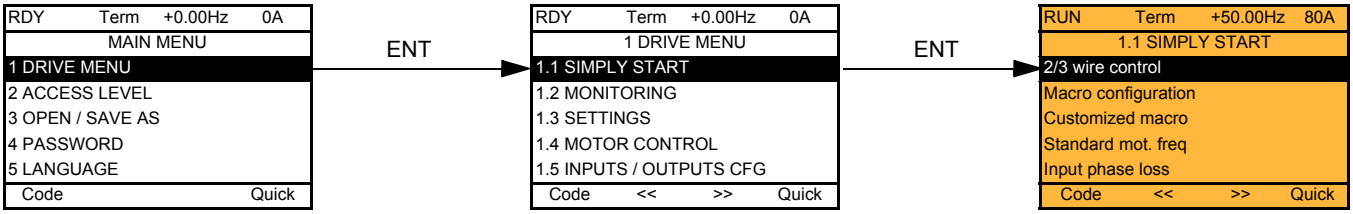

With integrated display terminal:

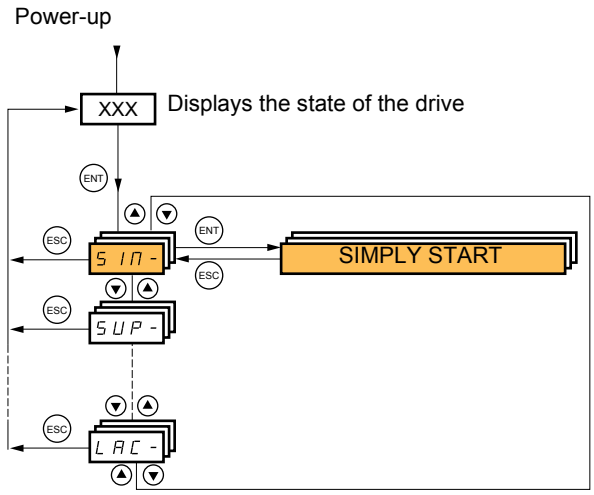

The [1.1-SIMPLY START] (SIM-) menu can be used for fast startup, which is sufficient for the majority of applications.

The parameters in this menu can only be modified when the drive is stopped and no run command is present, with the following exceptions:

- Auto-tuning, which causes the motor to start up
- The adjustment parameters on page 44

Note : The parameters of the [1.1 SIMPLY START] (SIM-) menu must be entered in the order in which they appear, as the later ones are dependent on the first ones.
For example [2/3 wire control] (tCC) must be configured before any other parameters.

The [1.1 SIMPLY START] (SIM-) menu should be configured **on its own or before the other drive configuration menus**. If a modification has previously been made to any of them, in particular in [1.4 MOTOR CONTROL] (drC-), some [1.1 SIMPLY START] (SIM-) parameters may be changed, for example, the motor parameters, if a synchronous motor has been selected. Returning to the [1.1 SIMPLY START] (SIM-) menu after modifying another drive configuration menu **is unnecessary** but does not pose any risk. Changes following modification of another configuration menu **are not described**, to avoid unnecessary complication in this section.

Macro configuration

Macro configuration provides a means of speeding up the configuration of functions for a specific field of application.
7 macro configurations are available:

- Start/stop (factory configuration)
- Handling
- General use
- Hoisting
- PID regulator
- Communication bus
- Master/slave

Selecting a macro configuration assigns the parameters in this macro configuration.

Each macro configuration can still be modified in the other menus.

Macro configuration parameters

Assignment of the inputs/outputs

Input/ output	[Start/Stop]	[M. handling]	[Gen. Use]	[Hoisting]	[PID regul.]	[Network C.]	[Mast./ slave]
AI1	[Ref.1 channel]	[Ref.1 channel]	[Ref.1 channel]	[Ref.1 channel]	[Ref.1 channel] (PID reference)	[Ref.2 channel] ([Ref.1 channel] = integrated Modbus) (1)	[Ref.1 channel]
AI2	[No]	[Summing ref. 2]	[Summing ref. 2]	[No]	[PID feedback]	[No]	[Torque reference]
AO1	[No]	[No]	[No]	[No]	[No]	[No]	[No]
R1	[No drive flt]	[No drive flt]	[No drive flt]	[No drive flt]	[No drive flt]	[No drive flt]	[No drive flt]
R2	[No]	[No]	[No]	[Brk control]	[No]	[No]	[No]
LI1 (2-wire)	[Forward]	[Forward]	[Forward]	[Forward]	[Forward]	[Forward]	[Forward]
LI2 (2-wire)	[Reverse]	[Reverse]	[Reverse]	[Reverse]	[Reverse]	[Reverse]	[Reverse]
LI3 (2-wire)	[No]	[2 preset speeds]	[Jog]	[Fault reset]	[PID integral reset]	[Ref. 2 switching]	[Trq/spd switching]
LI4 (2-wire)	[No]	[4 preset speeds]	[Fault reset]	[External fault]	[2 preset PID ref.]	[Fault reset]	[Fault reset]
LI5 (2-wire)	[No]	[8 preset speeds]	[Torque limitation]	[No]	[4 preset PID ref.]	[No]	[No]
LI6 (2-wire)	[No]	[Fault reset]	[No]	[No]	[No]	[No]	[No]
LI1 (3-wire)	Stop	Stop	Stop	Stop	Stop	Stop	Stop
LI2 (3-wire)	[Forward]	[Forward]	[Forward]	[Forward]	[Forward]	[Forward]	[Forward]
LI3 (3-wire)	[Reverse]	[Reverse]	[Reverse]	[Reverse]	[Reverse]	[Reverse]	[Reverse]
LI4 (3-wire)	[No]	[2 preset speeds]	[Jog]	[Fault reset]	[PID integral reset]	[Ref. 2 switching]	[Trq/spd switching]
LI5 (3-wire)	[No]	[4 preset speeds]	[Fault reset]	[External fault]	[2 preset PID ref.]	[Fault reset]	[Fault reset]
LI6 (3-wire)	[No]	[8 preset speeds]	[Torque limitation]	[No]	[4 preset PID ref.]	[No]	[No]
Option cards							
LI7 to LI14	[No]	[No]	[No]	[No]	[No]	[No]	[No]
LO1 to LO4	[No]	[No]	[No]	[No]	[No]	[No]	[No]
R3/R4	[No]	[No]	[No]	[No]	[No]	[No]	[No]
AI3, AI4	[No]	[No]	[No]	[No]	[No]	[No]	[No]
RP	[No]	[No]	[No]	[No]	[No]	[No]	[No]
AO2	[I motor]	[I motor]	[I motor]	[I motor]	[I motor]	[I motor]	[I motor]
AO3	[No]	[Sign. torque]	[No]	[Sign. torque]	[PID Output]	[No]	[Motor freq.]
Graphic display terminal keys							
F1 key	[No]	[No]	[No]	[No]	[No]	Control via graphic display terminal	[No]
F2, F3, F4 keys	[No]	[No]	[No]	[No]	[No]	[No]	[No]

In 3-wire control, the assignment of inputs LI1 to LI6 shifts.

(1) To start with integrated Modbus [Modbus Address] (Add) must first be configured, page 247.

Note: These assignments are reinitialized every time the macro configuration changes.

Macro configuration parameters

Other configurations and settings

In addition to the assignment of inputs/outputs, other parameters are assigned only in the Hoisting and Mast./slave macro configurations.

Hoisting:

- [Movement type] (bSt) = [Hoisting] (UEr) page 164
- [Brake contact] (bCI) = [No] (nO) page 164
- [Brake impulse] (bIP) = [No] (nO) page 164
- [Brake release I FW] (Ibr) = [Rated mot. current] (nCr) page 165
- [Brake Release time] (brt) = 0.5 s page 165
- [Brake release freq] (bIr) = [Auto] (AUtO) page 165
- [Brake engage freq] (bEn) = [Auto] (AUto) page 165
- [Brake engage time] (bEt) = 0.5 s page 165
- [Engage at reversal] (bEd) = [No] (nO) page 166
- [Jump at reversal] (JdC) = [Auto] (AUtO) page 166
- [Time to restart] (ttr) = 0 s page166
- [Current ramp time] (brr) = 0 s page 169
- [Low speed] (LSP) = Rated motor slip calculated by the drive, page 44
- [Output Phase Loss] (OPL) = [Yes] (YES) page 228. No further modifications can be made to this parameter.
- [Catch on the fly] (FLr) = [No] (nO) page 226. No further modifications can be made to this parameter.

Mast./slave:

- [Motor control type] (Ctt) = [SVC I] (CUC) page 73

Note: These assignments are forced every time the macro configuration changes, except for [Motor control type] (Ctt) for the Mast./slave macro configuration, if it is configured in [FVC] (FUC).

Return to factory settings:

Returning to factory settings with [Config. Source] (FCSI) = [Macro-Conf] (InI) page 254 will return the drive to the selected macro configuration. The [Macro configuration] (CFG) parameter does not change, although [Customized macro] (CCFG) disappears.




Note :

- The factory settings that appear in the parameter tables correspond to [Macro configuration] (CFG) = [Start/Stop] (StS). This is the macro configuration set at the factory.


Example diagrams for use with the macro configurations

[Hoisting] (HSt) diagram

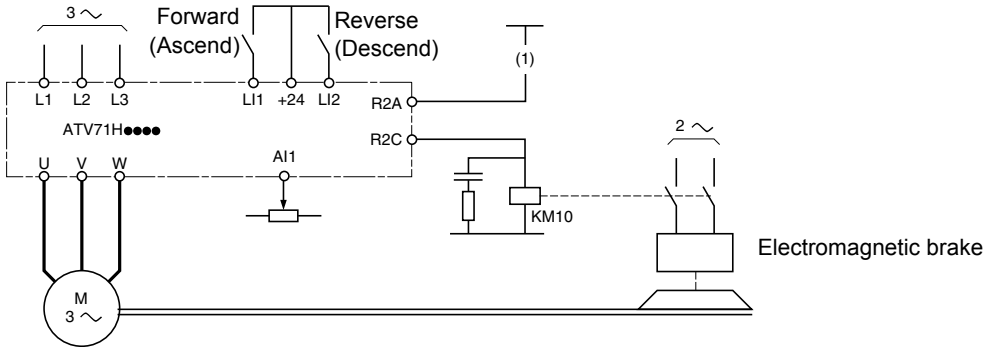

(1) A contact on the Preventa module must be inserted in the brake control circuit to engage it safely when the "Power Removal" safety function is activated (see connection diagrams in the Installation Manual).

[Mast./slave] (MSL) diagram

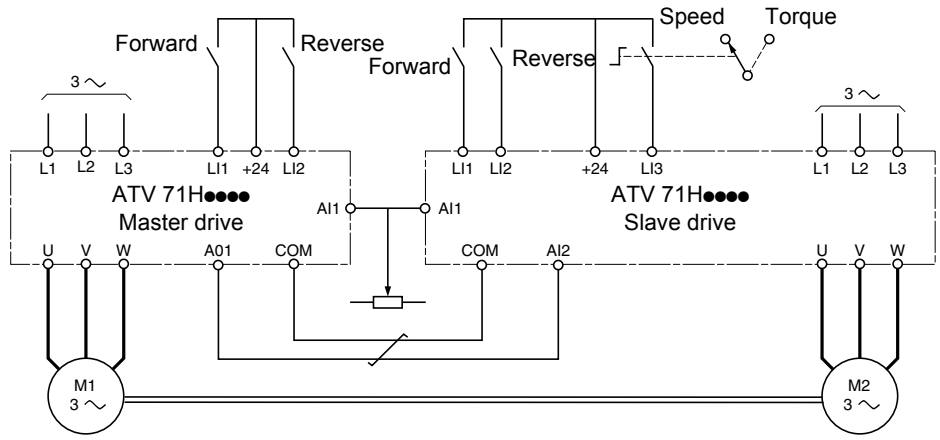


When the two motors are mechanically connected, the Speed/torque contact closing results in operation in Mast./slave mode. The master drive regulates the speed and controls the slave drive in torque mode to ensure distribution of the load.

Code	Name/Description	Adjustment range	Factory setting
tCC	❑ **[2/3 wire control]**		[2 wire] (2C)
2C	☐ **[2 wire]** (2C)		
3C	☐ **[3 wire]** (3C)		

2-wire control: This is the input state (0 or 1) or edge (0 to 1 or 1 to 0), which controls running or stopping.


Example of "source" wiring:



LI1: forward
LIx: reverse

3-wire control (pulse commands): A "forward" or "reverse" pulse is sufficient to command starting, a "stop" pulse is sufficient to command stopping.

Example of "source" wiring:



LI1: stop
LI2: forward
LIx: reverse

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION

To change the assignment of [2/3 wire control] (tCC) press and hold down the “ENT” key for 2 s. The following function will be returned to factory settings: [2 wire type] (tCt) page 92 as will all functions which assign logic inputs.
The macro configuration selected will also be reset it if has been customized (loss of custom settings).
Check that this change is compatible with the wiring diagram used.
Failure to follow these instructions can result in death or serious injury.

CFG	❑ **[Macro configuration]**		[Start/Stop] (StS)
StS	☐ **[Start/Stop]** (StS): Start/stop		
HdG	☐ **[M. handling]** (HdG): Handling		
HSt	☐ **[Hoisting]** (HSt): Hoisting		
GEn	☐ **[Gen. Use]** (GEn): General use		
PId	☐ **[PID regul.]** (PId): PID regulation		
nEt	☐ **[Network C.]** (nEt): Communication bus		
MSL	☐ **[Mast./slave]** (MSL): Master/slave		

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION

To change the assignment of [Macro configuration] (CFG) press and hold down the “ENT” key for 2 s.
Check that the selected macro configuration is compatible with the wiring diagram used.
Failure to follow these instructions can result in death or serious injury.

CCFG	❑ **[Customized macro]**		
	Read-only parameter, only visible if at least one macro configuration parameter has been modified.		
YES	☐ **[Yes]** (YES)		

Code	Name/Description	Adjustment range	Factory setting
bFr	❑ **[Standard mot. freq]**		[50Hz IEC] (50)
50 60	☐ **[50Hz IEC]** (50): IEC ☐ **[60Hz NEMA]** (60): NEMA This parameter modifies the presets of the following parameters:[Rated motor volt.] (UnS) below, [High speed] (HSP) page 44, [Freq. threshold] (Ftd) page 68, [Rated motor freq.] (FrS) and [Max frequency] (tFr) .		
IPL	❑ **[Input phase loss]**		According to drive rating
nO YES	☐ **[Ignore]** (nO): Fault ignored, to be used when the drive is supplied via a single-phase supply or by the DC bus. ☐ **[Freewheel]** (YES): Fault, with freewheel stop. If one phase disappears, the drive switches to fault mode [Input phase loss] (IPL), but if 2 or 3 phases disappear, the drive continues to operate until it trips on an undervoltage fault. This parameter is accessible in this menu only on ATV71H037M3 to HU75M3 drives (used with a single phase supply).		
nPr	❑ **[Rated motor power]**	According to drive rating	According to drive rating
	Rated motor power given on the nameplate, in kW if [Standard mot. freq] (bFr) = [50Hz IEC] (50), in HP if [Standard mot. freq] (bFr) = [60Hz NEMA] (60).		
UnS	❑ **[Rated motor volt.]**	According to drive rating	According to drive rating and [Standard mot. freq] (bFr)
	Rated motor voltage given on the nameplate. ATV71●●●M3: 100 to 240 V - ATV71●●●N4: 200 to 480 V - ATV71●●●S6X: 400 to 600 V - ATV71●●●Y: 400 to 690 V		
nCr	❑ **[Rated mot. current]**	0.25 to 1.5 In (1)	According to drive rating and [Standard mot. freq] (bFr)
	Rated motor current given on the nameplate.		
FrS	❑ **[Rated motor freq.]**	10 to 1600 Hz	50 Hz
	Rated motor frequency given on the nameplate. The factory setting is 50 Hz, or preset to 60 Hz if [Standard mot. freq] (bFr) is set to 60 Hz.		
nSP	❑ **[Rated motor speed]**	0 to 65535 RPM	According to drive rating
	Rated motor speed given on the nameplate. 0 to 9999 rpm then 10.00 to 60.00 krpm on the integrated display terminal. If, rather than the rated speed, the nameplate indicates the synchronous speed and the slip in Hz or as a %, calculate the rated speed as follows: • Nominal speed = Synchronous speed x $\frac{100 - \text{slip as a \%}}{100}$ or • Nominal speed = Synchronous speed x $\frac{50 - \text{slip in Hz}}{50}$ (50 Hz motors) or • Nominal speed = Synchronous speed x $\frac{60 - \text{slip in Hz}}{60}$ (60 Hz motors)		
tFr	❑ **[Max frequency]**	10 to 500 or 599 Hz according to rating	60 Hz
	The factory setting is 60 Hz, or preset to 72 Hz if [Standard mot. freq] (bFr) is set to 60 Hz. The maximum value is limited by the following conditions: • It must not exceed 10 times the value of [Rated motor freq.] (FrS) • Values between 500 Hz and 599 Hz are not possible for ATV71H●●●Y (500 to 690 V) • Values between 500 Hz and 599 Hz are only possible in V/F control and for powers limited to 37 kW (50 HP). In this case, configure [Motor control type] (Ctt) before [Max frequency] (tFr).		

(1) In corresponds to the rated drive current indicated in the Installation Manual and on the drive nameplate.

Code	Name/Description	Factory setting
tun	❑ **[Auto tuning]**	[No] (nO)

⚠⚠ DANGER

HAZARD OF ELECTRIC SHOCK OR ARC FLASH

- During auto-tuning, the motor operates at rated current.
- Do not service the motor during auto-tuning.

Failure to follow these instructions will result in death or serious injury.

⚠ WARNING

LOSS OF CONTROL

- It is essential that the following parameters [Rated motor volt.] (UnS), [Rated motor freq.] (FrS), [Rated mot. current] (nCr), [Rated motor speed] (nSP) and [Rated motor power] (nPr) are correctly configured before starting auto-tuning for asynchronous motor.
- It is essential that the following parameters [Nominal I sync] (nCrS), [Nom motor spdsync] (nSPS), [Pole pairs.] (PPnS), [Syn. EMF constant] (PHS), [Autotune L d-axis] (LdS) and [Autotune L q-axis] (LqS) are correctly configured before starting auto-tuning for synchronous motor.
- When one or more of these parameters have been changed after auto-tuning has been performed, [Auto tuning] (tUn) will return [No] (nO) and the procedure will have to be repeated.

Failure to follow these instructions can result in death, serious injury or equipment damage.

nO [No] (nO): Auto-tuning not performed.
YES **[Yes]** (YES): Auto-tuning is performed as soon as possible, then the parameter automatically changes to [Done] (dOnE).
donE [Done] (dOnE): Use of the values given the last time auto-tuning was performed.

Note:

- Auto-tuning is only performed if no stop command has been activated. If a "freewheel stop" or "fast stop" function has been assigned to a logic input, this input must be set to 1 (active at 0).
- Auto-tuning takes priority over any run or prefluxing commands, which will be taken into account after the auto-tuning sequence.
- If auto-tuning fails, the drive displays [No] (nO) and, depending on the configuration of [Autotune fault mgt] (tnL) page 242, may switch to [Auto-tuning] (tnF) fault mode.
- Auto-tuning may last for 1 to 2 seconds. Do not interrupt the process. Wait for the display to change to "[Done] (dOnE)" or "[No] (nO)".

tUS	❑ **[Auto tuning status]**	[Not done] (tAb)

(for information only, cannot be modified)

tAb **[Not done]** (tAb): The default stator resistance value is used to control the motor.
PEnd **[Pending]** (PEnd): Auto-tuning has been requested but not yet performed.
PrOG **[In Progress]** (PrOG): Auto-tuning in progress.
FAIL **[Failed]** (FAIL): Auto-tuning has failed.
donE **[Done]** (dOnE): The stator resistance measured by the auto-tuning function is used to control the motor.

PHr	❑ **[Output Ph rotation]**	[ABC] (AbC)

AbC **[ABC]** (AbC): Forward
ACb **[ACB]** (ACb): Reverse

This parameter can be used to reverse the direction of rotation of the motor without reversing the wiring.


Parameters that can be changed during operation or when stopped

Code	Name/Description		Factory setting
ItH	❑ [Mot. therm. current]	0.2 to 1.5 In (1)	According to drive rating
	Motor thermal protection current, to be set to the rated current indicated on the nameplate.		
ACC	❑ [Acceleration]	0.1 to 999.9 s	3.0 s
	Time to accelerate from 0 to the [Rated motor freq.] (FrS) (page 42). Make sure that this value is compatible with the inertia being driven.		
dEC	❑ [Deceleration]	0.1 to 999.9 s	3.0 s
	Time to decelerate from the [Rated motor freq.] (FrS) (page 42) to 0. Make sure that this value is compatible with the inertia being driven.		
LSP	❑ [Low speed]		0
	Motor frequency at minimum reference, can be set between 0 and [High speed] (HSP).		
HSP	❑ [High speed]		50 Hz
	Motor frequency at maximum reference, can be set between [Low speed] (LSP) and [Max frequency] (tFr). The factory setting changes to 60 Hz if [Standard mot. freq] (bFr) = [60Hz NEMA] (60).		


(1) In corresponds to the rated drive current indicated in the Installation Manual and on the drive nameplate.

[1.2 MONITORING] (SUP-)

With graphic display terminal:

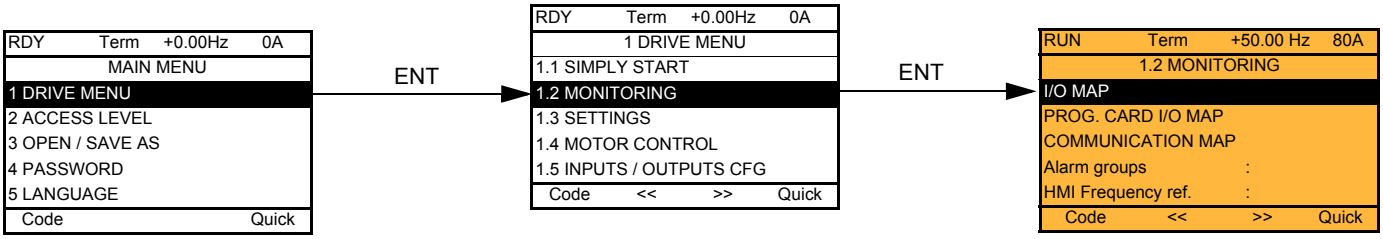


With integrated display terminal:

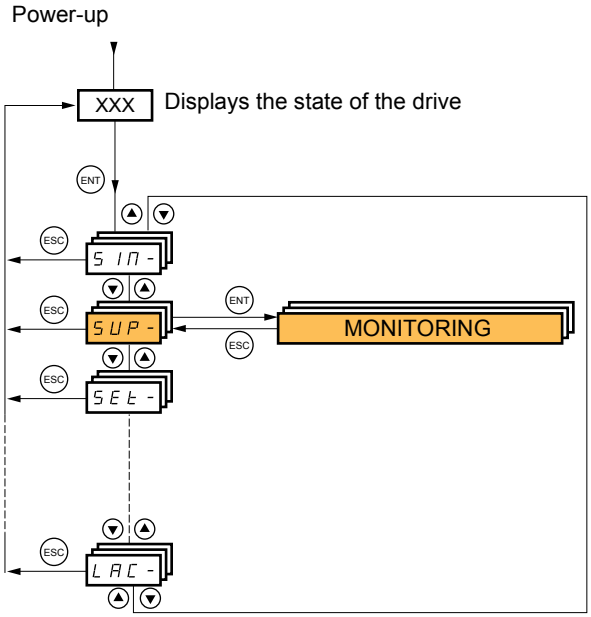


With graphic display terminal

This menu can be used to display the inputs/outputs, the drive internal states and values, and the communication data and values.

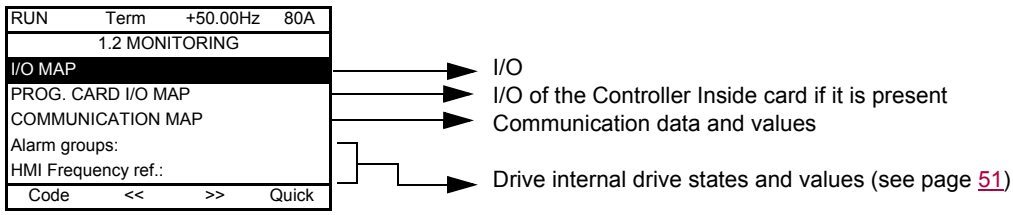


I/O

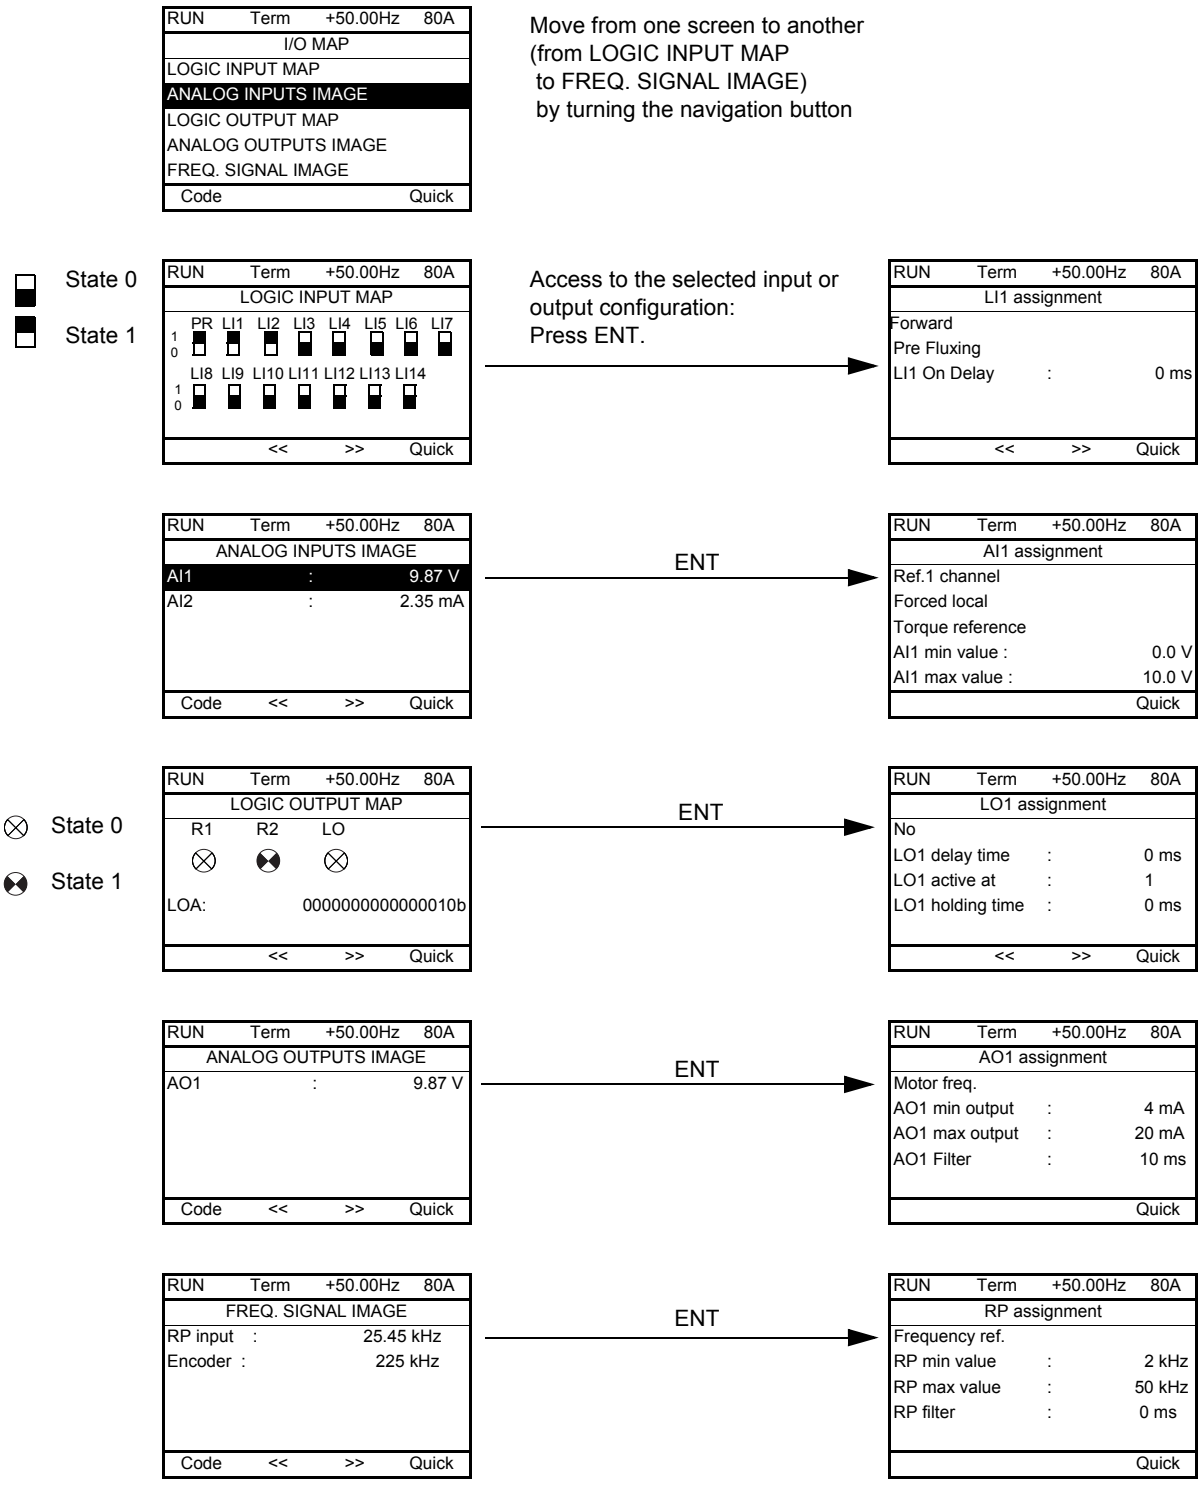


With graphic display terminal

Controller Inside card I/O

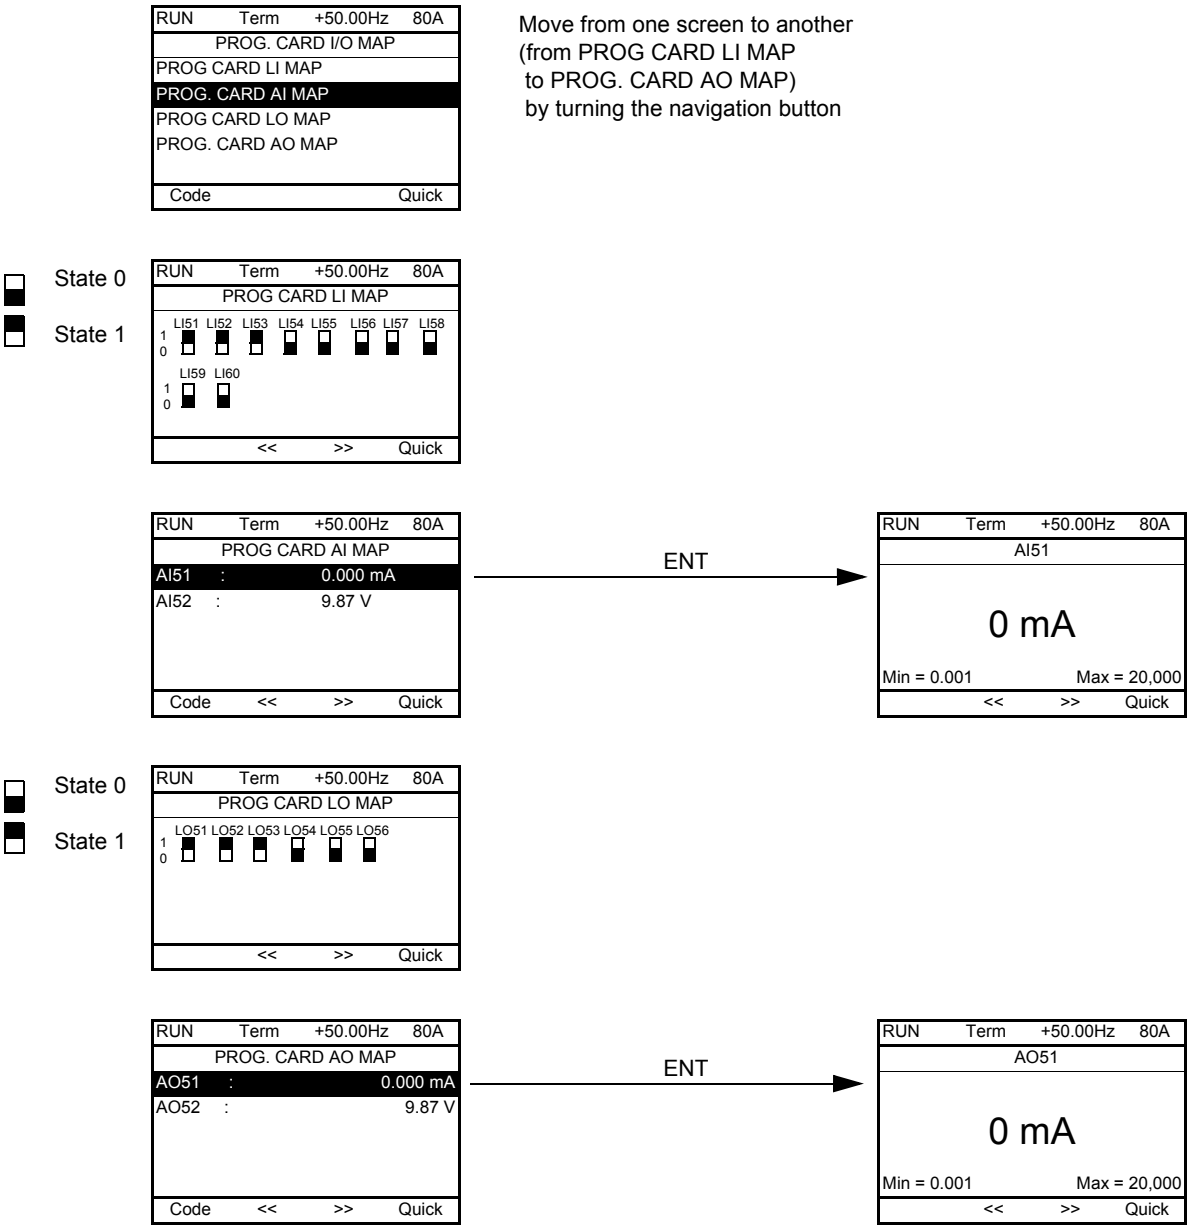

With graphic display terminal

Communication

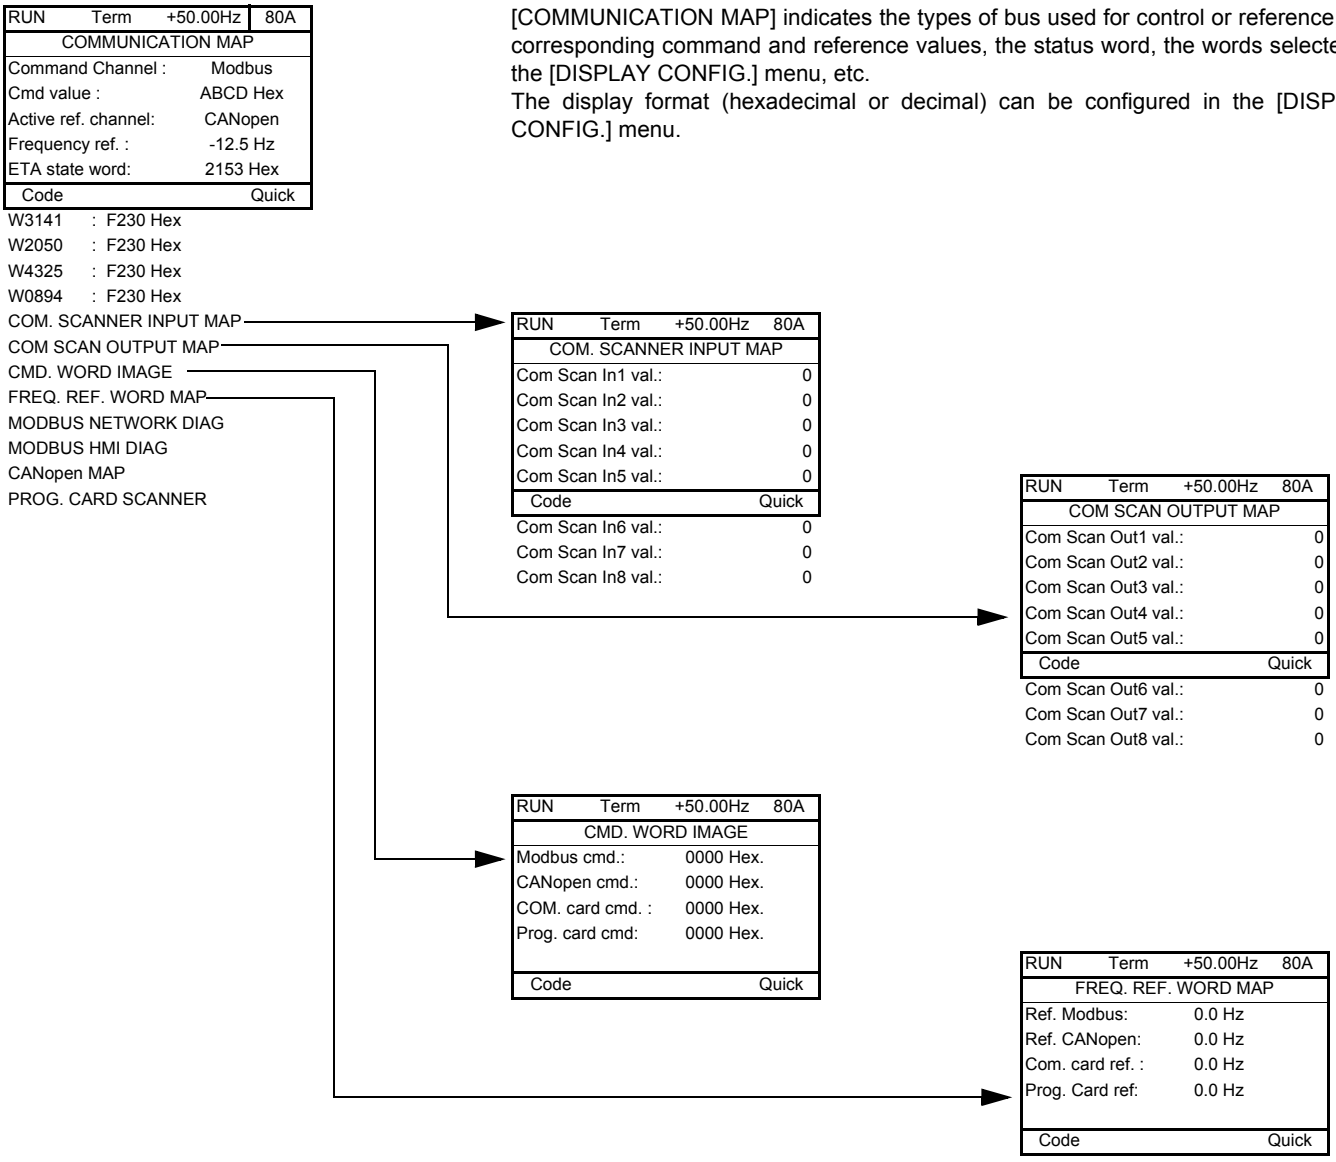


[COMMUNICATION MAP] indicates the types of bus used for control or reference, the corresponding command and reference values, the status word, the words selected in the [DISPLAY CONFIG.] menu, etc.
The display format (hexadecimal or decimal) can be configured in the [DISPLAY CONFIG.] menu.

[COM. SCANNER INPUT MAP] and [COM SCAN OUTPUT MAP]:
Visualization of registers exchanged periodically (8 input and 8 output) for integrated Modbus and for fieldbus cards.


With graphic display terminal

Communication (continued)

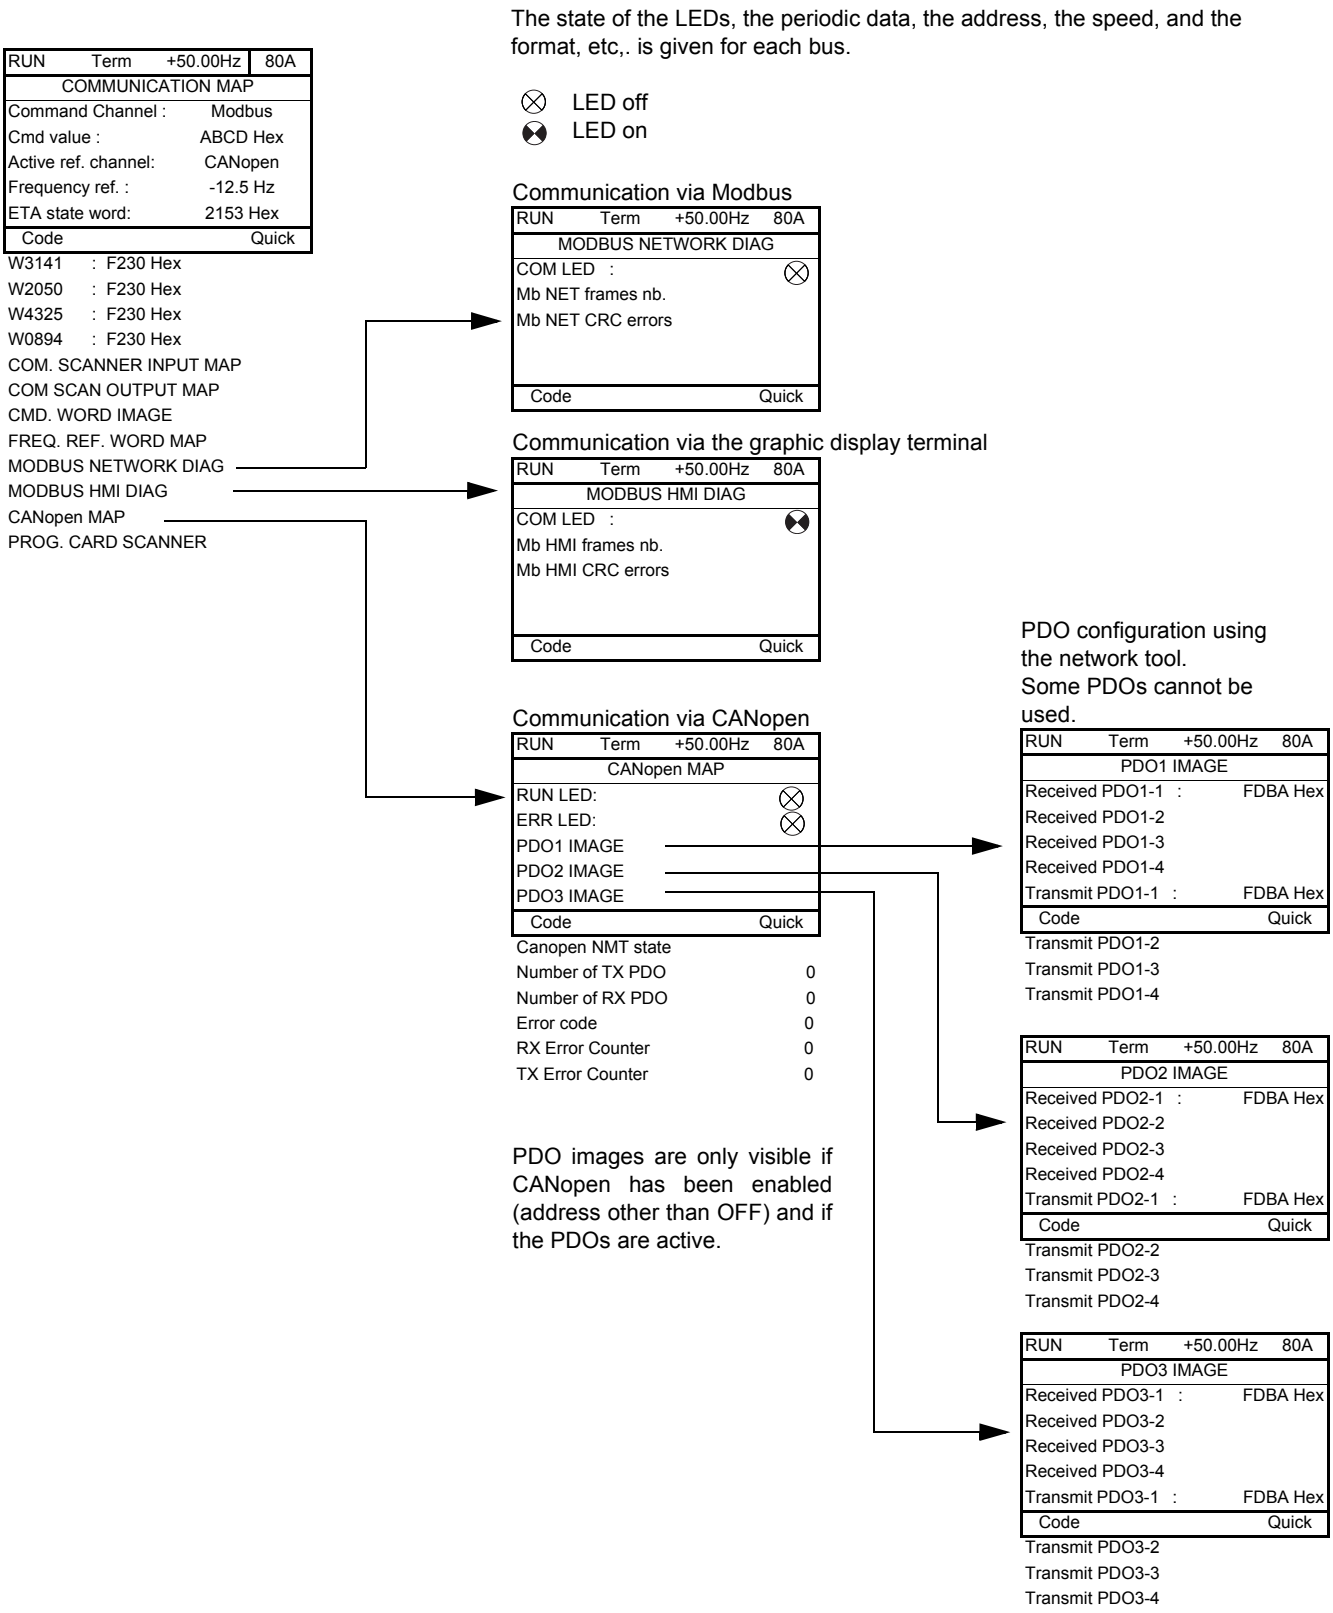

With graphic display terminal

Communication (continued)

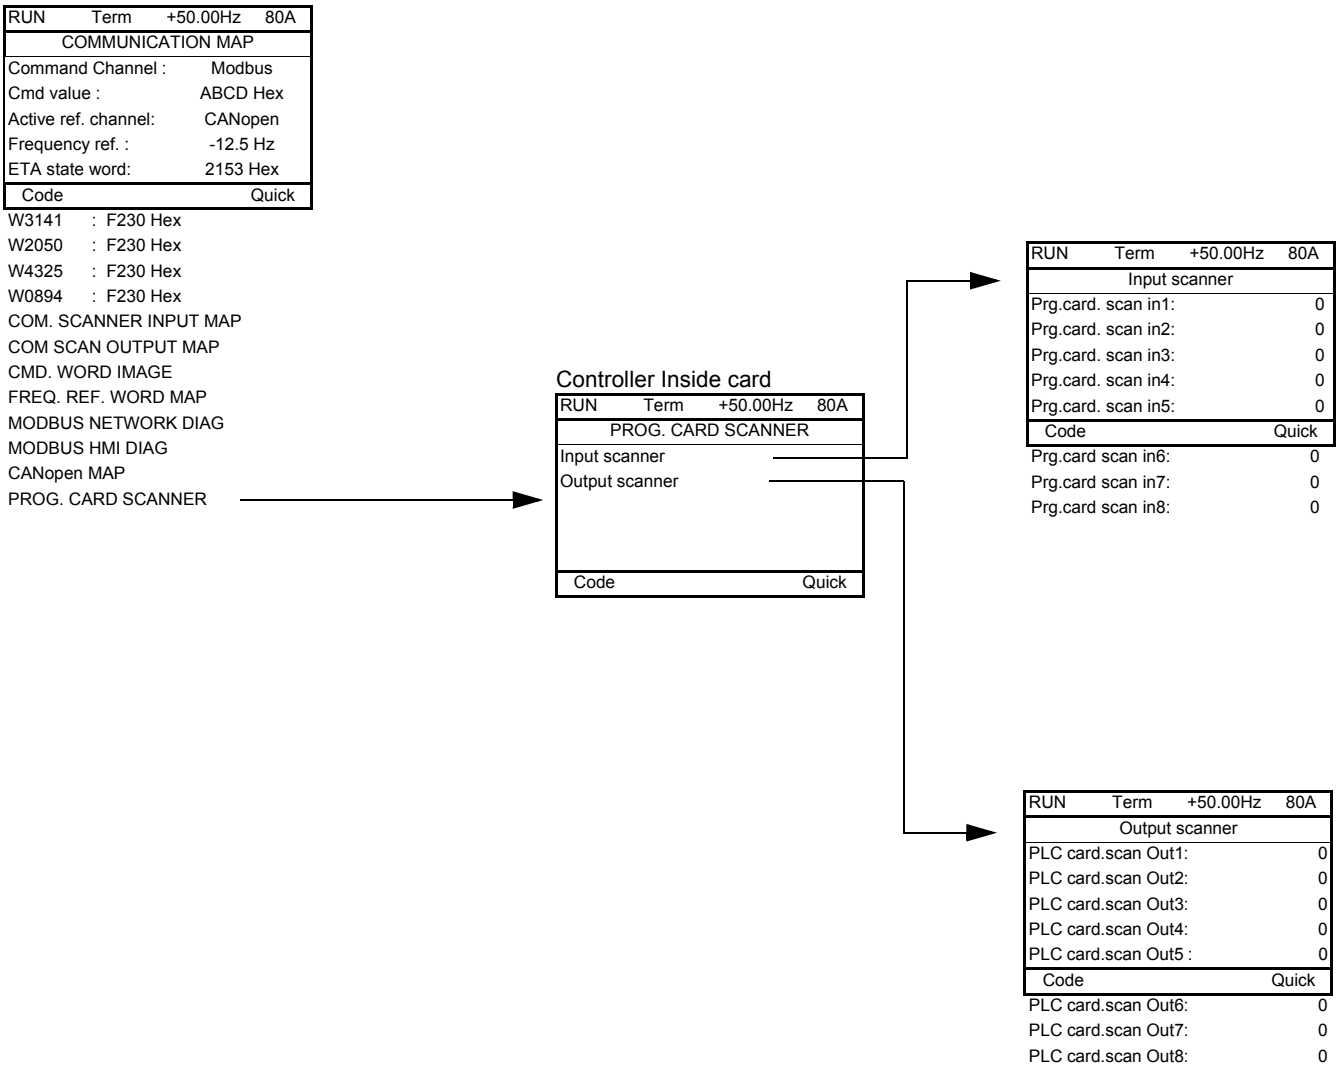

[Input scanner] and [Output scanner]:
Visualization of registers exchanged periodically (8 input and 8 output).



With graphic display terminal: Drive-internal states and values

Name/Description	
[Alarm groups] (ALGr)	Current alarm group numbers
[Frequency ref.] (LFr)	in Hz. Frequency reference via the graphic display terminal (can be accessed if the function has been configured).
[Internal PID ref.] (rPI)	as a process value. PID reference via graphic display terminal (can be accessed if the function has been configured).
[Torque ref.] (Ltr)	as a % of the rated torque. Torque reference via graphic display terminal.
[Multiplying coeff.] (MFr)	as a % (can be accessed if [Multiplier ref. -] (MA2,MA3) page 139 has been assigned)
[Frequency ref.] (FrH)	in Hz
[Torque reference] (trr)	as a % of the rated torque (can be accessed if the function has been configured)
[Output frequency] (rFr)	in Hz
[Measured output fr.] (MMF)	in Hz: The measured motor speed is displayed if an encoder card has been inserted, otherwise 0 appears.
[Pulse in. work. freq.] (FqS)	in Hz: Frequency of the "Pulse input" input used by the [FREQUENCY METER] (FqF-) function, page 239.
[Motor current] (LCr)	in A
[ENA avg speed] (AUS)	in Hz: The parameter can be accessed if [ENA system] (EnA) = [Yes] (YES) (see page 83)
[Motor speed] (SPd)	in rpm
[Motor voltage] (UOP)	in V
[Motor power] (OPr)	as a % of the rated power
[Motor torque] (Otr)	as a % of the rated torque
[Mains voltage] (ULn)	in V. Line voltage from the point of view of the DC bus, motor running or stopped.
[Motor thermal state] (tHr)	as a %
[Drv.thermal state] (tHd)	as a %
[DBR thermal state] (tHb)	as a % (can be accessed if [DB res. protection] (brO) has been enabled, see page 242)
[Consumption] (APH)	in Wh, kWh or MWh (accumulated consumption)
[Run time] (rtH)	in seconds, minutes or hours (length of time the motor has been switched on)
[Power on time] (PtH)	in seconds, minutes or hours (length of time the drive has been switched on)
[IGBT alarm counter] (tAC)	in seconds (length of time the "IGBT temperature" alarm has been active)
[PID reference] (rPC)	as a process value (can be accessed if the PID function has been configured)
[PID feedback] (rPF)	as a process value (can be accessed if the PID function has been configured)
[PID error] (rPE)	as a process value (can be accessed if the PID function has been configured)
[PID Output] (rPO)	in Hz (can be accessed if the PID function has been configured)
[Date/Time] (CLO)	Current date and time generated by the Controller Inside card (can be accessed if the card has been inserted)
[- - - - -] (o02) to [- - - - -] (o06)	Words generated by the Controller Inside card (can be accessed if the card has been inserted)
[Config. active] (CnFS)	Active configuration [Config. n°0, 1 or 2]
[Utilised param. set] (CFPS)	[Set n°1, 2 or 3] (can be accessed if parameter switching has been enabled, see page 203)
[ALARMS] (ALr-)	List of current alarms. If an alarm is present, a ✓ appears.
[OTHER STATE] (SSt-)	List of secondary states:

- [In motor fluxing] (FLX): In motor fluxing
- [PTC1 alarm] (PtC1): Probe alarm 1
- [PTC2 alarm] (PtC2): Probe alarm 2
- [LI6=PTC alarm] (PtC3): LI6 = PTC probe alarm
- [Fast stop in prog.] (FSt): Fast stop in progress
- [Current Th. attained] (CtA): Current threshold attained ([Current threshold] (Ctd) page 67)
- [Freq. Th. attained] (FtA): Frequency threshold attained ([Freq. threshold] (Ftd) page 68)
- [Freq. Th. 2 attained] (F2A): 2nd frequency threshold attained ([Freq. threshold 2] (F2d) page 68)
- [Frequency ref. att.] (SrA): Frequency reference attained
- [Motor th. state att.] (tSA): Motor 1 thermal state attained
- [External fault alarm] (EtF): External fault alarm
- [Auto restart] (AUtO): Automatic restart in progress
- [Remote] (FtL) : Line mode control
- [Auto-tuning] (tUn): Performing auto-tuning
- [Undervoltage] (USA): Undervoltage alarm
- [Cnfg.1 act.] (CnF1): Configuration 1 active
- [Cnfg.2 act.] (CnF2): Configuration 2 active
- [HSP attained] (FLA): High speed attained
- [Load slipping] (AnA): Slipping alarm
- [Set 1 active] (CFP1): Parameter set 1 active
- [Set 2 active] (CFP2): Parameter set 2 active
- [Set 3 active] (CFP3): Parameter set 3 active
- [In braking] (brS): Drive braking
- [DC bus loading] (dbL): DC bus loading
- [Forward] (MFrd): Motor running forward
- [Reverse] (MrrS): Motor running in reverse
- [High torque alarm] (ttHA): Motor torque overshooting high threshold [High torque thd.] (ttH) page 67.
- [Low torque alarm] (ttLA): Motor torque undershooting low threshold [Low torque thd.] (ttL) page 67.
- [Freq. meter Alarm] (FqLA): Measured speed threshold attained: [Pulse warning thd.] (FqL) page 68.

With integrated display terminal

This menu can be used to display the drive inputs, states and internal values.

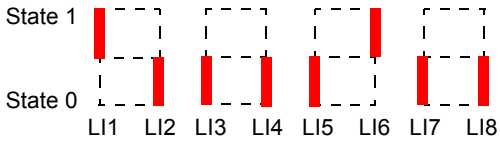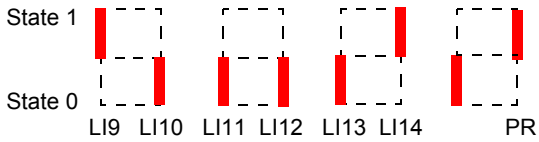
Code	Name/Description	Adjustment range	Factory setting
iOM-	**I/O MAP**		
LIA-	**Logic input functions**		
LI1A to LI14A	Can be used to display the functions assigned to each input. If no functions have been assigned, nO is displayed. Use the ▲ and ▼ arrows to scroll through the functions. If a number of functions have been assigned to the same input, check that they are compatible.		
LIS1	**State of logic inputs LI1 to LI8**		
	Can be used to visualize the state of logic inputs LI1 to LI8 (display segment assignment: high = 1, low = 0)  Example above: LI1 and LI6 are at 1; LI2 to LI5, LI7 and LI8 are at 0.		
LIS2	**State of logic inputs LI9 to LI14 and Power Removal**		
	Can be used to visualize the state of logic inputs LI9 to LI14 and PR (Power Removal) (display segment assignment: high = 1, low = 0)  Example above: LI9 and LI14 are at 1, LI10 to LI13 are at 0 and PR (Power Removal) is at 1.		
AIA-	**Analog input functions**		
AI1A AI2A AI3A AI4A	Can be used to display the functions assigned to each input. If no functions have been assigned, nO is displayed. Use the ▲ and ▼ arrows to scroll through the functions. If a number of functions have been assigned to the same input, check that they are compatible.		

With integrated display terminal: Drive-internal states and values


Code	Name/Description	Unit
ALGr	**Alarm groups:** Current alarm group numbers	
rP1	**Internal PID reference:** PID reference via graphic display terminal (can be accessed if the function has been configured).	as a process value
MFr	**Multiplication coefficient** (can be accessed if [Multiplier ref. -] (MA2,MA3) page 139 has been assigned)	%
FrH	**Frequency ref.**	Hz
trr	**Torque reference:** Can be accessed if the function has been configured	%.
rFr	**Output frequency**	Hz
MMF	**The measured motor speed is displayed** if an encoder card has been inserted, otherwise 0 appears.	Hz
FqS	**Frequency of the "Pulse input" input** used by the [FREQUENCY METER] (FqF-) function, page 239.	Hz
LCr	**Motor current**	A
AuS	**ENA avg SPEED:** The parameter can be accessed if EnA = YES (see page 83)	Hz
SPd	**Motor speed**	rpm
uoP	**Motor voltage**	V
oPr	**Motor power**	%
otr	**Motor torque**	%
uLn	**Line voltage:** Line voltage from the point of view of the DC bus, motor running or stopped.	V
tHr	**Motor thermal state**	%
tHd	**Drv thermal state**	%
tHb	**DBR thermal state:** Can be accessed if [DB res. protection] (brO) function has been configured	%
APH	**Power consumption**	Wh, kWh or MWh
rtH	**Run time:** Length of time the motor has been turned on	seconds, minutes or hours
PtH	**Power on time:** Length of time the drive has been turned on	
tAC	**IGBT alarm counter:** Length of time the "IGBT temperature" alarm has been active	seconds
rPC	**PID reference:** Can be accessed if the PID function has been configured	as a process value
rPF	**PID feedback:** Can be accessed if the PID function has been configured	
rPE	**PID error:** Can be accessed if the PID function has been configured	
rPo	**PID Output:** Can be accessed if the PID function has been configured	Hz
CLo-	**tIME, dAY:** Current date and time generated by the Controller Inside card (can be accessed if the card has been inserted)	
o02	Word generated by the Controller Inside card (can be accessed if the card has been inserted)	
o03	Word generated by the Controller Inside card (can be accessed if the card has been inserted)	
o04	Word generated by the Controller Inside card (can be accessed if the card has been inserted)	
o05	Word generated by the Controller Inside card (can be accessed if the card has been inserted)	
o06	Word generated by the Controller Inside card (can be accessed if the card has been inserted)	
CnFS	**Config. active:** CnF0, 1 or 2 (can be accessed if motor or configuration switching has been enabled, see page 208)	
CFPS	**Utilised param. set:** CFP1, 2 or 3 (can be accessed if parameter switching has been enabled, see page 203)	

[1.3 SETTINGS] (SEt-)

With graphic display terminal:

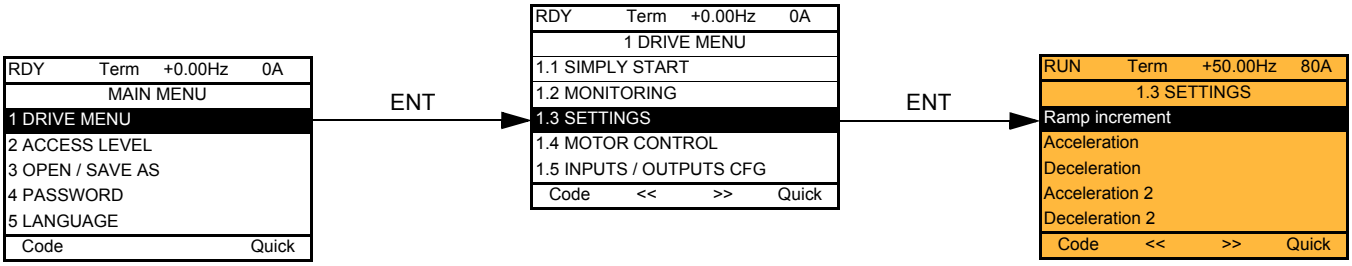

With integrated display terminal:

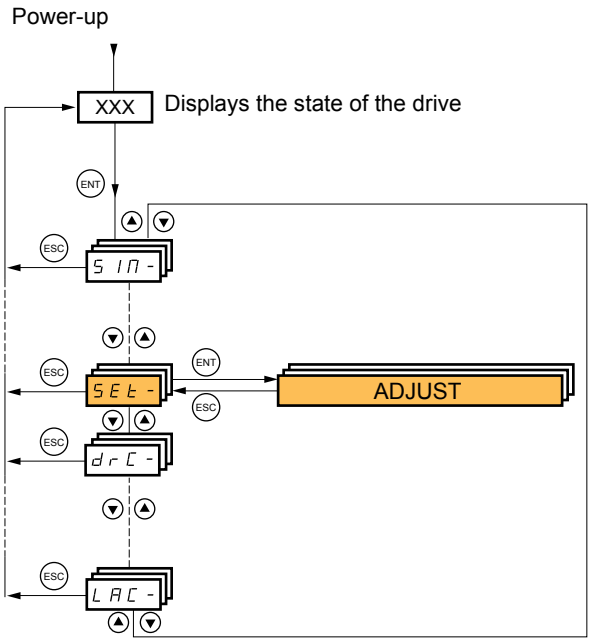

[1.3 SETTINGS] (SEt-)

The adjustment parameters can be modified with the drive running or stopped.

⚠ DANGER

UNINTENDED EQUIPMENT OPERATION

- Check that changes made to the settings during operation do not present any danger.
- We recommend stopping the drive before making any changes.

Failure to follow these instructions will result in death or serious injury.

Code	Name/Description	Adjustment range	Factory setting
inr 0.01 0.1 1	❑ **[Ramp increment]** ☐ **[0,01]**: ramp up to 99.99 seconds ☐ **[0,1]**: ramp up to 999.9 seconds ☐ **[1]**: ramp up to 6000 seconds This parameter is valid for [Acceleration] (ACC), [Deceleration] (dEC), [Acceleration 2] (AC2) and [Deceleration 2] (dE2).	0,01 - 0,1 - 1	0,1
ACC	❑ **[Acceleration]** Time to accelerate from 0 to the [Rated motor freq.] (FrS) (page 70). Make sure that this value is compatible with the inertia being driven.	0.01 to 6000 s (1)	3.0 s
dEC	❑ **[Deceleration]** Time to decelerate from the [Rated motor freq.] (FrS) (page 70) to 0. Make sure that this value is compatible with the inertia being driven.	0.01 to 6000 s (1)	3.0 s
AC2 ★	❑ **[Acceleration 2]** See page 142 Time to accelerate from 0 to the [Rated motor freq.] (FrS). Make sure that this value is compatible with the inertia being driven.	0.01 to 6000 s (1)	5.0 s
dE2 ★	❑ **[Deceleration 2]** See page 142 Time to decelerate from the [Rated motor freq.] (FrS) to 0. Make sure that this value is compatible with the inertia being driven.	0.01 to 6000 s (1)	5.0 s
tA1 ★	❑ **[Begin Acc round]** See page 141 Rounding of start of acceleration ramp as a % of the [Acceleration] (ACC) or [Acceleration 2] (AC2) ramp time.	0 to 100%	10%
tA2 ★	❑ **[End Acc round]** See page 141 - Rounding of end of acceleration ramp as a % of the [Acceleration] (ACC) or [Acceleration 2] (AC2) ramp time. - Can be set between 0 and (100% - [Begin Acc round] (tA1))		10%
tA3 ★	❑ **Begin Dec round]** See page 141 Rounding of start of deceleration ramp as a % of the [Deceleration] (dEC) or [Deceleration 2] (dE2) ramp time.	0 to 100%	10%

(1) Range 0.01 to 99.99 s or 0.1 to 999.9 s or 1 to 6000 s according to [Ramp increment] (Inr).

★ These parameters only appear if the corresponding function has been selected in another menu. When the parameters can also be accessed and adjusted from within the configuration menu for the corresponding function, their description is detailed in these menus, on the pages indicated, to aid programming.

Code	Name/Description	Adjustment range	Factory setting
tA4 ★	❑ **[End Dec round]** See page 141 - Rounding of end of deceleration ramp as a % of the [Deceleration] (dEC) or [Deceleration 2] (dE2) ramp time. - Can be set between 0 and (100% - [Begin Dec round] (tA3))		10%
LSP	❑ **[Low speed]** Motor frequency at minimum reference, can be set between 0 and [High speed] (HSP).		0 Hz
HSP	❑ **[High speed]** Motor frequency at maximum reference, can be set between [Low speed] (LSP) and [Max frequency] (tFr). The factory setting changes to 60 Hz if [Standard mot. freq] (bFr) = [60Hz NEMA] (60).		50 Hz
ItH	❑ **[Mot. therm. current]** Motor thermal protection current, to be set to the rated current indicated on the nameplate.	0.2 to 1.5 In (1)	According to drive rating
SPG	❑ **[Speed prop. gain]** Speed loop proportional gain	0 to 1000%	40%
SIt	❑ **[Speed time integral]** Speed loop integral time constant.	1 to 1000%	100%
SFC	❑ **[K speed loop filter]** Speed loop filter coefficient.	0 to 100	0

(1) In corresponds to the rated drive current indicated in the Installation Manual or on the drive nameplate.

Parameter settings for [K speed loop filter] (SFC), [Speed prop. gain] (SPG) and [Speed time integral] (SIt)


- The following parameters can only be accessed in vector control profiles: [Motor control type] (Ctt) page 73 = [SVC V] (UUC), [SVC I] (CUC), [FVC] (FUC), or [Sync. mot.] (SYn) and if [ENA system] (EnA) page 83 = [No] (nO).
- The factory settings are suitable for most applications.

General case: Setting for [K speed loop filter] (SFC) = 0


The regulator is an "IP" type with filtering of the speed reference, for applications requiring flexibility and stability (hoisting or high inertia, for example).

- [Speed prop. gain] (SPG) affects excessive speed.
- [Speed time integral] (SIt) affects the passband and response time.


Initial response

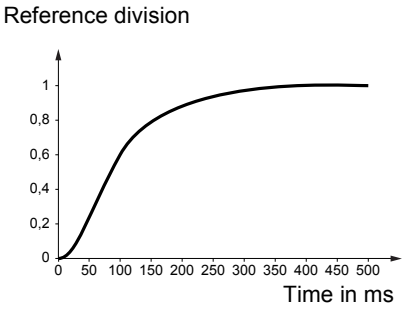


Reduction in SIT ↘

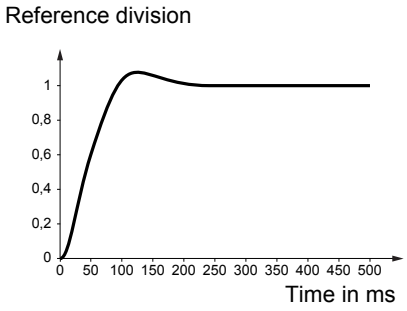


Reduction in SIT ↘↘

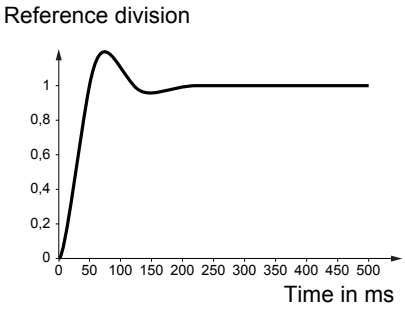


Initial response

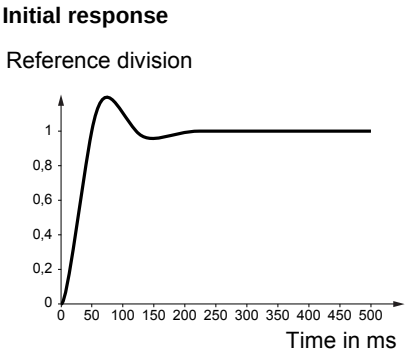

Increase in SPG ↗

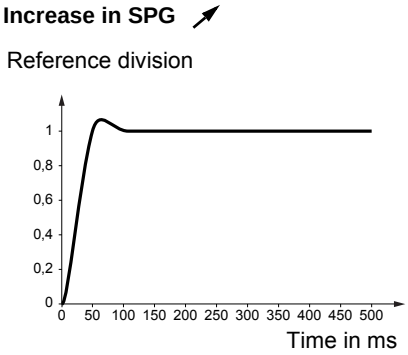

Increase in SPG ↗↗

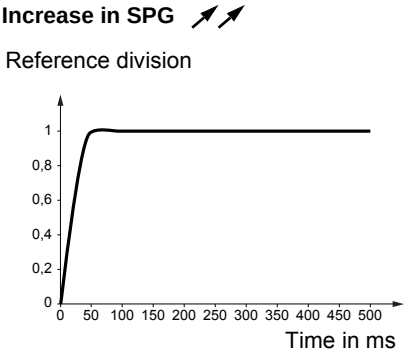

Special case: Parameter [K speed loop filter] (SFC) not 0

This parameter must be reserved for specific applications that require a short response time (trajectory positioning or servo control).


- When set to 100 as described above the regulator is a “PI” type, without filtering of the speed reference.
- Settings between 0 and 100 will obtain an intermediate function between the settings below and those on the previous page.

Example: Setting for [K speed loop filter] (SFC) = 100

- [Speed prop. gain] (SPG) affects the passband and response time.
- [Speed time integral] (SIt) affects excessive speed.


Initial response

Reference division

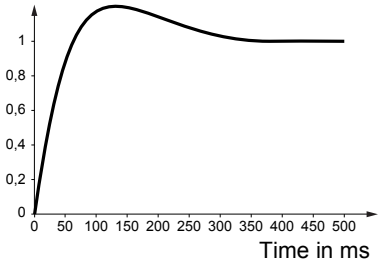


Reduction in SIT ↘

Reference division

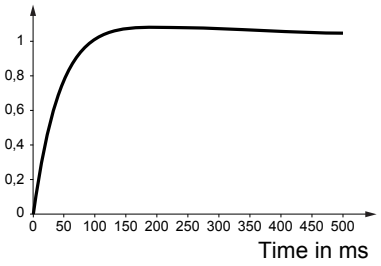


Reduction in SIT ↘↘

Reference division

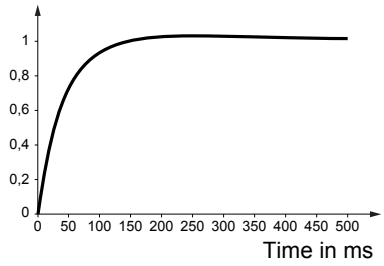


Initial response

Reference division

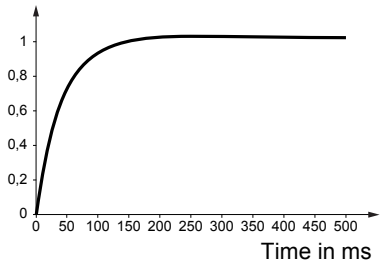


Increase in SPG ↗

Reference division

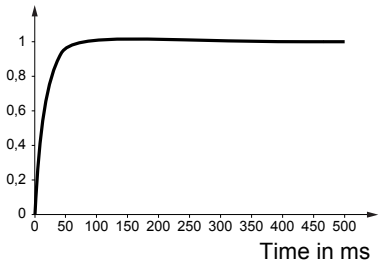

Increase in SPG ↗↗

Reference division

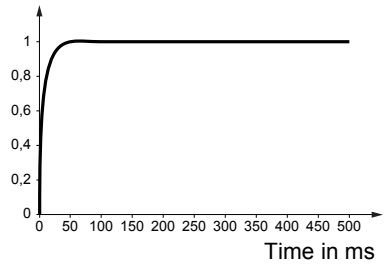

Code	Name/Description	Adjustment range	Factory setting
GPE ★	❑ [ENA prop.gain] See page 83	1 to 9999	250
G iE ★	❑ [ENA integral gain] See page 83	0 to 9999	100
uFr ★	❑ [IR compensation] See page 76	25 to 200%	100%
SLP ★	❑ [Slip compensation] See page 76	0 to 300%	100%
dCF ★	❑ [Ramp divider] See page 144	0 to 10	4
idC ★	❑ [DC inject. level 1] See page 145 Level of DC injection braking current activated via logic input or selected as stop mode. **CAUTION** Check that the motor will withstand this current without overheating. **Failure to follow this instruction can result in equipment damage.**	0.1 to 1.41 In (1)	0.64 In (1)
tdi ★	❑ [DC injection time 1] See page 145 Maximum current injection time [DC inject. level 1] (IdC). After this time the injection current becomes [DC inject. level 2] (IdC2).	0.1 to 30 s	0.5 s
idC2 ★	❑ [DC inject. level 2] See page 145 Injection current activated by logic input or selected as stop mode, once period of time [DC injection time 1] (tdI) has elapsed. **CAUTION** Check that the motor will withstand this current without overheating. **Failure to follow this instruction can result in equipment damage.**	0.1 In (2) to [DC inject. level 1] (IdC)	0.5 In (1)
tdC ★	❑ [DC injection time 2] See page 145 Maximum injection time [DC inject. level 2] (IdC2) for injection selected as stop mode only.	0.1 to 30 s	0.5 s

(1) In corresponds to the rated drive current indicated in the Installation Manual or on the drive nameplate.

★ These parameters only appear if the corresponding function has been selected in another menu. When the parameters can also be accessed and adjusted from within the configuration menu for the corresponding function, their description is detailed in these menus, on the pages indicated, to aid programming.

Code	Name/Description	Adjustment range	Factory setting
SdC1 ★	❑ [Auto DC inj. level 1]	0 to 1.2 In (1)	0.7 In (1)

Level of standstill DC injection current. This parameter can be accessed if [Auto DC injection] (AdC) page 146 is not [No] (nO)
This parameter is forced to 0 if [Motor control type] (Ctt) page 73 = [Sync. mot.] (SYn).

CAUTION

Check that the motor will withstand this current without overheating.
Failure to follow this instruction can result in equipment damage.

tdC1 ★	❑ [Auto DC inj. time 1]	0.1 to 30 s	0.5 s

Standstill injection time. This parameter can be accessed if [Auto DC injection] (AdC) page 146 is not [No] (nO)
If [Motor control type] (Ctt) page 73 = [FVC] (FUC) or [Sync. mot.] (SYn) this time corresponds to the zero speed maintenance time.

SdC2 ★	❑ [Auto DC inj. level 2]	0 to 1.2 In (1)	0.5 In (1)

2nd level of standstill DC injection current.
This parameter can be accessed if [Auto DC injection] (AdC) page 146 is not [No] (nO)
This parameter is forced to 0 if [Motor control type] (Ctt) page 73 = [Sync. mot.] (SYn).


CAUTION

Check that the motor will withstand this current without overheating.
Failure to follow this instruction can result in equipment damage.

tdC2 ★	❑ [Auto DC inj. time 2]	0 to 30 s	0 s

2nd standstill injection time.
This parameter can be accessed if [Auto DC injection] (AdC) page 146 = [Yes] (YES)

AdC	SdC2	Operation
YES	x	
Ct	≠ 0	
Ct	= 0	
Run command		
Speed		

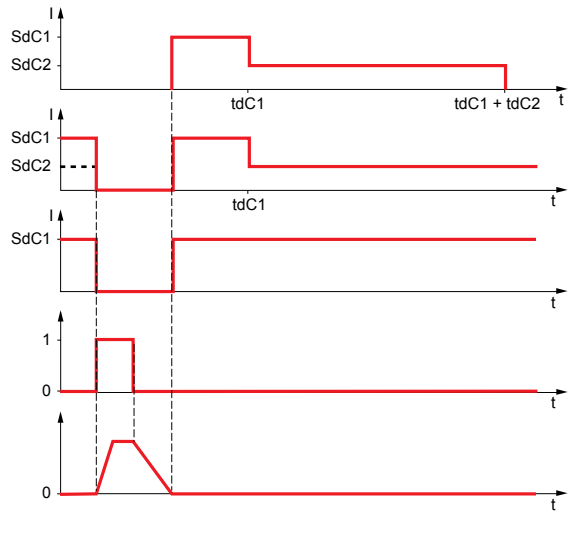

Note: When [Motor control type] (Ctt) page 73 = [FVC] (FUC):
[Auto DC inj. level 1] (SdC1), [Auto DC inj. level 2] (SdC2) and [Auto DC inj. time 2] (tdC2) are not accessible. Only [Auto DC inj. time 1] (tdC1) can be accessed. This then corresponds to a zero speed maintenance time.

(1) In corresponds to the rated drive current indicated in the Installation Manual or on the drive nameplate.

Code	Name/Description	Adjustment range	Factory setting
SFr	❑ [Switching freq.]	According to rating	According to rating

Switching frequency setting.
Adjustment range: This can vary between 1 and 16 kHz, but the minimum and maximum values, as well as the factory setting, can be limited in accordance with the type of drive (ATV71H or W), the rating (power and voltage) and the configuration of the [Sinus filter] (OFI) and [Motor surge limit] (SUL) parameters, page 85.

If [Sinus filter] (OFI)= [YES] (YES) and if the caliber is 690 V, the minimum [Switching freq.] (SFr) value is 2.5 kHz otherwise the minimum [Switching freq.] (SFr) value is 4.0 kHz.

If the value is less than 2 kHz, [Current Limitation] (CLI) and [I Limit. 2 value] (CL2) page 61 are limited to 1.36 In.

Adjustment with drive running:
- If the initial value is less than 2 kHz, it is not possible to increase it above 1.9 kHz while running.
- If the initial value is greater than or equal to 2 kHz, a minimum of 2 kHz must be maintained while running.

Adjustment with the drive stopped: No restrictions.

Note: In the event of excessive temperature rise, the drive will automatically reduce the switching frequency and reset it once the temperature returns to normal.

Note: If [Motor control type] (Ctt) page 73 = [FVC] (FUC), we do not recommend setting the switching frequency to a value less than 2 kHz (in order to avoid speed instability).
.

CAUTION

On ATV71●075N4 to U40N4, drives, if the RFI filters are disconnected (operation on an IT system), the drive's switching frequency must not exceed 4 kHz.
Failure to follow this instruction can result in equipment damage.

CLI	❑ [Current Limitation]	0 to 1.65 In (1)	1.5 In (1)

Used to limit the motor current.
The adjustment range is limited to 1.36 In if [Switching freq.] (SFr) page 61 is less than 2 kHz.

Note: If the setting is less than 0.25 In, the drive may lock in [Output Phase Loss] (OPF) fault mode if this has been enabled (see page 228). If it is less than the no-load motor current, the limitation no longer has any effect.

CAUTION

Check that the motor will withstand this current, particularly in the case of permanent magnet synchronous motors, which are susceptible to demagnetization.
Failure to follow this instruction can result in equipment damage.

CL2 ★	❑ [I Limit. 2 value]	0 to 1.65 In (1)	1.5 In (1)

See page 192
The adjustment range is limited to 1.36 In if [Switching freq.] (SFr) page 61 is less than 2 kHz.

Note: If the setting is less than 0.25 In, the drive may lock in [Output Phase Loss] (OPF) fault mode if this has been enabled (see page 228). If it is less than the no-load motor current, the limitation no longer has any effect.

CAUTION

Check that the motor will withstand this current, particularly in the case of permanent magnet synchronous motors, which are susceptible to demagnetization.
Failure to follow this instruction can result in equipment damage.

(1) In corresponds to the rated drive current indicated in the Installation Manual or on the drive nameplate.

Code	Name/Description	Adjustment range	Factory setting
FLU	❑ **[Motor fluxing]**		[No] (FnO)
FnC	☐ **[Not cont.]** (FnC): Non-continuous mode		
FCt	☐ **[Continuous]** (FCt): Continuous mode. This option is not possible if [Auto DC injection] (AdC) page 146 is [Yes] (YES) or if [Type of stop] (Stt) page 144 is [Freewheel] (nSt).		
Fno	☐ **[No]** (FnO): Function inactive This option is not possible if [Motor control type] (Ctt) page 73 = [SVCI] (CUC) or [FVC] (FUC).		
	If [Motor control type] (Ctt) page 73 = [SVCI] (CUC), [FVC] (FUC) or [Sync. mot.] (SYn) the factory setting is replaced by [Not cont.] (FnC).		
	In order to obtain rapid high torque on startup, magnetic flux needs to already have been established in the motor. • In [Continuous] (FCt) mode, the drive automatically builds up flux when it is powered up. • In [Not cont.] (FnC) mode, fluxing occurs when the motor starts up.		
	The flux current is greater than nCr (configured rated motor current) when the flux is established and is then adjusted to the motor magnetizing current...		
	CAUTION Check that the motor will withstand this current without overheating. **Failure to follow this instruction can result in equipment damage.**		
	If [Motor control type] (Ctt) page 73 = [Sync. mot.] (SYn), the [Motor fluxing] (FLU) parameter causes the alignment of the rotor and not the fluxing. If [Brake assignment] (bLC) page 164 is not [No] (nO), the [Motor fluxing] (FLU) parameter has no effect.		
tLS	❑ **[Low speed time out]**	0 to 999.9 s	0 s
	Maximum operating time at [Low speed] (LSP) (see page 44) Following operation at LSP for a defined period, a motor stop is requested automatically. The motor will restart if the reference is greater than LSP and if a run command is still present. Caution: A value of 0 indicates an unlimited period of time.		
	Note: If [Low speed time out] (tLS) is not 0, [Type of stop] (Stt) page 144 is forced to [Ramp stop] (rMP) (only if a ramp stop can be configured).		
JGF ★	❑ **[Jog frequency]**	0 to 10 Hz	10 Hz
	See page 148 Reference in jog operation		
JGt ★	❑ **[Jog delay]**	0 to 2.0 s	0.5 s
	See page 148 Anti-repeat delay between 2 consecutive jog operations.		

(1) In corresponds to the rated drive current indicated in the Installation Manual or on the drive nameplate.

★ These parameters only appear if the corresponding function has been selected in another menu. When the parameters can also be accessed and adjusted from within the configuration menu for the corresponding function, their description is detailed in these menus, on the pages indicated, to aid programming.

Code	Name/Description	Adjustment range	Factory setting
SP2 ★	❑ [Preset speed 2] See page 151 Preset speed 2	0 to 599 Hz	10 Hz
SP3 ★	❑ [Preset speed 3] See page 151 Preset speed 3	0 to 599 Hz	15 Hz
SP4 ★	❑ [Preset speed 4] See page 151 Preset speed 4	0 to 599 Hz	20 Hz
SP5 ★	❑ [Preset speed 5] See page 151 Preset speed 5	0 to 599 Hz	25 Hz
SP6 ★	❑ [Preset speed 6] See page 151 Preset speed 6	0 to 599 Hz	30 Hz
SP7 ★	❑ [Preset speed 7] See page 151 Preset speed 7	0 to 599 Hz	35 Hz
SP8 ★	❑ [Preset speed 8] See page 151 Preset speed 8	0 to 599 Hz	40 Hz
SP9 ★	❑ [Preset speed 9] See page 151 Preset speed 9	0 to 599 Hz	45 Hz
SP10 ★	❑ [Preset speed 10] See page 151 Preset speed 10	0 to 599 Hz	50 Hz
SP11 ★	❑ [Preset speed 11] See page 151 Preset speed 11	0 to 599 Hz	55 Hz
SP12 ★	❑ [Preset speed 12] See page 151 Preset speed 12	0 to 599 Hz	60 Hz
SP13 ★	❑ [Preset speed 13] See page 151 Preset speed 13	0 to 599 Hz	70 Hz
SP14 ★	❑ [Preset speed 14] See page 151 Preset speed 14	0 to 599 Hz	80 Hz

★ These parameters only appear if the corresponding function has been selected in another menu. When the parameters can also be accessed and adjusted from within the configuration menu for the corresponding function, their description is detailed in these menus, on the pages indicated, to aid programming.

Code	Name/Description	Adjustment range	Factory setting
SP 15 ★	❑ [Preset speed 15] See page 151 Preset speed 15	0 to 599 Hz	90 Hz
SP 16 ★	❑ [Preset speed 16] See page 151 Preset speed 16	0 to 599 Hz	100 Hz
MFr	❑ [Multiplying coeff.] Multiplying coefficient, can be accessed if [Multiplier ref.-] (MA2,MA3) page 139 has been assigned to the graphic terminal	0 to 100%	100%
SrP ★	❑ [+/-Speed limitation] See page 155 Limitation of +/- speed variation	0 to 50%	10%
rPG ★	❑ [PID prop. gain] See page 181 Proportional gain	0.01 to 100	1
r iG ★	❑ [PID integral gain] See page 182 Integral gain	0.01 to 100	1
rdG ★	❑ [PID derivative gain] See page 182 Derivative gain	0.00 to 100	0
PrP ★	❑ [PID ramp] See page 182 PID acceleration/deceleration ramp, defined to go from [Min PID reference] (PIP1) to [Max PID reference] (PIP2) and vice versa.	0 to 99.9 s	0
PoL ★	❑ [Min PID output] See page 182 Minimum value of regulator output in Hz	- 500 to 500 or -599 to 599 according to rating	0 Hz
PoH ★	❑ [Max PID output] See page 182 Maximum value of regulator output in Hz	0 to 500 or 599 according to rating	60 Hz
PAL ★	❑ [Min fbk alarm] See page 182 Minimum monitoring threshold for regulator feedback	See page 182 (1)	100
PAH ★	❑ [Max fbk alarm] See page 182 Maximum monitoring threshold for regulator feedback	See page 182 (1)	1000

(1) If a graphic display terminal is not in use, values greater than 9999 will be displayed on the 4-digit display with a period mark after the thousand digit, e.g., 15.65 for 15650.

★ These parameters only appear if the corresponding function has been selected in another menu. When the parameters can also be accessed and adjusted from within the configuration menu for the corresponding function, their description is detailed in these menus, on the pages indicated, to aid programming.

Code	Name/Description	Adjustment range	Factory setting
PEr ★	❑ [PID error Alarm] See page 182 Regulator error monitoring threshold	0 to 65535 (1)	100
PSr ★	❑ [Speed input %] See page 183 Multiplying coefficient for predictive speed input.	1 to 100%	100%
rP2 ★	❑ [Preset ref. PID 2] See page 185 Preset PID reference	See page 185 (1)	300
rP3 ★	❑ [Preset ref. PID 3] See page 185 Preset PID reference	See page 185 (1)	600
rP4 ★	❑ [Preset ref. PID 4] See page 185 Preset PID reference	See page 185 (1)	900
Ibr ★	❑ [Brake release I FW] See page 165 Brake release current threshold for lifting or forward movement	0 to 1.32 In (2)	0
Ird ★	❑ [Brake release I Rev] See page 165 Brake release current threshold for lowering or reverse movement	0 to 1.32 In (2)	0
brt ★	❑ [Brake Release time] See page 165 Brake release time delay	0 to 5.00 s	0 s
bIr ★	❑ [Brake release freq] See page 165 Brake release frequency threshold	[Auto] (AUtO) 0 to 10 Hz	[Auto] (AUtO)
bEn ★	❑ [Brake engage freq] See page 165 Brake engage frequency threshold	[Auto] (AUtO) 0 to 10 Hz	[Auto] (AUtO)
tbE ★	❑ [Brake engage delay] See page 165 Time delay before request to engage brake. To delay the engaging of the brake, for horizontal movement only, if you wish the brake to engage when the drive comes to a complete stop.	0 to 5.00 s	0 s

(1) If a graphic display terminal is not in use, values greater than 9999 will be displayed on the 4-digit display with a period mark after the thousand digit, e.g., 15.65 for 15650.
(2) In corresponds to the rated drive current indicated in the Installation Manual or on the drive nameplate.

★ These parameters only appear if the corresponding function has been selected in another menu. When the parameters can also be accessed and adjusted from within the configuration menu for the corresponding function, their description is detailed in these menus, on the pages indicated, to aid programming.

Code	Name/Description	Adjustment range	Factory setting
bEt ★	❑ [Brake engage time] See page 165 Brake engage time (brake response time)	0 to 5.00 s	0 s
JdC ★	❑ [Jump at reversal] See page 166	[Auto] (AUtO) 0 to 10 Hz	[Auto] (AUtO)
tbr ★	❑ [Time to restart] See page 166 Time between the end of a brake engage sequence and the start of a brake release sequence	0.00 to 15.00 s	0.00 s
bFtd ★	❑ [BRH_b4_freq] Parameter can only be modified in [ACCESS LEVEL] = [Expert] mode. If [BRH_b4] (brH4), [BRH_b4_freq] (bFtd) represent the threshold level for [BRH_b4] (brH4). [BRH_b4_freq] (bFtd) value depends from the installation mechanical response. If [BRH_b4_freq] (bFtd) is too low the drive may rise [Load mvt al] (bSA) when not needed. If [BRH_b4_freq] (bFtd) is too high a slip of the load may occur without [Load mvt al] (bSA) alarm. **⚠ WARNING** **LOSS OF CONTROL** If the setting is too low, the [BRH_b4] (brH4) function might be activated untimely. If the setting is too high, the [BRH_b4] (brH4) function might notbe activated when required. - Check and control that the setting is convenient for the application **Failure to follow these instructions can result in death, serious injury or equipment damage.**	0.1 to 10 Hz	0.2 Hz
tLIM ★	❑ [Motoring torque lim] See page 190 Torque limitation in generator mode, as a % or in 0.1% increments of the rated torque in accordance with the [Torque increment] (IntP) parameter, page 190.	0 to 300%	100%
tLIG ★	❑ [Gen. torque lim] See page 190 Torque limitation in generator mode, as a % or in 0.1% increments of the rated torque in accordance with the [Torque increment] (IntP) parameter, page 190.	0 to 300%	100%
trH ★	❑ [Traverse freq. high] See page 214	0 to 10 Hz	4 Hz
trL ★	❑ [Traverse freq. low] See page 214	0 to 10 Hz	4 Hz

(1) In corresponds to the rated drive current indicated in the Installation Manual or on the drive nameplate.

★ These parameters only appear if the corresponding function has been selected in another menu. When the parameters can also be accessed and adjusted from within the configuration menu for the corresponding function, their description is detailed in these menus, on the pages indicated, to aid programming.

Code	Name/Description	Adjustment range	Factory setting
9 5 H ★	❑ [Quick step High] See page 214	0 to [Traverse freq. high] (trH)	0 Hz
9 5 L ★	❑ [Quick step Low] See page 214	0 to [Traverse freq. low] (trL)	0 Hz
C t d	❑ [Current threshold] Current threshold for [I attained] (CtA) function assigned to a relay or a logic output (see page 106).	0 to 1.5 In (1)	In (1)
t t H	❑ [High torque thd.] High current threshold for [High tq. att.] (ttHA) function assigned to a relay or a logic output (see page 106), as a % of the rated motor torque.	-300% to +300%	100%
t t L	❑ [Low torque thd.] Low current threshold for [Low tq. att.] (ttLA) function assigned to a relay or a logic output (see page 106), as a % of the rated motor torque.	-300% to +300%	50%

(1) In corresponds to the rated drive current indicated in the Installation Manual or on the drive nameplate.


★ These parameters only appear if the corresponding function has been selected in another menu. When the parameters can also be accessed and adjusted from within the configuration menu for the corresponding function, their description is detailed in these menus, on the pages indicated, to aid programming.

Code	Name/Description	Adjustment range	Factory setting
FqL ★	❑ **[Pulse warning thd.]** Speed threshold measured by the FREQUENCY METER] FqF-) function, page 239, assigned to a relay or a logic output (see page 106).	0 Hz to 30.00 kHz	0 Hz
Ftd	❑ **[Freq. threshold]** Frequency threshold for [Freq.Th.att.] (FtA) function assigned to a relay or a logic output (see page 106), or used by the [PARAM. SET SWITCHING] (MLP-) function, page 203.	0.0 to 599 Hz	[High speed] (HSP)
F2d	❑ **[Freq. threshold 2]** Frequency threshold for [Freq. Th. 2 attain.] (F2A) function assigned to a relay or a logic output (see page 106), or used by the [PARAM. SET SWITCHING] (MLP-) function, page 203.	0.0 to 599 Hz	[High speed] (HSP)
FFt ★	❑ **[Freewheel stop Thd]** See page 144 This parameter supports switching from a ramp stop or a fast stop to a freewheel stop below a low speed threshold. It can be accessed if [Type of stop] (Stt) = [Fast stop] (FSt) or [Ramp stop] (rMP). ☐ 0.0: Does not switch to freewheel stop. ☐ 0,1 to 599 Hz: Speed threshold below which the motor will switch to freewheel stop.	0.0 to 599 Hz	0.0 Hz
ttd ★	❑ **[Motor therm. level]** See page 228 Trip threshold for motor thermal alarm (logic output or relay)	0 to 118%	100%
JPF	❑ **[Skip Frequency]** Skip frequency. This parameter prevents prolonged operation within an adjustable range around the regulated frequency. This function can be used to prevent a critical speed, which would cause resonance, being reached. Setting the function to 0 renders it inactive.	0 to 500 or 599 Hz according to rating	0 Hz
JF2	❑ **[Skip Frequency 2]** 2nd skip frequency. This parameter prevents prolonged operation within an adjustable range around the regulated frequency. This function can be used to prevent a critical speed, which would cause resonance, being reached. Setting the function to 0 renders it inactive.	0 to 500 or 599 Hz according to rating	0 Hz
JF3	❑ **[3rd Skip Frequency]** 3rd skip frequency. This parameter prevents prolonged operation within an adjustable range around the regulated frequency. This function can be used to prevent a critical speed, which would cause resonance, being reached. Setting the function to 0 renders it inactive.	0 to 500 or 599 Hz according to rating	0 Hz
JFH	❑ **[Skip.Freq.Hysteresis]** Parameter visible if at least one skip frequency [Skip Frequency] (JPF), [Skip Frequency 2] (JF2) or [3rd Skip Frequency] (JF3) is different from 0. Skip frequency range: between (JPF – JFH) and (JPF + JFH), for example. This adjustment is common to all 3 frequencies (JPF, JF2 and JF3).	0.1 to 10 Hz	1 Hz
LbC ★	❑ **[Load correction]** Rated correction in Hz. See page 88	0 to 599 Hz	0
trt	❑ **[Torque ratio]** Coefficient applied to [Torque reference] (tr1).	0 to 1000%	100%


★ These parameters only appear if the corresponding function has been selected in another menu. When the parameters can also be accessed and adjusted from within the configuration menu for the corresponding function, their description is detailed in these menus, on the pages indicated, to aid programming.

[1.4 MOTOR CONTROL] (drC-)

With graphic display terminal:

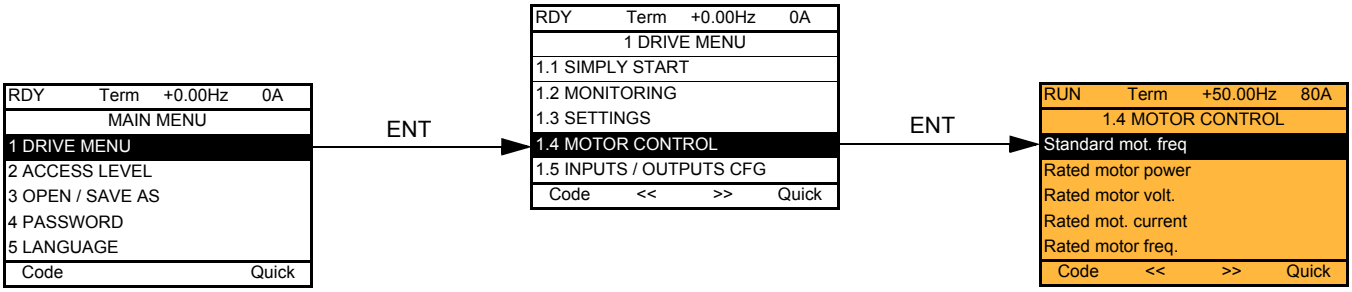

With integrated display terminal:

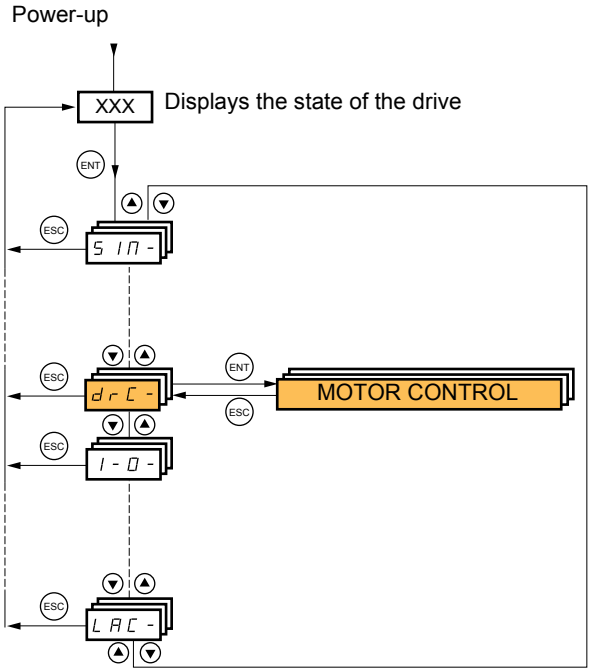

[1.4 MOTOR CONTROL] (drC-)

The parameters in the [1.4 MOTOR CONTROL] (drC-) menu can only be modified when the drive is stopped and no run command is present, with the following exceptions:

- [Auto tuning] (tUn) page 71, which may cause the motor to start up.
- Parameters containing the sign ( ) in the code column, which can be modified with the drive running or stopped.

Code	Name/Description	Adjustment range	Factory setting
bFr 50 60	**[Standard mot. freq]** ☐ **[50Hz IEC]** (50): IEC ☐ **[60Hz NEMA]** (60) : NEMA This parameter modifies the presets of the following parameters: [High speed] (HSP) page 44, [Freq. threshold] (Ftd) page 68, [Rated motor volt.] (UnS), [Rated motor freq.] (FrS) and [Max frequency] (tFr).		[50Hz IEC] (50)
nPr	**[Rated motor power]** The parameter cannot be accessed if [Motor control type] (Ctt) page 73 = [Sync. mot.] (SYn). Rated motor power given on the nameplate, in kW if [Standard mot. freq] (bFr) = [50Hz IEC] (50), in HP if [Standard mot. freq] (bFr) = [60Hz NEMA] (60).	According to drive rating	According to drive rating
UnS	**[Rated motor volt.]** The parameter cannot be accessed if [Motor control type] (Ctt) page 73 = [Sync. mot.] (SYn). Rated motor voltage given on the nameplate. ATV71●●●M3: 100 to 240 V - ATV71●●●N4: 200 to 480 V- ATV71●●●S6X: 400 to 600 - ATV71●●●Y: 400 to 690 V.	According to drive rating	According to drive rating and [Standard mot. freq] (bFr)
nCr	**[Rated mot. current]** The parameter cannot be accessed if [Motor control type] (Ctt) page 73 = [Sync. mot.] (SYn). Rated motor current given on the nameplate.	0.25 to 1.5 In (1)	According to drive rating and [Standard mot. freq] (bFr)
FrS	**[Rated motor freq.]** The parameter cannot be accessed if [Motor control type] (Ctt) page 73 = [Sync. mot.] (SYn). Rated motor frequency given on the nameplate. The factory setting is 50 Hz, or preset to 60 Hz if [Standard mot. freq] (bFr) is set to 60 Hz. The maximum value is limited to 500 Hz if [Motor control type] (Ctt) (page 73) is not V/F, or for ATV71●●●Y drives, or for drives rated higher than ATV71HD37. Values between 500 Hz and 599 Hz are only possible in V/F control and for powers limited to 37 kW (50 HP). In this case configure [Motor control type] (Ctt) before [Rated motor freq.] (FrS).	10 to 599 Hz	50 Hz
InSP 1 10	**[rpm increment]** Increment of parameter [Rated motor speed] (nSP). ☐ **[x1 rpm]** (1): Increment of 1 rpm, to be used if [Rated motor speed] (nSP) does not exceed 65535 rpm. ☐ **[x10 rpm]** (10) : Increment of 10 rpm, to be used if [Rated motor speed] (nSP) exceeds 65535 rpm. ☞ **Note 1:** Changing [rpm increment] (InSP) will restore [Rated motor speed] (nSP) to its factory setting. **Note 2:** For ATV71●●●Y range, [rpm increment] (InSP) is fixed to 1.		[x1 rpm] (1)
nSP	**[Rated motor speed]** The parameter cannot be accessed if [Motor control type] (Ctt) page 73 = [Sync. mot.] (SYn). Rated motor speed given on the nameplate. Adjustable between 0 and 65535 rpm if [rpm increment] (InSP) = [x1 rpm] (1) or between 0.00 and 96.00 krpm if [rpm increment] (InSP) = [x10 rpm] (10). 0 to 9999 rpm then 10.00 to 65.53 or 96.00 krpm on the integrated display terminal. If, rather than the rated speed, the nameplate indicates the synchronous speed and the slip in Hz or as a %, calculate the rated speed as follows: • Nominal speed = Synchronous speed x $\frac{100 - \text{slip as a \%}}{100}$ or • Nominal speed = Synchronous speed x $\frac{50 - \text{slip in Hz}}{50}$ (50 Hz motors) or • Nominal speed = Synchronous speed x $\frac{60 - \text{slip in Hz}}{60}$ (60 Hz motors)	0 to 96000 rpm	According to drive rating

(1) In corresponds to the rated drive current indicated in the Installation Manual and on the drive nameplate.

Code	Name/Description	Factory setting
tFr	❑ **[Max frequency]** The factory setting is 60 Hz, or preset to 72 Hz if [Standard mot. freq] (bFr) is set to 60 Hz. The maximum value is limited by the following conditions: • It must not exceed 10 times the value of [Rated motor freq.] (FrS) • It must not exceed 500 Hz if [Motor control type] (Ctt) (page 73) is not V/F or for ATV71●●●Y drives, or for drives rated higher than ATV71HD37. Values between 500 Hz and 599 Hz are only possible in V/F control and for powers limited to 37 kW (50 HP). In this case configure [Motor control type] (Ctt) before [Max frequency] (tFr).	10 to 599 Hz
tUn	❑ **[Auto tuning]** **⚠⚠ DANGER** **HAZARD OF ELECTRIC SHOCK OR ARC FLASH** • During auto-tuning, the motor operates at rated current. • Do not service the motor during auto-tuning. **Failure to follow these instructions will result in death or serious injury.** **⚠ WARNING** **LOSS OF CONTROL** • It is essential that the following parameters [Rated motor volt.] (UnS), [Rated motor freq.] (FrS), [Rated mot. current] (nCr), [Rated motor speed] (nSP) and [Rated motor power] (nPr) are correctly configured before starting auto-tuning for asynchronous motor. • It is essential that the following parameters [Nominal I sync] (nCrS), [Nom motor spdsync] (nSPS), [Pole pairs.] (PPnS), [Syn. EMF constant] (PHS), [Autotune L d-axis] (LdS) and [Autotune L q-axis] (LqS) are correctly configured before starting auto-tuning for synchronous motor. • When one or more of these parameters have been changed after auto-tuning has been performed, [Auto tuning] (tUn) will return [No] (nO) and the procedure will have to be repeated. **Failure to follow these instructions can result in death, serious injury or equipment damage.** nO ☐ **[No]** (nO): Auto-tuning not performed. YES ☐ **[Yes]** (YES): Auto-tuning is performed as soon as possible, then the parameter automatically changes to [Done] (dOnE). dOnE ☐ **[Done]** (dOnE): Use of the values given the last time auto-tuning was performed. **Note:** • Auto-tuning is only performed if no stop command has been activated. If a "freewheel stop" or "fast stop" function has been assigned to a logic input, this input must be set to 1 (active at 0). • Auto-tuning takes priority over any run or prefluxing commands, which will be taken into account after the auto-tuning sequence. • If auto-tuning fails, the drive displays [No] (nO) and, depending on the configuration of [Autotune fault mgt] (tnL) page 242, may switch to [Auto-tuning] (tnF) fault mode. • Auto-tuning may last for 1 to 2 seconds. Do not interrupt the process. Wait for the display to change to "[Done] (dOnE)" or "[No] (nO)".	[No] (nO)
AUt	❑ **[Automatic autotune]** nO ☐ **[No]** (nO): Function inactive YES ☐ **[Yes]** (YES): Auto-tuning is performed on every power-up. **Caution:** Same comments as for [Auto tuning] (tUn) above. If [Profile] (CHCF) = [8 serie] (SE8), then [Automatic autotune] (AUt) is fixed to [No] (nO).	[No] (nO)

[1.4 MOTOR CONTROL] (drC-)

Code	Name/Description	Factory setting
tUS	❑ **[Auto tuning state]**	[Not done] (tAb)
	For information only, cannot be modified.	
tAb	☐ **[Not done]** (tAb): The default stator resistance value is used to control the motor.	
PEnd	☐ **[Pending]** (PEnd): Auto-tuning has been requested but not yet performed.	
PrOG	☐ **[In Progress]** (PrOG): Auto-tuning in progress	
FAIL	☐ **[Failed]** (FAIL): Auto-tuning has failed.	
donE	☐ **[Done]** (dOnE): The stator resistance measured by the auto-tuning function is used to control the motor.	
CUS	☐ **[Customized]** (CUS): Auto-tuning has been performed, but at least one parameter set by this auto-tuning operation has subsequently been modified. The [Auto tuning] (tUn) parameter then returns to [No] (nO). The following auto-tuning parameters are affected: [Cust. stator R syn] (rSAS) page 76, [Cust stator resist.] (rSA), [Idw] (IdA), [LFw] (LFA) and [T2w] (trA) page 77.	
PHr	❑ **[Output Ph rotation]**	[ABC] (AbC)
AbC	☐ **[ABC]** (AbC): Forward	
ACb	☐ **[ACB]** (ACb): Reverse	
	This parameter can be used to reverse the direction of rotation of the motor without reversing the wiring.	
	☞ **Do not modify the [Output Ph rotation] (PHr) parameter when [Motor control type] (Ctt) page 73 = [FVC] (FUC)**. The direction of rotation must be modified, if required, before or during the procedure to check the encoder page 80 when [Motor control type] (Ctt) is not [FVC] (FUC).	

Code	Name/Description	Adjustment range	Factory setting
Ctt	❑ **[Motor control type]**		[SVC V] (UUC)


☐ **[SVC V]** (UUC): Open-loop voltage flux vector control with automatic slip compensation according to the load. This type of control is recommended when replacing an ATV58. It supports operation with a number of motors connected in parallel on the same drive (if the motors are identical).

☐ **[SVC I]** (CUC): Open-loop current flux vector control. This type of control is recommended when replacing an ATV58F used in an open-loop configuration. It does not support operation with a number of motors connected in parallel on the same drive.

☐ **[FVC]** (FUC) : Closed-loop current flux vector control for motors with incremental encoder type sensor; this option can only be selected if an incremental encoder card has been inserted. This function is not possible, however, when using an encoder that generates signal "A" only.
This type of control is recommended when replacing an ATV58F used in a closed-loop configuration. It provides better performance in terms of speed and torque accuracy and enables torque to be obtained at zero speed. It does not support operation with a number of motors connected in parallel on the same drive.


It is essential that the encoder check page 80 is performed successfully before selecting [FVC] (FUC).

☐ **[V/F 2pts]** (UF2): Simple V/F profile without slip compensation. It supports operation with:
- Special motors (wound rotor, tapered rotor, etc.)
- A number of motors in parallel on the same drive
- High-speed motors
- Motors with a low power rating in comparison to that of the drive

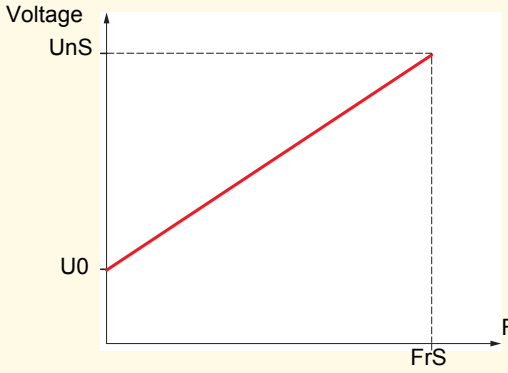

The profile is defined by the values of parameters UnS, FrS and U0.

☐ **[V/F 5pts]** (UF5): 5-segment V/F profile: As V/F 2 pts profile but also supports the avoidance of resonance (saturation).

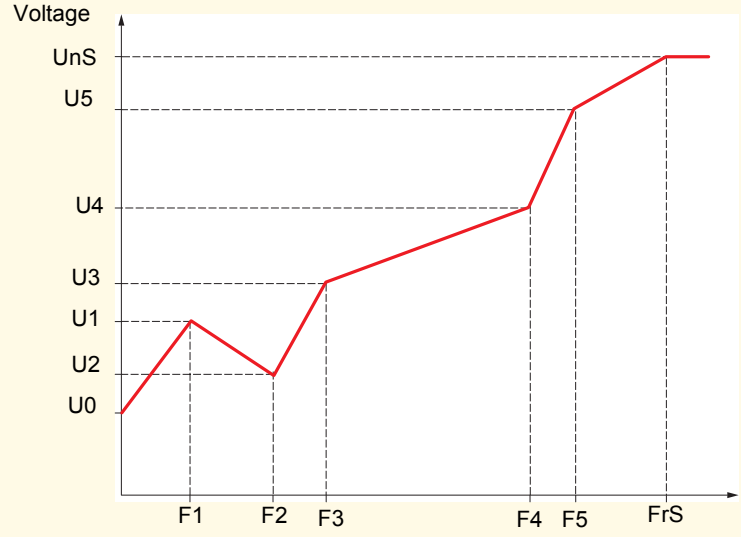


The profile is defined by the values of parameters UnS, FrS, U0 to U5 and F1 to F5.

FrS > F5 > F4 > F3 > F2 > F1

☐ **[Sync. mot.]** (SYn): For synchronous permanent magnet motors with sinusoidal electromotive force (EMF) only. This selection is prohibited with ATV71●●●●Y (500 to 690 V).
This selection makes the asynchronous motor parameters inaccessible, and the synchronous motor parameters accessible.

[1.4 MOTOR CONTROL] (drC-)

Code	Name/Description	Adjustment range	Factory setting
u0	❑ [U0] V/F profile setting. The parameter can be accessed if [Motor control type] (Ctt) = [V/F 2pts] (UF2) or [V/F 5pts] (UF5)	0 to 800 or 1000 V according to rating	0
u1	❑ [U1] V/F profile setting. The parameter can be accessed if [Motor control type] (Ctt) = [V/F 5pts] (UF5)	0 to 800 or 1000 V according to rating	0
F1	❑ [F1] V/F profile setting. The parameter can be accessed if [Motor control type] (Ctt) = [V/F 5pts] (UF5)	0 to 599 Hz	0
u2	❑ [U2] V/F profile setting. The parameter can be accessed if [Motor control type] (Ctt) = [V/F 5pts] (UF5)	0 to 800 or 1000 V according to rating	0
F2	❑ [F2] V/F profile setting. The parameter can be accessed if [Motor control type] (Ctt) = [V/F 5pts] (UF5)	0 to 599 Hz	0
u3	❑ [U3] V/F profile setting. The parameter can be accessed if [Motor control type] (Ctt) = [V/F 5pts] (UF5)	0 to 800 or 1000 V according to rating	0
F3	❑ [F3] V/F profile setting. The parameter can be accessed if [Motor control type] (Ctt) = [V/F 5pts] (UF5)	0 to 599 Hz	0
u4	❑ [U4] V/F profile setting. The parameter can be accessed if [Motor control type] (Ctt) = [V/F 5pts] (UF5)	0 to 800 or 1000 V according to rating	0
F4	❑ [F4] V/F profile setting. The parameter can be accessed if [Motor control type] (Ctt) = [V/F 5pts] (UF5)	0 to 599 Hz	0
u5	❑ [U5] V/F profile setting. The parameter can be accessed if [Motor control type] (Ctt) = [V/F 5pts] (UF5)	0 to 800 or 1000 V according to rating	0
F5	❑ [F5] V/F profile setting. The parameter can be accessed if [Motor control type] (Ctt) = [V/F 5pts] (UF5)	0 to 599 Hz	0

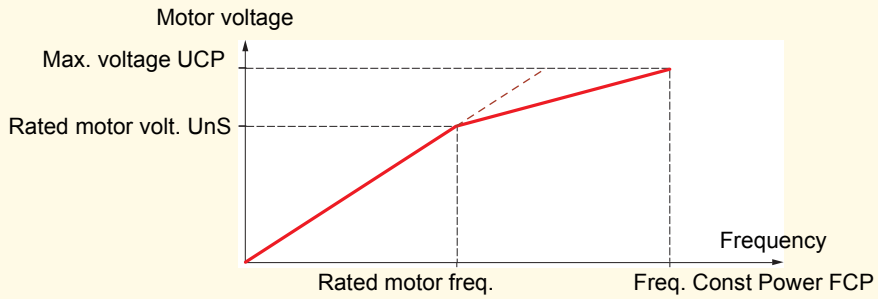Code	Name/Description	Adjustment range	Factory setting
uC2 nO YES	❏ **[Vector Control 2pt]** The parameter can be accessed if [Motor control type] (Ctt) is not [Sync. mot.] (SYn). ☐ **[No]** (nO): Function inactive ☐ **[Yes]** (YES): Function active. Used in applications in which the motor rated speed and frequency need to be exceeded in order to optimize operation at constant power, or when the maximum voltage of the motor needs to be limited to a value below the line voltage. The voltage/frequency profile must then be adapted in accordance with the motor's capabilities to operate at maximum voltage UCP and maximum frequency FCP.  		[No] (nO)
uCP	❏ **[V. constant power]** The parameter can be accessed if [Vector Control 2pt] (UC2) = [Yes] (YES)	According to drive rating	According to drive rating and [Standard mot. freq] (bFr)
FCP	❏ **[Freq. Const Power]** The parameter can be accessed if [Vector Control 2pt] (UC2) = [Yes] (YES)	According to drive rating and [Rated motor freq.] (FrS)	= [Standard mot. freq] (bFr)

Synchronous motor parameters:

These parameters can be accessed if [Motor control type] (Ctt) page 73 = [Sync. mot.] (SYn). In this case, the asynchronous motor parameters cannot be accessed.

Code	Name/Description	Adjustment range	Factory setting
nCrS	❑ [Nominal I sync.] Rated synchronous motor current given on the nameplate.	0.25 to 1.5 In (2)	According to drive rating
nSPS	❑ [Nom motor spdsync] Rated motor speed given on the nameplate. On the integrated display unit: 0 to 9999 rpm then 10.00 to 60.00 krpm.	0 to 60000 rpm	According to drive rating
PPnS	❑ [Pole pairs] Number of pairs of poles on the synchronous motor.	1 to 50	According to drive rating
PHS	❑ [Syn. EMF constant] Synchronous motor EMF constant, in mV per rpm (peak voltage per phase). On the integrated display unit: 0 to 9999 then 10.00 to 65.53 (10000 to 65536).	0 to 65535	According to drive rating
LdS	❑ [Autotune L d-axis] Axis "d" stator inductance in mH (per phase). On motors with smooth poles [Autotune L d-axis] (LdS) = [Autotune L q-axis] (LqS) = Stator inductance L.	0 to 655.3	According to drive rating
LqS	❑ [Autotune L q-axis] Axis "q" stator inductance in mH (per phase). On motors with smooth poles [Autotune L d-axis] (LdS) = [Autotune L q-axis] (LqS) = Stator inductance L.	0 to 655.3	According to drive rating
rSAS	❑ [Cust. stator R syn] Cold state stator resistance (per winding) The factory setting is replaced by the result of the auto-tuning operation, if it has been performed. The value can be entered by the user, if he knows it. Value in milliohms (mΩ) up to 75 kW (100 HP), in hundredths of milliohms (mΩ/100) above 75 kW (100 HP). On the integrated display unit: 0 to 9999 then 10.00 to 65.53 (10000 to 65536).	According to drive rating	According to drive rating

Code	Name/Description	Adjustment range	Factory setting
UFr	❑ [IR compensation] (1) The parameter can be accessed if [Motor control type] (Ctt) is not [V/F 2pts] (UF2) and [V/F 5pts] (UF5). Used to optimize the torque at very low speed (increase [IR compensation] (UFr) if the torque is insufficient). Check that the [IR compensation] (UFr) value is not too high when the motor is warm (risk of instability).	25 to 200%	100%
SLP	❑ [Slip compensation] (1) The parameter can be accessed if [Motor control type] (Ctt) is not [V/F 2pts] (UF2), [V/F 5pts] (UF5) and [Sync. mot.] (SYn). Adjusts the slip compensation around the value set by the rated motor speed. The speeds given on motor nameplates are not necessarily exact. • If slip setting < actual slip: The motor is not rotating at the correct speed in steady state, but at a speed lower than the reference. • If slip setting > actual slip: The motor is overcompensated and the speed is unstable.	0 to 300%	100%

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-) menu.
(2) In corresponds to the rated drive current indicated in the Installation Manual and on the drive nameplate.

Parameter that can be modified during operation or when stopped.

Motor parameters that can be accessed in [Expert] mode.

These include:

- Parameters calculated by the drive during auto-tuning, in read-only mode. For example, R1r, calculated cold stator resistance.
- The possibility of replacing some of these calculated parameters by other values, if necessary. For example, R1w, measured cold stator resistance.

When a parameter Xyw is modified by the user, the drive uses it in place of the calculated parameter Xyr.

Asynchronous motor

If an auto-tuning operation is performed or if one of the motor parameters on which auto-tuning depends is modified ([Rated motor volt.] (UnS), [Rated motor freq.] (FrS), [Rated mot. current] (nCr), [Rated motor speed] (nSP), [Rated motor power] (nPr)), parameters Xyw return to their factory settings.

Code	Name/Description
rSM	❑ **[Stator R measured]** Cold stator resistance, calculated by the drive, in read-only mode. Value in milliohms (mΩ) up to 75 kW (100 HP), in hundredths of milliohms (mΩ/100) above 75 kW (100 HP).
idM	❑ **[Idr]** Magnetizing current in A, calculated by the drive, in read-only mode.
LFM	❑ **[Lfr]** Leakage inductance in mH, calculated by the drive, in read-only mode.
trM	❑ **[T2r]** Rotor time constant in mS, calculated by the drive, in read-only mode.
nSL	❑ **[Nominal motor slip]** Rated slip in Hz, calculated by the drive, in read-only mode. To modify the rated slip, modify the [Rated motor speed] (nSP) (page 70).
PPn	❑ **[Poles pair number]** Number of pairs of poles, calculated by the drive, in read-only mode.
rSA	❑ **[Cust stator resist.]** Cold state stator resistance (per winding), modifiable value. In milliohms (mΩ) up to 75 kW (100 HP), in hundredths of milliohms (mΩ/100) above 75 kW (100 HP). On the integrated display unit: 0 to 9999 then 10.00 to 65.53 (10000 to 65536).
idA	❑ **[Idw]** Magnetizing current in A, modifiable value.
LFA	❑ **[Lfw]** Leakage inductance in mH, modifiable value.
trA	❑ **[T2w]** Rotor time constant in mS, modifiable value.

Synchronous motor

Code	Name/Description
r S M S	❑ **[R1rS]** Cold state stator resistance (per winding), in read-only mode. This is the drive factory setting or the result of the auto-tuning operation, if it has been performed. Value in milliohms (mΩ) up to 75 kW (100 HP), in hundredths of milliohms (mΩ/100) above 75 kW (100 HP). On the integrated display unit: 0 to 9999 then 10.00 to 65.53 (10000 to 65536).
F r S S	❑ **[Nominal freq sync.]** Motor frequency at rated speed in Hz, calculated by the drive (rated motor frequency), in read-only mode.

Selecting the encoder

Follow the recommendations in the catalog and the Installation Manual.

Code	Name/Description	Adjustment range	Factory setting
EnS	❏ **[Encoder type]** The parameter can be accessed if an incremental encoder card has been inserted (1). To be configured in accordance with the type of card and encoder used. AAbb ☐ **[AABB]** (AAbb): For signals A, A-, B, B-. Ab ☐ **[AB]** (Ab): For signals A, B. A ☐ **[A]** (A): For signal A. Value cannot be accessed if [Encoder usage] (EnU) page 81 = [Spd fdk reg.] (rEG).		[AABB] (AAbb)
PGI	❏ **[Number of pulses]** Number of pulses per encoder revolution. The parameter can be accessed if an incremental encoder card has been inserted (1).	100 to 5000	1024

(1) The encoder parameters can only be accessed if the encoder card has been inserted, and the available selections will depend on the type of encoder card used. The encoder configuration can also be accessed in the [1.5- INPUTS / OUTPUTS CFG] (I/O) menu.

Encoder check procedure

This procedure applies to all types of encoder.

1. Set [Motor control type] (Ctt) to a value other than [FVC] (FUC) even if it is the required configuration. For example, use [SVC V] (UUC) for an asynchronous motor and [Sync. mot.] (SYn) for a synchronous motor.

2. Configure the motor parameters in accordance with the specifications on the rating plate.
   - Asynchronous motor (see page 70): [Rated motor power] (nPr), [Rated motor volt.] (UnS), [Rated mot. current] (nCr), [Rated motor freq.] (FrS), [Rated motor speed] (nSP).
   - Synchronous motor (see "Synchronous motor parameters" on page 76): [Nominal I sync.] (nCrS), [Nom motor spdsync] (nSPS), [Pole pairs] (PPnS), [Syn. EMF constant] (PHS), [Autotune L d-axis] (LdS), [Autotune L q-axis] (LqS), [Cust. stator R syn] (rSAS). [Current limitation] (CLI) must not exceed the maximum motor current, **otherwise demagnetization may occur**.

3. Set [Encoder usage] (EnU) = [No] (nO).

4. Perform auto-tuning.

5. In the case of an incremental encoder, set [Encoder type] (EnS) and [Number of pulses] (PGI) page 79 according to the encoder used.

6. Set [Encoder check] (EnC) = [Yes] (YES)

7. Check that the rotation of the motor is safe.

8. Set the motor rotating at stabilized speed ≈ 15% of the rated speed for at least 3 seconds, and use the [1.2-MONITORING] (SUP-) menu to monitor its behavior.

9. If it trips on an [Encoder fault] (EnF), [Encoder check] (EnC) returns to [No] (nO).
   - Check the parameter settings (see points 1 to 4 above).
   - Check that the mechanical and electrical operation of the encoder, its power supply and connections are all OK.
   - Reverse the direction of rotation of the motor ([Output Ph rotation] (PHr) parameter page 67) or the encoder signals.

10. Repeat the operations from step 5 onwards until [Encoder check] (EnC) changes to [Done] (dOnE).

11. If necessary, change [Motor control type] (Ctt) to [FVC] (FUC).

Code	Name/Description	Adjustment range	Factory setting
EnC	❑ **[Encoder check]** Encoder feedback check. See procedure on previous page. The parameter can be accessed if an encoder card has been inserted (1). ☐ **[Not done]** (nO) Check not performed. ☐ **[Yes]** (YES): Activates monitoring of the encoder. ☐ **[Done]** (dOnE): Check performed successfully. The check procedure checks: - The direction of rotation of the encoder/motor - The presence of signals (wiring continuity) - The number of pulses/revolution If a fault is detected, the drive locks in [Encoder fault] (EnF) fault mode.		[Not done] (nO)
EnU	❑ **[Encoder usage]** The parameter can be accessed if an encoder card has been inserted (1). ☐ **[No]** (nO): Function inactive ☐ **[Fdbk monit.]** (SEC): The encoder provides speed feedback for monitoring only. ☐ **[Spd fdk reg.]** (rEG): The encoder provides speed feedback for regulation and monitoring. This configuration is automatic if the drive is configured for closed-loop operation ([Motor control type] (Ctt) = [FVC] (FUC). If [Motor control type] (Ctt) = [SVC V] (UUC) the encoder operates in speed feedback mode and enables static correction of the speed to be performed. This configuration is not accessible for other [Motor control type] (Ctt) values. ☐ **[Speed ref.]** (PGr): The encoder provides a reference. Can only be selected with an incremental encoder card.		[No] (nO)

(1) The encoder parameters can only be accessed if the encoder card has been inserted, and the available selections will depend on the type of encoder card used. The encoder configuration can also be accessed in the [1.5- INPUTS / OUTPUTS CFG] (I/O) menu.

[ENA SYSTEM]

ENA SYSTEM is a control profile designed for rotating machines with unbalanced load.
It is used primarily for oil pumps. The operating principle applied:

- Allows operation without a braking resistor
- Reduces mechanical stress on the rod
- Reduces line current fluctuations
- Reduces energy consumption by improving the electric power/current ratio

[ENA prop.gain]

This setting is used to achieve a compromise between the reduced energy consumption (and/or line current fluctuations) and the mechanical stress to which the rod is subject.
Energy is saved by reducing current fluctuations and increasing the current while retaining the same average speed.

[ENA integral gain]

This setting is used to smooth the DC bus voltage.

Start up the machine with a low integral and proportional gain (proportional 25% and integral 10%) in order to avoid an overvoltage trip in the absence of a braking resistor. See if these settings are suitable.

Recommended adjustments to be made during operation:

- To eliminate the braking resistor and, therefore, the increase in the DC bus voltage:
  Display the machine speed on the graphic display terminal.
  Reduce the integral gain value until the machine speed drops. When this point is reached, increase the integral gain until the machine speed stabilizes.
  Use the graphic display terminal or an oscilloscope to check that the DC bus voltage is stable.
- To save energy:
  Reducing the proportional gain (gradually) may increase energy savings by reducing the maximum value of the line current, but it will increase speed variations and, therefore, mechanical stress.
  The aim is to identify settings that will enable energy to be saved and minimize mechanical stress.
  When reducing the proportional gain, it may be necessary to readjust the integral gain in order to avoid an overvoltage trip.

Note: Once the adjustments are complete, check that the pump starts up correctly. If the ENA integral gain setting is too low, this may lead to insufficient torque on startup.

[Reduction ratio]

This setting corresponds to the motor speed ahead of gearbox/speed after gearbox ratio. This parameter is used to display the average speed in Hz and the machine speed in customer units (e.g., in strokes per minute) on the graphic display terminal. In order to be displayed on the graphic display terminal, these values must be selected in the [1.2 MONITORING] (SUP-) menu.

Adjustment recommendations for prevention of tripping on an [Overspeed] (SOF) fault

ENA SYSTEM authorizes overspeed, which can trigger an [Overspeed] (SOF) fault. To avoid this occurring, it is advisable to increase the value of the following parameters slightly:

- [Max frequency] (tFr) page 71
- [Overspd. pulse thd.] (FqA) page 239, if the "frequency meter" function is configured

[1.4 MOTOR CONTROL] (drC-)

Code	Name/Description	Adjustment range	Factory setting
EnA nO YES	❑ **[ENA system]** The parameter can be accessed if [Motor control type] (Ctt) = [SVC V] (UUC), see page 73. ☐ **[No]** (nO) : Function inactive ☐ **[Yes]** (YES) : Function active.		[No] (nO)
GPE ()	❑ **[ENA prop.gain]** (1) The parameter can be accessed if [ENA system] (EnA) = [Yes] (YES)	1 to 9999	250
G iE ()	❑ **[ENA integral gain]** (1) The parameter can be accessed if [ENA system] (EnA) = [Yes] (YES)	0 to 9999	100
rAP ()	❑ **[Reduction ratio]** (1) The parameter can be accessed if [ENA system] (EnA) = [Yes] (YES)	10.0 to 999.9	10

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.

() Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting
oFI no YES	**❑ [Sinus filter]**		[No] (nO)

☐ **[No]** (nO): No sinus filter
☐ **[Yes]** (YES): Use of a sinus filter, to limit overvoltages on the motor and reduce the ground fault leakage current.
- [Sinus filter] (OFI) is forced to [No] (nO) on ATV71●037M3 and ATV71●075N4.
- [Sinus filter] (OFI) is forced to [No] (nO) for ATV71●●●●Y if [Motor control type] (Ctt) page 73 is not set to [V/F 2pts] (UF2) or [V/F 5pts] (UF5).

Note: The settings for [Current Limitation] (CLI) and [I Limit. 2 value] (CL2) page 61 must be made once [Motor control type] (Ctt) page 73 has been set to [V/F 2pts] (UF2) or [V/F 5pts] (UF5) and [Sinus filter] (OFI) has been set to [Yes] (YES). This is due to the fact that for certain ratings, this configuration will result in a reduced factory setting (1.36 In) for current limitations.

CAUTION

If [Sinus filter] (OFI) = [Yes] (YES), [Motor control type] (Ctt) page 73 must be [V/F 2pts] (UF2), [V/F 5pts] (UF5), (or [SVC V] (UUC) only up to 45 kW for ATV71●●●M3X and 75 kW for ATV71●●●N4), and [Max frequency] (tFr) must not exceed **100 Hz**.
Failure to follow this instruction can result in equipment damage.

SFr ( )	**❑ [Switching freq.]**	(1)	According to rating	According to rating

Switching frequency setting.
Adjustment range: This can vary between 1 and 16 kHz, but the minimum and maximum values, as well as the factory setting, can be limited in accordance with the type of drive (ATV71H or W), the rating (power and voltage) and the configuration of the [Sinus filter] (OFI) and [Motor surge limit] (SUL) parameters, page 85.

If [Sinus filter] (OFI)= [YES] (YES) and if the caliber is 690 V, the minimum [Switching freq.] (SFr) value is 2.5 kHz otherwise the minimum [Switching freq.] (SFr) value is 4.0 kHz.

If the value is less than 2 kHz, [Current Limitation] (CLI) and [I Limit. 2 value] (CL2) page 61 are limited to 1.36 In.

Adjustment with drive running:
- If the initial value is less than 2 kHz, it is not possible to increase it above 1.9 kHz while running.
- If the initial value is greater than or equal to 2 kHz, a minimum of 2 kHz must be maintained while running.

Adjustment with the drive stopped: No restrictions.

Note: In the event of excessive temperature rise, the drive will automatically reduce the switching frequency and reset it once the temperature returns to normal.

Note: If [Motor control type] (Ctt) page 73 = [FVC] (FUC), we do not recommend setting the switching frequency to a value less than 2 kHz (in order to avoid speed instability).

CAUTION

On ATV71●075N4 to U40N4, drives, if the RFI filters are disconnected (operation on an IT system), the drive's switching frequency must not exceed 4 kHz.
Failure to follow this instruction can result in equipment damage.

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.

( ) Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting
CL1	❑ **[Current Limitation]** (1) Used to limit the motor current. The adjustment range is limited to 1.36 In if [Switching freq.] (SFr) is less than 2 kHz. **Note:** If the setting is less than 0.25 In, the drive may lock in [Output Phase Loss] (OPF) fault mode if this has been enabled (see page 228). If it is less than the no-load motor current, the limitation no longer has any effect. **CAUTION** Check that the motor will withstand this current, particularly in the case of permanent magnet synchronous motors, which are susceptible to demagnetization. **Failure to follow this instruction can result in equipment damage.**	0 to 1.65 In (2)	1.5 In (2)
nrd nO YES	❑ **[Noise reduction]** ☐ **[No]** (nO): Fixed frequency. Factory setting at and above ATV71HD55M3X, ATV71HD90N4 and ATV71HC11Y. ☐ **[Yes]** (YES): Frequency with random modulation. Factory setting up to ATV71HD45M3X, ATV71HD75N4 and ATV71HD90Y. Random frequency modulation prevents any resonance, which may occur at a fixed frequency.		According to rating
SUL nO YES	❑ **[Motor surge limit.]** This function limits motor overvoltages and is useful in the following applications: - NEMA motors - Spindle motors - Rewound motors ☐ **[No]** (nO) : Function inactive ☐ **[Yes]** (YES) : Function active This parameter is forced to [No] (nO) if [Sinus filter] (OFI) previous page = [Yes] (YES). This parameter can remain = [No] (nO) for 230/400 V motors used at 230 V, or if the length of cable between the drive and the motor does not exceed: - 4 m with unshielded cables - 10 m with shielded cables		[No] (nO)
SOP	❑ **[Volt surge limit. opt]** Optimization parameter for transient overvoltages at the motor terminals. Can be accessed if [Motor surge limit.] (SUL) = [Yes] (YES). Set to 6, 8, or 10 µs, according to the following table.		10 µs

The value of the "SOP" parameter corresponds to the attenuation time of the cable used. It is defined to prevent the superimposition of voltage wave reflections resulting from long cable lengths. It limits overvoltages to twice the DC bus rated voltage.
The tables on the following page give examples of correspondence between the "SOP" parameter and the length of the cable between the drive and the motor. For longer cable lengths, a sinus filter or a dV/dt protection filter must be used.

- For motors in parallel, the sum of all the cable lengths must be taken into consideration. Compare the length given in the table row corresponding to the power for one motor with that corresponding to the total power, and select the shorter length. Example: Two 7.5 kW (10 HP) motors - take the lengths on the 15 kW (20 HP) table row, which are shorter than those on the 7.5 kW (10 HP) row, and divide by the number of motors to obtain the length per motor (with unshielded "GORSE" cable and SOP = 6, the result is 40/2 = 20 m maximum for each 7.5 kW (10 HP) motor).

In special cases (for example, different types of cable, different motor powers in parallel, different cable lengths in parallel, etc.), we recommend using an oscilloscope to check the overvoltage values obtained at the motor terminals.

To retain the overall drive performance, do not increase the SOP value unnecessarily.

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.
(2) In corresponds to the rated drive current indicated in the Installation Manual and on the drive nameplate.

Parameter that can be modified during operation or when stopped.


Tables giving the correspondence between the SOP parameter and the cable length, for 400 V line supply

Altivar 71	Motor		Cable cross-section		Maximum cable length in meters					
Reference	Power				Unshielded "GORSE" cable Type H07 RN-F 4Gxx			Shielded "GORSE" cable Type GVCSTV-LS/LH		
	kW	HP	in mm^2	AWG	**SOP = 10**	**SOP = 8**	**SOP = 6**	**SOP = 10**	**SOP = 8**	**SOP = 6**
ATV71H075N4	0.75	1	1.5	14	109.36 yd	76.55 yd	49.21 yd	114.83 yd	92.96 yd	71.08 yd
ATV71HU15N4	1.5	2	1.5	14	109.36 yd	76.55 yd	49.21 yd	114.83 yd	92.96 yd	71.08 yd
ATV71HU22N4	2.2	3	1.5	14	120.30 yd	71.08 yd	49.21 yd	114.83 yd	92.96 yd	71.08 yd
ATV71HU30N4	3	-	1.5	14	120.30 yd	71.08 yd	49.21 yd	114.83 yd	92.96 yd	71.08 yd
ATV71HU40N4	4	5	1.5	14	120.30 yd	71.08 yd	49.21 yd	114.83 yd	92.96 yd	71.08 yd
ATV71HU55N4	5.5	7.5	2.5	14	131.23 yd	71.08 yd	49.21 yd	114.83 yd	92.96 yd	71.08 yd
ATV71HU75N4	7.5	10	2.5	14	131.23 yd	71.08 yd	49.21 yd	114.83 yd	92.96 yd	71.08 yd
ATV71HD11N4	11	15	6	10	125.77 yd	65.62 yd	49.21 yd	109.36 yd	82.02 yd	60.15 yd
ATV71HD15N4	15	20	10	8	114.83 yd	65.62 yd	43.74 yd	109.36 yd	76.55 yd	54.68 yd
ATV71HD18N4	18.5	25	10	8	125.77 yd	65.62 yd	38.28 yd	164.04 yd	82.02 yd	54.68 yd
ATV71HD22N4	22	30	16	6	164.04 yd	65.62 yd	43.74 yd	164.04 yd	76.55 yd	54.68 yd
ATV71HD30N4	30	40	25	4	164.04 yd	60.15 yd	38.28 yd	164.04 yd	76.55 yd	54.68 yd
ATV71HD37N4	37	50	35	5	218.72 yd	71.08 yd	54.68 yd	164.04 yd	76.55 yd	54.68 yd
ATV71HD45N4	45	60	50	0	218.72 yd	60.15 yd	32.81 yd	164.04 yd	65.62 yd	43.74 yd
ATV71HD55N4	55	75	70	2/0	218.72 yd	54.68 yd	27.34 yd	164.04 yd	60.15 yd	32.81 yd
ATV71HD75N4	75	100	95	4/0	218.72 yd	49.21 yd	27.34 yd	164.04 yd	60.15 yd	32.81 yd

Altivar 71	Motor		Cable cross-section		Maximum cable length in meters					
Reference	Power				Shielded "BELDEN" cable Type 2950x			Shielded "PROTOFLEX" cable Type EMV 2YSLCY-J		
	kW	HP	in mm^2	AWG	**SOP = 10**	**SOP = 8**	**SOP = 6**	**SOP = 10**	**SOP = 8**	**SOP = 6**
ATV71H075N4	0.75	1	1.5	14	54.68 yd	43.74 yd	32.81 yd			
ATV71HU15N4	1.5	2	1.5	14	54.68 yd	43.74 yd	32.81 yd			
ATV71HU22N4	2.2	3	1.5	14	54.68 yd	43.74 yd	32.81 yd			
ATV71HU30N4	3	-	1.5	14	54.68 yd	43.74 yd	32.81 yd			
ATV71HU40N4	4	5	1.5	14	54.68 yd	43.74 yd	32.81 yd			
ATV71HU55N4	5.5	7.5	2.5	14	54.68 yd	43.74 yd	32.81 yd			
ATV71HU75N4	7.5	10	2.5	14	54.68 yd	43.74 yd	32.81 yd			
ATV71HD11N4	11	15	6	10	54.68 yd	43.74 yd	32.81 yd			
ATV71HD15N4	15	20	10	8	54.68 yd	43.74 yd	32.81 yd			
ATV71HD18N4	18.5	25	10	8	54.68 yd	43.74 yd	32.81 yd			
ATV71HD22N4	22	30	16	6				82.02 yd	43.74 yd	27.34 yd
ATV71HD30N4	30	40	25	4				82.02 yd	43.74 yd	27.34 yd
ATV71HD37N4	37	50	35	5				82.02 yd	43.74 yd	27.34 yd
ATV71HD45N4	45	60	50	0				82.02 yd	43.74 yd	27.34 yd
ATV71HD55N4	55	75	70	2/0				82.02 yd	32.81 yd	16.40 yd
ATV71HD75N4	75	100	95	4/0				82.02 yd	32.81 yd	16.40 yd

For 230/400 V motors used at 230 V, the [Motor surge limit.] (SUL) parameter can remain = [No] (nO).

Code	Name/Description	Adjustment range	Factory setting
ubr	**❑ [Braking level]**		According to drive voltage rating
	DC bus voltage threshold above which the braking transistor cuts in to limit this voltage. ATV71●●●●M3●: factory setting 395 V. ATV71●●●●N4: factory setting 785 V. ATV71●●●●S6X: factory setting 980 V. ATV71●●●●Y: factory setting 1127 V or 1080 V according to rating. The adjustment range depends on the voltage rating of the drive and the [Mains voltage] (UrES) parameter, page 232.		
bbA	**❑ [Braking balance]**		[No] (nO)
nO YES	☐ **[No]** (nO) : Function inactive ☐ **[Yes]** (YES) : Function active, to be used on drives connected in parallel via their DC bus. Used to balance the braking power between the drives. The [Braking level] (Ubr) parameter must be set to the same value on the various drives. The value[Yes] (YES) is possible only if [Dec ramp adapt.] (brA) = [No] (nO) (see page 143)		
LbA	**❑ [Load sharing]**		[No] (nO)
nO YES	When 2 motors are connected mechanically and therefore at the same speed, and each is controlled by a drive, this function can be used to improve torque distribution between the two motors. To do this, it varies the speed based on the torque. ☐ **[No]** (nO) : Function inactive ☐ **[Yes]** (YES) : Function active The parameter can only be accessed if [Motor control type] (Ctt) page 73 is not [V/F 2pts] (UF2) or [V/F 5pts] (UF5).		
LbC	**❑ [Load correction]** (1)	0 to 599 Hz	0
	Rated correction in Hz. The parameter can be accessed if [Load sharing] (LbA) = [Yes] (YES)		

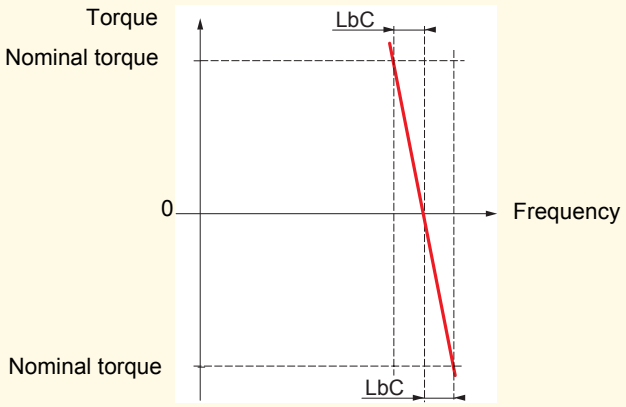


(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.


Parameter that can be modified during operation or when stopped.


Load sharing, parameters that can be accessed at expert level

Principle

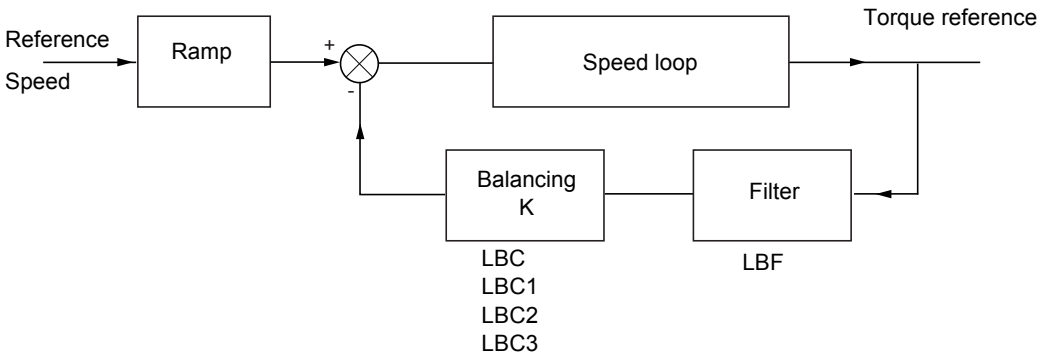

The load sharing factor K is determined by the torque and speed, with two factors K1 and K2 (K = K1 x K2).

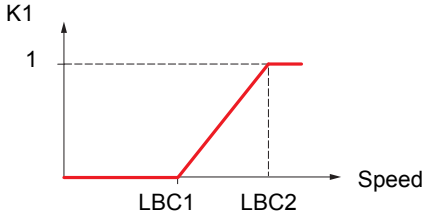

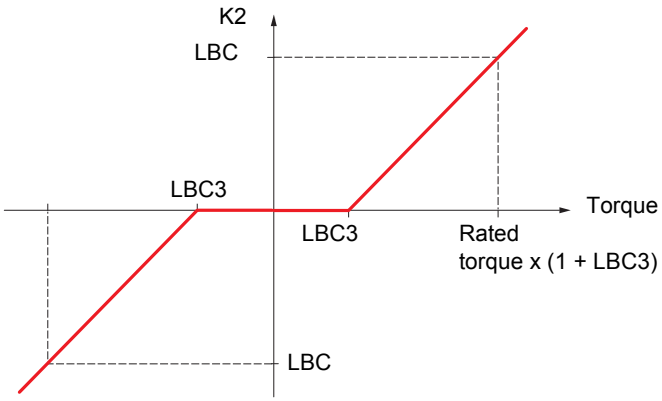


[1.4 MOTOR CONTROL] (drC-)

Code	Name/Description	Adjustment range	Factory setting
LbC1	❑ **[Correction min spd]** The parameter can be accessed if [Load sharing] (LbA) = [Yes] (YES) Minimum speed for load correction in Hz. Below this threshold, no corrections are made. Used to prevent correction at very low speed if this would hamper rotation of the motor.	0 to 598.9 Hz	0
LbC2	❑ **[Correction max spd]** The parameter can be accessed if [Load sharing] (LbA) = [Yes] (YES) Speed threshold in Hz above which maximum load correction is applied.	[Correction min spd] (LbC1) + 0.1 at 599 Hz	0,1
LbC3	❑ **[Torque offset]** The parameter can be accessed if [Load sharing] (LbA) = [Yes] (YES) Minimum torque for load correction as a % of the rated torque. Below this threshold, no corrections are made. Used to avoid torque instabilities when the torque direction is not constant.	0 to 300%	0%
LbF	❑ **[Sharing filter]** The parameter can be accessed if [Load sharing] (LbA) = [Yes] (YES) Time constant (filter) for correction in ms. Used in the event of flexible mechanical coupling in order to avoid instabilities.	100 ms to 20 s	100 ms


Parameter that can be modified during operation or when stopped.

[1.5 INPUTS / OUTPUTS CFG] (I-O-)

With graphic display terminal:

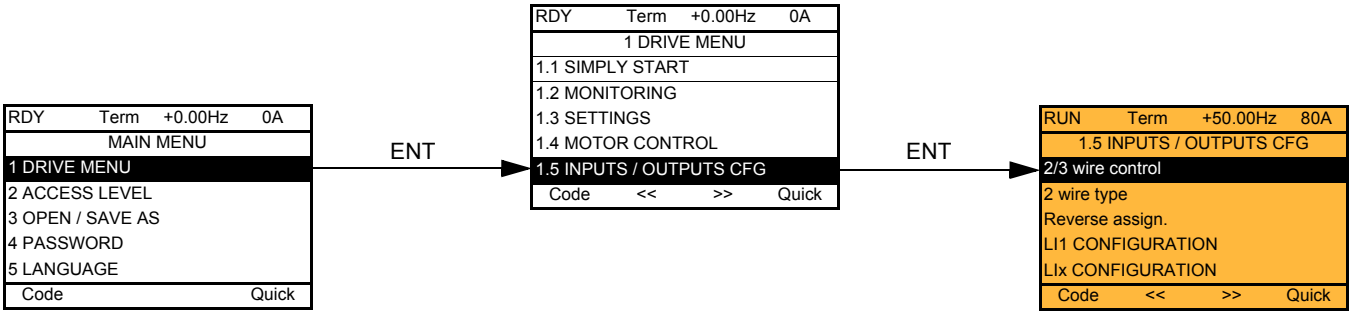

With integrated display terminal:

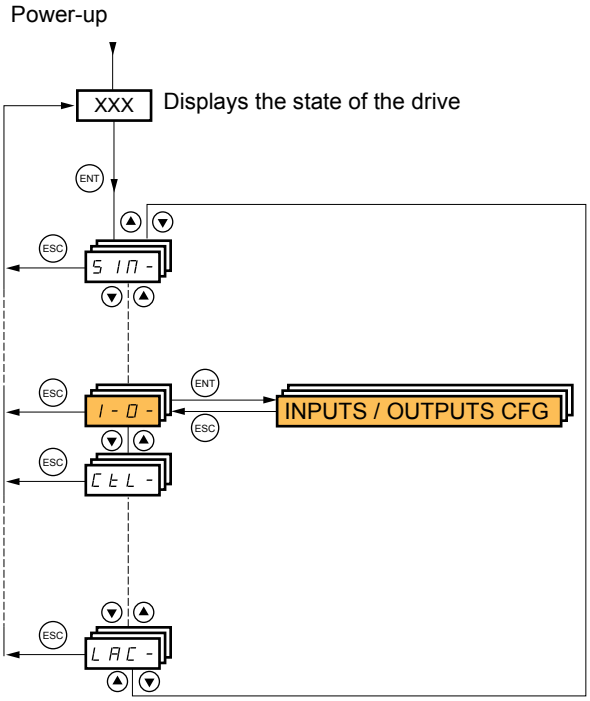


[1.5 INPUTS / OUTPUTS CFG] (I-O-)

The parameters in the [1.5 INPUTS / OUTPUTS CFG] (I-O-) menu can only be modified when the drive is stopped and no run command is present.

Code	Name/Description	Adjustment range	Factory setting
tCC	❑ **[2/3 wire control]**		[2 wire] (2C)
2C	☐ **[2 wire]** (2C)		
3C	☐ **[3 wire]** (3C)		

2-wire control: This is the input state (0 or 1) or edge (0 to 1 or 1 to 0), which controls running or stopping.


Example of "source" wiring:



LI1: forward
LIx: reverse

3-wire control (pulse commands): A "forward" or "reverse" pulse is sufficient to command starting, a "stop" pulse is sufficient to command stopping.

Example of "source" wiring:



LI1: stop
LI2: forward
LIx: reverse

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION

To change the assignment of [2/3 wire control] (tCC) press and hold down the “ENT” key for 2 s.
It causes the following functions to return to factory setting: [2 wire type] (tCt) and [Reverse assign.] (rrS) below, and all functions which assign logic inputs and analog inputs.
The macro configuration selected will also be reset it if has been customized (loss of custom settings).
It is advisable to configure this parameter before configuring the [1.6 COMMAND] (CtL-) and [1.7 APPLICATION FUNCT.] (FUn-) menus.
Check that this change is compatible with the wiring diagram used.
Failure to follow these instructions can result in death or serious injury.

tCt	❑ **[2 wire type]**		[Transition] (trn)
LEL	☐ **[Level]** (LEL): State 0 or 1 is taken into account for run (1) or stop (0).		
trn	☐ **[Transition]** (trn): A change of state (transition or edge) is necessary to initiate operation, in order to prevent accidental restarts after a break in the power supply.		
PFo	☐ **[Fwd priority]** (PFO): State 0 or 1 is taken into account for run or stop, but the "forward" input always takes priority over the "reverse" input.		
rrS	❑ **[Reverse assign.]**		[LI2] (LI2)
nO	☐ **[No]** (nO): Not assigned		
LI1	☐ **[LI1]** (LI1) to **[LI6]** (LI6)		
-	☐ **[LI7]** (LI7) to **[LI10]** (LI10): If VW3A3201 logic I/O card has been inserted		
-	☐ **[LI11]** (LI11) to **[LI14]** (LI14): If VW3A3202 extended I/O card has been inserted		
C101	☐ **[C101]** (C101) to **[C115]** (C115): With integrated Modbus in [I/O profile] (IO)		
-	☐ **[C201]** (C201) to **[C215]** (C215): With integrated CANopen in [I/O profile] (IO)		
-	☐ **[C301]** (C301) to **[C315]** (C315): With a communication card in [I/O profile] (IO)		
-	☐ **[C401]** (C401) to **[C415]** (C415): With a Controller Inside card in [I/O profile] (IO)		
Cd00	☐ **[CD00]** (Cd00) to **[CD13]** (Cd13): In [I/O profile] (IO) can be switched with possible logic inputs		
-	☐ **[CD14]** (Cd14) to **[CD15]** (Cd15): In [I/O profile] (IO) can be switched without logic inputs		
	Assignment of the reverse direction command.		


Code	Name/Description	Adjustment range	Factory setting
L I -	**[LI1 CONFIGURATION]**		
L IA	**[LI1 assignment]** Read-only parameter, cannot be configured. It displays all the functions that are assigned to input LI1 in order to check for multiple assignments.		
L Id	**[LI1 On Delay]** This parameter is used to take account of the change of the logic input to state 1 with a delay that can be adjusted between 0 and 200 milliseconds, in order to filter out possible interference. The change to state 0 is taken into account without delay. **WARNING** **UNINTENDED EQUIPMENT OPERATION** Check that the delay set does not pose a risk or lead to undesired operation. The relative order in which these inputs are taken into account may be modified according to the delay values of the various logic inputs, and thus lead to unintended operation. **Failure to follow these instructions can result in death or serious injury.**	0 to 200 ms	0
L - -	**[LIx CONFIGURATION]**		
	All the logic inputs available on the drive are processed as in the example for LI1 above, up to LI6, LI10 or LI14, depending on whether or not option cards have been inserted.		


Configuration of analog inputs and Pulse input

The minimum and maximum input values (in volts, mA, etc.) are converted to % in order to adapt the references to the application.

Minimum and maximum input values:


The minimum value corresponds to a reference of 0% and the maximum value to a reference of 100%. The minimum value may be greater than the maximum value:

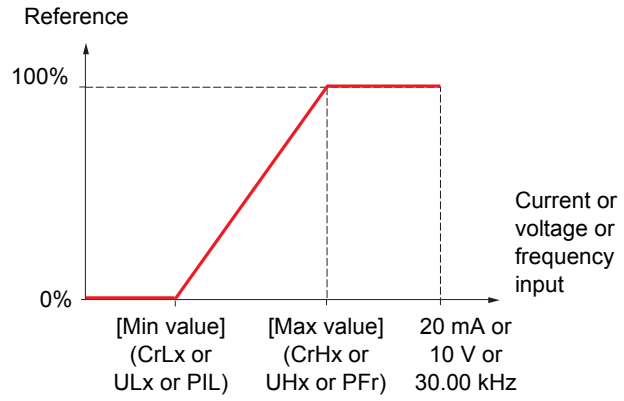

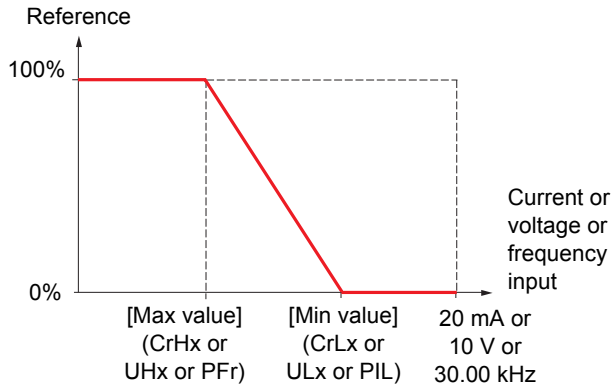


For +/- bidirectional inputs, the min. and max. are relative to the absolute value, for example, +/- 2 to 8 V.


Negative min. value of Pulse input:

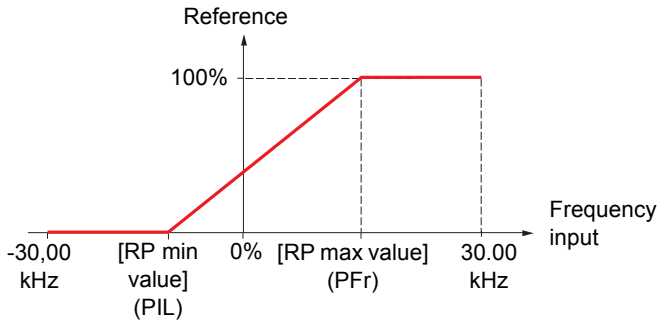


Range (output values): For analog inputs only

This parameter is used to configure the reference range to [0% ➞100%] or [-100% ➞ +100%] in order to obtain a bidirectional output from a unidirectional input.

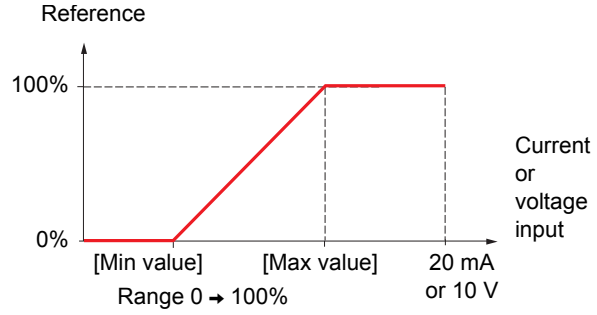

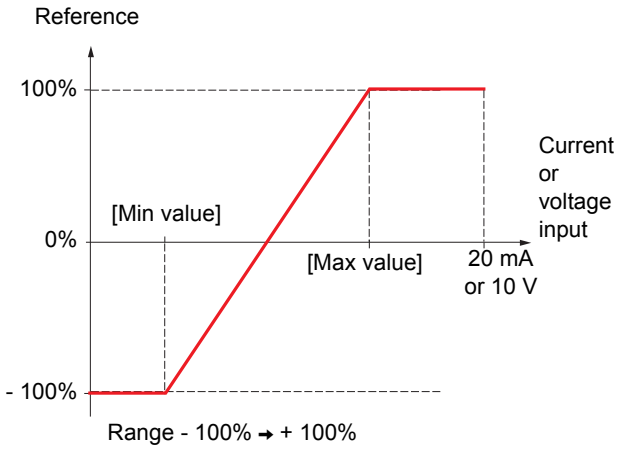


Code	Name/Description	Adjustment range	Factory setting
bSP	❑ **[Reference template]**		[Standard] (bSd)
bSd	☐ **[Standard]** (bSd)		

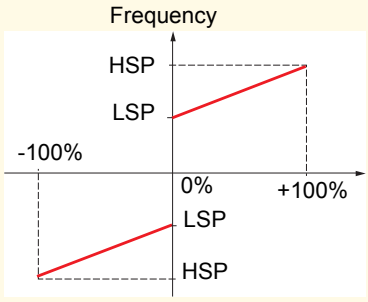


At zero reference the frequency = LSP

bLS	☐ **[Pedestal]** (bLS)	

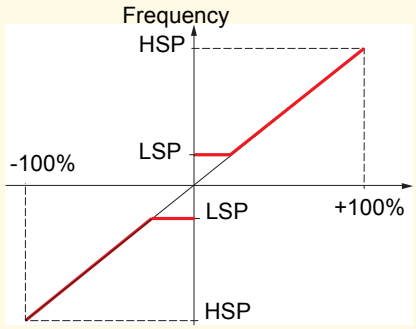


At reference = 0 to LSP the frequency = LSP

bnS	☐ **[Deadband]** (bnS)	

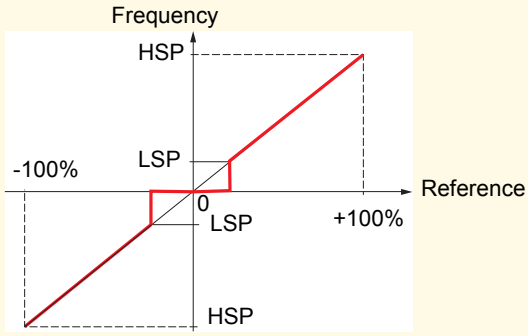

At reference = 0 to LSP the frequency = 0

bnS0	☐ **[Deadband 0]** (bnS0)	

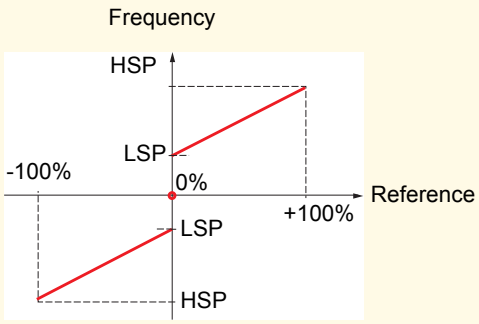

This operation is the same as [Standard] (bSd), except that in the following cases at zero reference, the frequency = 0:
• The signal is less than [Min value], which is greater than 0 (example 1 V on a 2 - 10 V input)
• The signal is greater than [Min value], which is greater than [Max value] (example 11 V on a 10 - 0 V input).


If the input range is configured as "bidirectional", operation remains identical to [Standard] (bSd).

This parameter defines how the speed reference is taken into account, for analog inputs and Pulse input only. In the case of the PID regulator, this is the PID output reference.
The limits are set by the [Low speed] (LSP) and [High speed] (HSP) parameters, page 44

Delinearization: For analog inputs only


The input can be delinearized by configuring an intermediate point on the input/output curve of this input:

For range 0 ➞ 100%

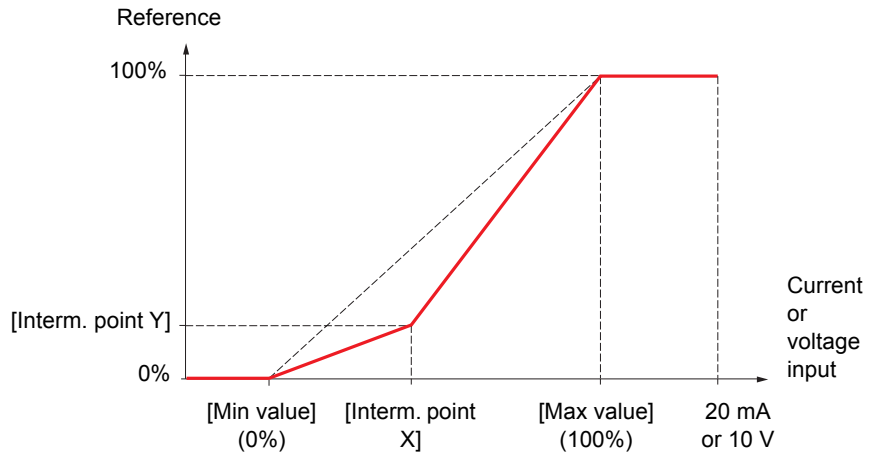

Note: For [Interm. point X], 0% corresponds to [Min value] and 100% to [Max value]

For range -100% ➞ 100%

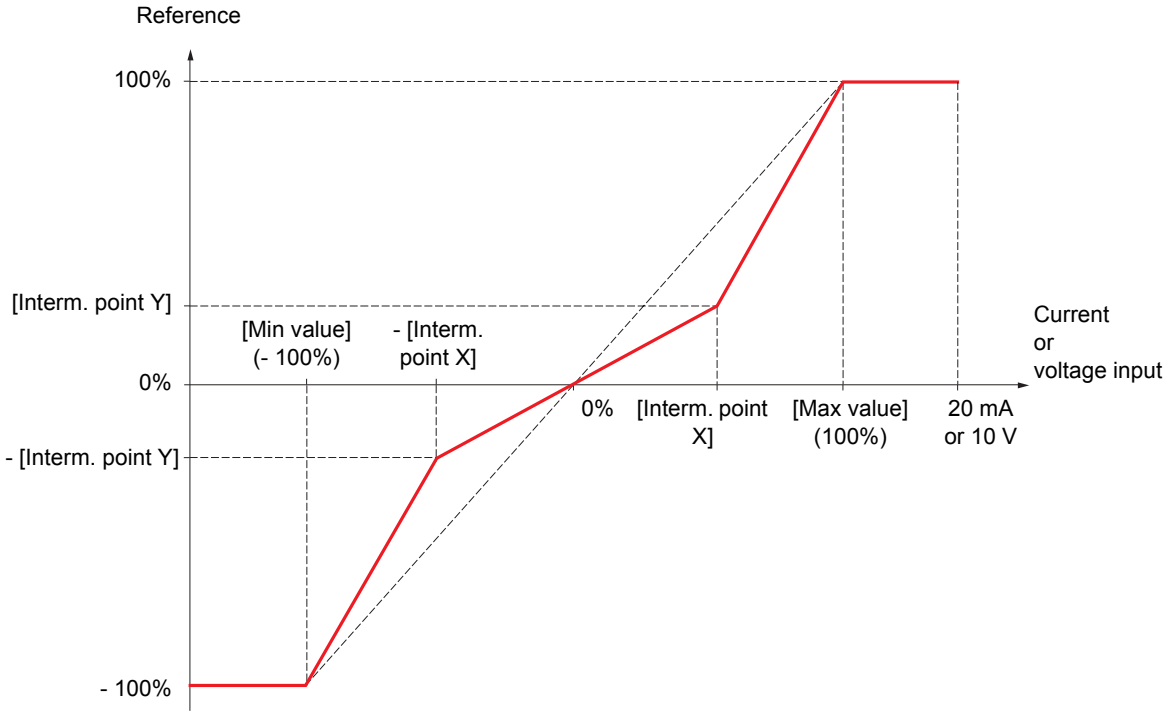

Code	Name/Description	Adjustment range	Factory setting
AI1-	**[AI1 CONFIGURATION]**		
AI1A	**[AI1 assignment]** Read-only parameter, cannot be configured. It displays all the functions associated with input AI1 in order to check, for example, for compatibility problems.		
AI1t 10U n10U	**[AI1 Type]** ☐ **[Voltage]** (10U): Positive voltage input (negative values are interpreted as zero: the input is unidirectional). ☐ **[Voltage +/-]** (n10U): Positive and negative voltage input (the input is bidirectional).		[Voltage] (10U)
UIL1	**[AI1 min value]**	0 to 10.0 V	0 V
UIH1	**[AI1 max value]**	0 to 10.0 V	10.0 V
AI1F	**[AI1 filter]** Interference filtering.	0 to 10.00 s	0 s
AI1E	**[AI1 Interm. point X]** Input delinearization point coordinate. • 0% corresponds to [AI1 min value] (UIL1). • 100% corresponds to [AI1 max value] (UIH1).	0 to 100%	0%
AI1S	**[AI1 Interm. point Y]** Output delinearization point coordinate (frequency reference).	0 to 100%	0%

Code	Name/Description	Adjustment range	Factory setting
AI2-	**[AI2 CONFIGURATION]**		
AI2A	**[AI2 assignment]** Read-only parameter, cannot be configured. It displays all the functions associated with input AI2 in order to check, for example, for compatibility problems.		
AI2t 10U 0A	**[AI2 Type]** ☐ **[Voltage]** (10U): Voltage input ☐ **[Current]** (0 A): Current input		[Current] (0 A)
CrL2	**[AI2 min value]** The parameter can be accessed if [AI2 Type] (AI2t) = [Current] (0 A)	0 to 20.0 mA	0 mA
uIL2	**[AI2 min value]** The parameter can be accessed if [AI2 Type] (AI2t) = [Voltage] (10U)	0 to 10.0 V	0 V
CrH2	**[AI2 max. value]** The parameter can be accessed if [AI2 Type] (AI2t) = [Current] (0 A)	0 to 20.0 mA	20.0 mA
uIH2	**[AI2 max. value]** The parameter can be accessed if [AI2 Type] (AI2t) = [Voltage] (10U)	0 to 10.0 V	10.0 V
AI2F	**[AI2 filter]** Interference filtering.	0 to 10.00 s	0 s
AI2L PoS nEG	**[AI2 range]** ☐ **[0 - 100%]** (POS): Unidirectional input ☐ **[+/- 100%]** (nEG): Bidirectional input Example: On a 0/10 V input - 0 V corresponds to reference -100% - 5 V corresponds to reference 0% - 10 V corresponds to reference + 100%		[0 - 100%] (POS)
AI2E	**[AI2 Interm. point X]** Input delinearization point coordinate. • 0% corresponds to [Min value] if the range is 0 ➞ 100%. • 0% corresponds to $\frac{\text{[Max value]} + \text{[Min value]}}{2}$ if the range is -100% ➞ + 100%. • 100% corresponds to [Max value].	0 to 100%	0%
AI2S	**[AI2 Interm. point Y]** Output delinearization point coordinate (frequency reference).	0 to 100%	0%

Code	Name/Description	Adjustment range	Factory setting
AI3 -	**[AI3 CONFIGURATION]** Can be accessed if a VW3A3202 option card has been inserted		
AI3A	**[AI3 assignment]** Read-only parameter, cannot be configured. It displays all the functions associated with input AI3 in order to check, for example, for compatibility problems.		
AI3t OA	**[AI3 Type]** Read-only parameter, cannot be configured. ☐ **[Current]** (0 A): Current input		[Current] (0 A)
CrL3	**[AI3 min. value]**	0 to 20.0 mA	0 mA
CrH3	**[AI3 max. value]**	0 to 20.0 mA	20.0 mA
AI3F	**[AI3 filter]** Interference filtering.	0 to 10.00 s	0 s
AI3L PoS nEG	**[AI3 range]** ☐ **[0 - 100%]** (POS): Unidirectional input ☐ **[+/- 100%]** (nEG): Bidirectional input Example: On a 4 - 20 mA input - 4 mA corresponds to reference -100% - 12 mA corresponds to reference 0% - 20 mA corresponds to reference + 100% Since AI3 is, in physical terms, a bidirectional input, the [+/- 100%] (nEG) configuration must only be used if the signal applied is unidirectional. A bidirectional signal is not compatible with a bidirectional configuration.		[0 - 100%] (POS)
AI3E	**[AI3 Interm. point X]** Input delinearization point coordinate. • 0% corresponds to [Min value] (CrL3) if the range is 0 → 100%. • 0% corresponds to $\frac{\text{[AI3 max. value] (CrH3) - [AI3 min. value]}}{\text{(CrL3)}}$ if the range is -100% → +100%. • 100% corresponds to [AI3 max. value] (CrH3).	0 to 100%	0%
AI3S	**[AI3 Interm. point Y]** Output delinearization point coordinate (frequency reference).	0 to 100%	0%

Code	Name/Description	Adjustment range	Factory setting
A I 4 -	**[AI4 CONFIGURATION]** Can be accessed if a VW3A3202 option card has been inserted		
A I 4 A	**[AI4 assignment]** Read-only parameter, cannot be configured. It displays all the functions associated with input AI4 in order to check, for example, for compatibility problems.		
A I 4 t 10U 0A	**[AI4 Type]** ☐ **[Voltage]** (10U): Voltage input ☐ **[Current]** (0 A): Current input		[Voltage] (10U)
C r L 4	**[AI4 min value]** The parameter can be accessed if [AI4 Type] (AI4t) = [Current] (0 A)	0 to 20.0 mA	0 mA
U I L 4	**[AI4 min value]** The parameter can be accessed if [AI4 Type] (AI4t) = [Voltage] (10U)	0 to 10.0 V	0 V
C r H 4	**[AI4 max value]** The parameter can be accessed if [AI4 Type] (AI4t) = [Current] (0 A)	0 to 20.0 mA	20.0 mA
U I H 4	**[AI4 max value]** The parameter can be accessed if [AI4 Type] (AI4t) = [Voltage] (10U)	0 to 10.0 V	10.0 V
A I 4 F	**[AI4 filter]** Interference filtering.	0 to 10.00 s	0 s
A I 4 L PoS nEG	**[AI4 range]** ☐ **[0 - 100%]** (POS): Unidirectional input ☐ **[+/- 100%]** (nEG): Bidirectional input Example: On a 0/10 V input - 0 V corresponds to reference -100% - 5 V corresponds to reference 0% - 10 V corresponds to reference + 100%		[0 - 100%] (POS)
A I 4 E	**[AI4 Interm.point X]** Input delinearization point coordinate. • 0% corresponds to [Min value] if the range is 0 → 100%. • 0% corresponds to $\frac{\text{[Max value]} + \text{[Min value]}}{2}$ if the range is -100% → + 100%. • 100% corresponds to [Max value].	0 to 100%	0%
A I 4 S	**[AI4 Interm.point Y]** Output delinearization point coordinate (frequency reference).	0 to 100%	0%

Code	Name/Description	Adjustment range	Factory setting
AUI-	**[VIRTUAL AI1]**		
AIC1	**[AI net. channel]**		[No] (nO)

Virtual input.
This parameter can also be accessed in the [PID REGULATOR] (PId-)submenu page 181.

nO **[No]** (nO): Not assigned (in this case, the virtual input does not appear in the analog input assignment parameters for the functions)

Mdb **[Modbus]** (Mdb): Integrated Modbus

CAn **[CANopen]** (CAn): Integrated CANopen

nEt **[Com. card]** (nEt): Communication card (if inserted)

APP **[C.Insid. card]** (APP): Controller Inside card (if inserted)

Scale: the value 8192 transmitted by this input is equivalent to 10 V on a 10 V input.

WARNING

UNINTENDED EQUIPMENT OPERATION

If the equipment switches to forced local mode (see page 248), the virtual input remains fixed at the last value transmitted.
Do not use the virtual input and forced local mode in the same configuration.
Failure to follow these instructions can result in death or serious injury.


Code	Name/Description	Adjustment range	Factory setting
PL i-	**[RP CONFIGURATION]** Can be accessed if a VW3A3202 option card has been inserted		
P iA	**[RP assignment]** Read-only parameter, cannot be configured. It displays all the functions associated with the Pulse In input in order to check, for example, for compatibility problems.		
P iL	**[RP min value]** Frequency corresponding to the minimum speed	- 30.00 to 30.00 kHz	0
PFr	**[RP max value]** Frequency corresponding to the maximum speed	0 to 30.00 kHz	30.00 kHz
PF i	**[RP filter]** Interference filtering.	0 to 1000 ms	0


Configuration of the encoder input serving as a reference, with a frequency generator


This reference is not signed, therefore the directions of operation must be given via the control channel (logic inputs, for example).

Minimum and maximum values (input values):

The minimum value corresponds to a minimum reference of 0% and the maximum value to a maximum reference of 100%. The minimum value may be greater than the maximum value. It may also be negative.

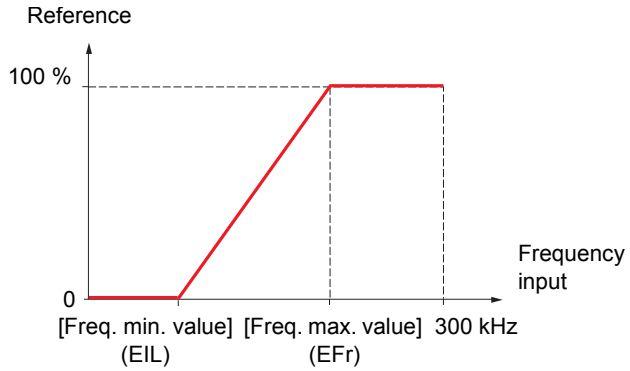

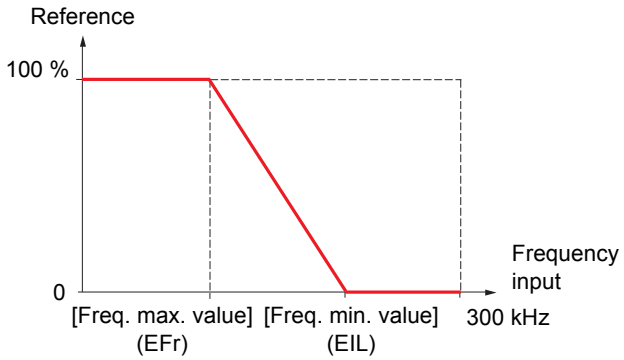

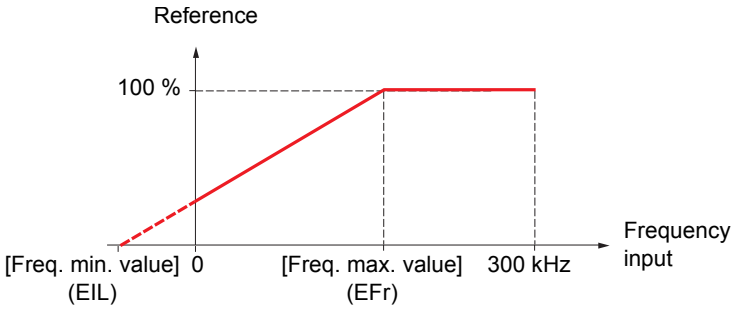

A reference can be obtained at zero frequency by assigning a negative value to the minimum value.

[1.5 INPUTS / OUTPUTS CFG] (I-O-)

The encoder configuration can also be accessed in the [1.4 MOTOR CONTROL] (drC-) menu.

Code	Name/Description	Adjustment range	Factory setting
iEn-	**[ENCODER CONFIGURATION]** The encoder parameters can only be accessed if a compatible encoder card has been inserted, and the available selections will depend on the type of encoder card used.		
EnS	**[Encoder type]** The parameter can be accessed if an incremental encoder card has been inserted. To be configured in accordance with the type of encoder used. ☐ **[AABB]** (AAbb): For signals A, A-, B, B-. ☐ **[AB]** (Ab): For signals A, B. ☐ **[A]** (A): For signal A. Value cannot be accessed if [Encoder usage] (EnU) page 105 = [Spd fdk reg.] (rEG).	[AABB] (AAbb)	
AAbb			
Ab			
A			
EnC	**[Encoder check]** Checks the encoder feedback. See procedure page 82. The parameter can be accessed if an encoder card has been inserted and if [Encoder usage] (EnU) page 105 is not [Speed ref.] (PGr). ☐ **[Not done]** (nO): Check not performed. ☐ **[Yes]** (YES): Activates monitoring of the encoder. ☐ **[Done]** (dOnE): Check performed successfully. The check procedure checks: - The direction of rotation of the encoder/motor - The presence of signals (wiring continuity) - The number of pulses/revolution If a fault is detected, the drive locks in [Encoder fault] (EnF) fault mode.	[Not done] (nO)	
no			
YES			
donE			

Code	Name/Description	Adjustment range	Factory setting
	[ENCODER CONFIGURATION] (continued)		
EnU	**[Encoder usage]**		[No] (nO)
	The parameter can be accessed if an encoder card has been inserted. ☐ **[No]** (nO): Function inactive. In this case, the other parameters cannot be accessed. ☐ **[Fdbk monit.]** (SEC): The encoder provides speed feedback for monitoring only. ☐ **[Spd fdk reg.]** (rEG): The encoder provides speed feedback for regulation and monitoring. This configuration is automatic if the drive is configured for closed-loop operation ([Motor control type] (Ctt) = [FVC] (FUC). If [Motor control type] (Ctt) = [SVC V] (UUC) the encoder operates in speed feedback mode and enables static correction of the speed to be performed. This configuration is not accessible for other [Motor control type] (Ctt) values. ☐ **[Speed ref.]** (PGr): The encoder provides a reference. Can only be selected with an incremental encoder card.		
PGI	**[Number of pulses]**	100 to 5000	1024
	Number of pulses per encoder revolution. The parameter can be accessed if an incremental encoder card has been inserted.		
PGA	**[Reference type]**		[Encoder] (EnC)
	The parameter can be accessed if [Encoder usage] (EnU) = [Speed ref.] (PGr). ☐ **[Encoder]** (EnC) : Use of an encoder. ☐ **[Freq. gen.]** (PtG): Use of a frequency generator (absolute speed setpoint).		
EIL	**[Freq. min. value]**	- 300 to 300 kHz	0
	The parameter can be accessed if [Encoder usage] (EnU) = [Speed ref.] (PGr) and if [Reference type] (PGA) = [Freq. gen.] (PtG). Frequency corresponding to the minimum speed		
EFr	**[Freq. max value]**	0.00 to 300 kHz	300 kHz
	The parameter can be accessed if [Encoder usage] (EnU) = [Speed ref.] (PGr) and if [Reference type] (PGA) = [Freq. gen.] (PtG). Frequency corresponding to the maximum speed		
EFI	**[Freq. signal filter]**	0 to 1000 ms	0
	The parameter can be accessed if [Encoder usage] (EnU) = [Speed ref.] (PGr). Interference filtering.		

Code	Name/Description	Adjustment range	Factory setting
r 1-	**[R1 CONFIGURATION]**		
r 1	**[R1 Assignment]**		[No drive flt] (FLt)

- ☐ **[No]** (nO): **Not assigned**
- ☐ **[No drive flt]** (FLt): Drive not faulty (relay normally energized, and de-energized if there is a fault)
- ☐ **[Drv running]** (rUn): Drive running
- ☐ **[Freq. Th. attain.]** (FtA): Frequency threshold attained ([Freq. threshold] (Ftd) page 68)
- ☐ **[HSP attain.]** (FLA): High speed attained
- ☐ **[I attained]** (CtA): Current threshold attained ([Current threshold] (Ctd) page 67)
- ☐ **[Freq.ref.att]** (SrA): Frequency reference attained
- ☐ **[Th.mot. att.]** (tSA): Motor 1 thermal state attained
- ☐ **[PID error al]** (PEE): PID error alarm
- ☐ **[PID fdbk al]** (PFA): PID feedback alarm
- ☐ **[AI2 AI. 4-20]** (AP2): Alarm indicating absence of 4-20 mA signal on input A12
- ☐ **[Freq. Th 2 attain.]** (F2A): Frequency threshold 2 attained ([Freq. threshold 2] (F2d) page 68)
- ☐ **[Th. drv. att.]** (tAd): Drive thermal state attained
- ☐ **[Rope slack]** (rSdA): Rope slack (see [Rope slack config.] (rSd) parameter page 176)
- ☐ **[High tq. att.]** (ttHA): Motor torque overshooting high threshold[High torque thd.] (ttH) page 67.
- ☐ **[Low tq. att.]** (ttLA): Motor torque undershooting low threshold[Low torque thd.] (ttL) page 67.
- ☐ **[Forward]** (MFrd): Motor in forward rotation
- ☐ **[Reverse]** (MrrS): Motor in reverse rotation
- ☐ **[Th.mot2 att]** (tS2): Motor 2 thermal state attained
- ☐ **[Th.mot3 att]** (tS3): Motor 3 thermal state attained
- ☐ **[Drive start]** (Strt)
  1 : A run order has been received
  0 : A stop order has been received
- ☐ **[Neg Torque]** (AtS): Negative torque (braking)
- ☐ **[Cnfg.0 act.]** (CnF0): Configuration 0 active
- ☐ **[Cnfg.1 act.]** (CnF1): Configuration 1 active
- ☐ **[Cnfg.2 act.]** (CnF2): Configuration 2 active
- ☐ **[Set 1 active]** (CFP1): Parameter set 1 active
- ☐ **[Set 2 active]** (CFP2): Parameter set 2 active
- ☐ **[Set 3 active]** (CFP3): Parameter set 3 active
- ☐ **[DC charged]** (dbL): DC bus charging
- ☐ **[In braking]** (brS): Drive braking
- ☐ **[P. removed]** (PRM): Drive locked by "Power removal" input
- ☐ **[Fr.met. alar.]** (FqLA): Measured speed threshold attained: [Pulse warning thd.] (FqL) page 68.
- ☐ **[I present]** (MCP): Motor current present
- ☐ **[Limit sw. att]** (LSA): Limit switch attained
- ☐ **[Load alarm]** (dLdA): Load variation detection (see page 241).
- ☐ **[Alarm Grp 1]** (AGI): Alarm group 1
- ☐ **[Alarm Grp 2]** (AG2): Alarm group 2
- ☐ **[Alarm Grp 3]** (AG3): Alarm group 3
- ☐ **[PTC1 alarm]** (P1A): Probe alarm 1
- ☐ **[PTC2 alarm]** (P2A): Probe alarm 2
- ☐ **[LI6=PTC al.]** (PLA): LI6 = PTC probe alarm
- ☐ **[Ext. fault al]** (EFA): External fault alarm
- ☐ **[Under V. al.]** (USA): Undervoltage alarm
- ☐ **[Uvolt warn]** (UPA): Undervoltage warning
- ☐ **[slipping al.]** (AnA): Slipping alarm
- ☐ **[AI. °C drv]** (tHA): Drive overheating
- ☐ **[Load mvt al]** (bSA): Braking speed alarm
- ☐ **[Brk cont. al]** (bCA): Brake contact alarm
- ☐ **[Lim T/I att.]** (SSA): Torque limit alarm
- ☐ **[Trq. ctrl. al.]** (rtA): Torque control alarm
- ☐ **[IGBT al.]** (tJA): IGBT alarm
- ☐ **[Brake R. al.]** (bOA): Braking resistor temperature alarm
- ☐ **[Option al.]** (APA): Alarm generated by the Controller Inside card.
- ☐ **[AI3 AI. 4-20]** (AP3): Alarm indicating absence of 4-20 mA signal on input AI3
- ☐ **[AI4 AI. 4-20]** (AP4): Alarm indicating absence of 4-20 mA signal on input AI4
- ☐ **[Ready]** (rdY): Drive ready

Code	Name/Description	Adjustment range	Factory setting
	[R1 CONFIGURATION] (continued)		
r1d	**[R1 Delay time]**	0 to 60000 ms (1)	0
	The change in state only takes effect once the configured time has elapsed, when the information becomes true. The delay cannot be set for the [No drive flt] (FLt) assignment, and remains at 0.		
r1S	**[R1 Active at]**		[1] (POS)
	Configuration of the operating logic: ☐ **[1]** (POS): State 1 when the information is true ☐ **[0]** (nEG): State 0 when the information is true Configuration [1] (POS) cannot be modified for the [No drive flt] (FLt), assignment.		
r1H	**[R1 Holding time]**	0 to 9999 ms	0
	The change in state only takes effect once the configured time has elapsed, when the information becomes false. The holding time cannot be set for the [No drive flt] (FLt) assignment, and remains at 0.		
r2-	**[R2 CONFIGURATION]**		
r2	**[R2 Assignment]**		[No] (nO)
	Identical to R1 (see page 106) with the addition of (shown for information only as these selections can only be configured in the [1.7 APPLICATION FUNCT.] (Fun-)) menu: ☐ **[Brk control]** (bLC): Brake contactor control ☐ **[Input cont.]** (LLC): Line contactor control ☐ **[Output cont]** (OCC): Output contactor control ☐ **[End reel]** (EbO): End of reel(traverse control function) ☐ **[Sync. wobble]** (tSY): "Counter wobble" synchronization ☐ **[DC charging]** (dCO): DC bus precharging contactor control.		
r2d	**[R2 Delay time]**	0 to 60000 ms (1)	0
	The delay cannot be set for the [No drive flt] (FLt), [Brk control] (bLC), [Output cont.] (OCC), [DC charging] (dCO), and [Input cont.] (LLC) assignments, and remains at 0. The change in state only takes effect once the configured time has elapsed, when the information becomes true.		
r2S	**[R2 Active at]**		[1] (POS)
	Configuration of the operating logic: ☐ **[1]** (POS): State 1 when the information is true ☐ **[0]** (nEG): State 0 when the information is true The configuration [1] (POS) cannot be modified for the [No drive flt] (FLt), [Brk control] (bLC), [DC charging] (dCO), and [Input cont.] (LLC) assignments.		
r2H	**[R2 Holding time]**	0 to 9999 ms	0
	The holding time cannot be set for the [No drive flt] (FLt), [Brk control] (bLC), [DC charging] (dCO), and [Input cont] (LLC) assignments, and remains at 0. The change in state only takes effect once the configured time has elapsed, when the information becomes false.		

(1) 0 to 9999 ms then 10.00 to 60.00 s on the integrated display terminal.

Code	Name/Description	Adjustment range	Factory setting
r 3 -	**[R3 CONFIGURATION]** Can be accessed if a VW3A3201 option card has been inserted		
r 3	**[R3 Assignment]** Identical to R2		[No] (nO)
r 3 d	**[R3 Delay time]** The delay cannot be set for the [No drive flt] (FLt), [Brk control] (bLC), [Output cont.] (OCC), [DC charging] (dCO), and [Input cont.] (LLC) assignments, and remains at 0. The change in state only takes effect once the configured time has elapsed, when the information becomes true.	0 to 60000 ms (1)	0
r 3 S PoS nEG	**[R3 Active at]** Configuration of the operating logic: ☐ **[1]** (POS): State 1 when the information is true ☐ **[0]** (nEG): State 0 when the information is true The configuration [1] (POS) cannot be modified for the [No drive flt] (FLt), [Brk control] (bLC), [DC charging] (dCO), and [Input cont.] (LLC) assignments.		[1] (POS)
r 3 H	**[R3 Holding time]** The holding time cannot be set for the [No drive flt] (FLt), [Brk control] (bLC), [DC charging] (dCO), and [Input cont] (LLC) assignments, and remains at 0. The change in state only takes effect once the configured time has elapsed, when the information becomes false.	0 to 9999 ms	0
r 4 -	**[R4 CONFIGURATION]** Can be accessed if a VW3A3202 option card has been inserted		
r 4	**[R4 Assignment]** Identical to R2 (see page 107)		[No] (nO)
r 4 d	**[R4 Delay time]** The delay cannot be set for the [No drive flt] (FLt), [Brk control] (bLC), [Output cont.] (OCC), [DC charging] (dCO), and [Input cont.] (LLC) assignments, and remains at 0. The change in state only takes effect once the configured time has elapsed, when the information becomes true.	0 to 60000 ms (1)	0
r 4 S PoS nEG	**[R4 Active at]** Configuration of the operating logic: ☐ **[1]** (POS): State 1 when the information is true ☐ **[0]** (nEG): State 0 when the information is true The configuration [1] (POS) cannot be modified for the [No drive flt] (FLt), [Brk control] (bLC), [DC charging] (dCO), and [Input cont.] (LLC) assignments.		[1] (POS)
r 4 H	**[R4 Holding time]** The holding time cannot be set for the [No drive flt] (FLt), [Brk control] (bLC), [DC charging] (dCO), and [Input cont] (LLC) assignments, and remains at 0. The change in state only takes effect once the configured time has elapsed, when the information becomes false.	0 to 9999 ms	0

(1) 0 to 9999 ms then 10.00 to 60.00 s on the integrated display terminal.

Code	Name/Description	Adjustment range	Factory setting
Lo1-	**[LO1 CONFIGURATION]** Can be accessed if a VW3A3201 option card has been inserted		
Lo1	**[LO1 assignment]** Identical to R1 (see page 106) with the addition of (shown for information only as these selections can only be configured in the [1.7 APPLICATION FUNCT.] (Fun-)) menu: ☐ **[Brk control]** (bLC): Brake contactor control ☐ **[Input cont.]** (LLC): Line contactor control ☐ **[Output cont]** (OCC): Output contactor control ☐ **[End reel]** (EbO): End of reel(traverse control function) ☐ **[Sync. wobble]** (tSY): "Counter wobble" synchronization ☐ **[DC charging]** (dCO): DC bus precharging contactor control.		[No] (nO)
Lo1d	**[LO1 delay time]** The delay cannot be set for the [No drive flt] (FLt), [Brk control] (bLC), [Output cont.] (OCC), [DC charging] (dCO), and [Input cont.] (LLC) assignments, and remains at 0. The change in state only takes effect once the configured time has elapsed, when the information becomes true.	0 to 60000 ms (1)	0
Lo1S	**[LO1 active at]** Configuration of the operating logic: ☐ **[1]** (POS): State 1 when the information is true ☐ **[0]** (nEG): State 0 when the information is true The configuration [1] (POS) cannot be modified for the [No drive flt] (FLt), [Brk control] (bLC), [DC charging] (dCO), and [Input cont.] (LLC) assignments.		[1] (POS)
Lo1H	**[LO1 holding time]** The holding time cannot be set for the [No drive flt] (FLt), [Brk control] (bLC), [DC charging] (dCO), and [Input cont] (LLC) assignments, and remains at 0. The change in state only takes effect once the configured time has elapsed, when the information becomes false.	0 to 9999 ms	0
Lo2-	**[LO2 CONFIGURATION]** Can be accessed if a VW3A3201 option card has been inserted		
Lo2	**[LO2 assignment]** Identical to LO1.		[No] (nO)
Lo2d	**[LO2 delay time]** The delay cannot be set for the [No drive flt] (FLt), [Brk control] (bLC), [Output cont.] (OCC), [DC charging] (dCO), and [Input cont.] (LLC) assignments, and remains at 0. The change in state only takes effect once the configured time has elapsed, when the information becomes true.	0 to 60000 ms (1)	0
Lo2S	**[LO2 active at]** Configuration of the operating logic: ☐ **[1]** (POS): State 1 when the information is true ☐ **[0]** (nEG): State 0 when the information is true The configuration [1] (POS) cannot be modified for the [No drive flt] (FLt), [Brk control] (bLC), [DC charging] (dCO), and [Input cont.] (LLC) assignments.		[1] (POS)
Lo2H	**[LO2 holding time]** The holding time cannot be set for the [No drive flt] (FLt), [Brk control] (bLC), [DC charging] (dCO), and [Input cont] (LLC) assignments, and remains at 0. The change in state only takes effect once the configured time has elapsed, when the information becomes false.	0 to 9999 ms	0

(1)0 to 9999 ms then 10.00 to 60.00 s on the integrated display terminal.

Code	Name/Description	Adjustment range	Factory setting
LO3-	**[LO3 CONFIGURATION]** Can be accessed if a VW3A3202 option card has been inserted		
LO3	**[LO3 assignment]** Identical to LO1 (see page 109).		[No] (nO)
LO3d	**[LO3 delay time]** The delay cannot be set for the [No drive flt] (FLt), [Brk control] (bLC), [Output cont.] (OCC), [DC charging] (dCO), and [Input cont.] (LLC) assignments, and remains at 0. The change in state only takes effect once the configured time has elapsed, when the information becomes true.	0 to 60000 ms (1)	0
LO3S POS nEG	**[LO3 active at]** Configuration of the operating logic: ☐ **[1]** (POS): State 1 when the information is true ☐ **[0]** (nEG): State 0 when the information is true The configuration [1] (POS) cannot be modified for the [No drive flt] (FLt), [Brk control] (bLC), [DC charging] (dCO), and [Input cont.] (LLC) assignments.		[1] (POS)
LO3H	**[LO3 holding time]** The holding time cannot be set for the [No drive flt] (FLt), [Brk control] (bLC), [DC charging] (dCO), and [Input cont] (LLC) assignments, and remains at 0. The change in state only takes effect once the configured time has elapsed, when the information becomes false.	0 to 9999 ms	0
LO4-	**[LO4 CONFIGURATION]** Can be accessed if a VW3A3202 option card has been inserted		
LO4	**[LO4 assignment]** Identical to LO1 (see page 109).		[No] (nO)
LO4d	**[LO4 delay time]** The delay cannot be set for the [No drive flt] (FLt), [Brk control] (bLC), [Output cont.] (OCC), [DC charging] (dCO), and [Input cont.] (LLC) assignments, and remains at 0. The change in state only takes effect once the configured time has elapsed, when the information becomes true.	0 to 60000 ms (1)	0
LO4S POS nEG	**[LO4 active at]** Configuration of the operating logic: ☐ **[1]** (POS): State 1 when the information is true ☐ **[0]** (nEG): State 0 when the information is true The configuration [1] (POS) cannot be modified for the [No drive flt] (FLt), [Brk control] (bLC), [DC charging] (dCO), and [Input cont.] (LLC) assignments.		[1] (POS)
LO4H	**[LO4 holding time]** The holding time cannot be set for the [No drive flt] (FLt), [Brk control] (bLC), [DC charging] (dCO), and [Input cont] (LLC) assignments, and remains at 0. The change in state only takes effect once the configured time has elapsed, when the information becomes false.	0 to 9999 ms	0

(1) 0 to 9999 ms then 10.00 to 60.00 s on the integrated display terminal.

Use of analog output AO1 as a logic output

Analog output AO1 can be used as a logic output, by assigning DO1. In this case, when set to 0 this output corresponds to the AO1 min. value (0 V or 0 mA, for example), and when set to 1 to the AO1 max. value (10 V or 20 mA, for example).
The electrical characteristics of this analog output remain unchanged. As these differ from logic output characteristics, it is important to ensure that they are compatible with the intended application.


Code	Name/Description	Adjustment range	Factory setting
do 1-	**[DO1 CONFIGURATION]**		
do 1	**[DO1 assignment]**		[No] (nO)
	Identical to R1 (see page 106) with the addition of (shown for information only as these selections can only be configured in the [1.7 APPLICATION FUNCT.] (Fun-)) menu: ☐ **[Brk control]** (bLC): Brake contactor control ☐ **[Input cont.]** (LLC): Line contactor control ☐ **[Output cont]** (OCC): Output contactor control ☐ **[End reel]** (EbO): End of reel(traverse control function) ☐ **[Sync. wobble]** (tSY): "Counter wobble" synchronization ☐ **[DC charging]** (dCO): DC bus precharging contactor control.		
do 1d	**[DO1 delay time]**	0 to 60000 ms (1)	0
	The delay cannot be set for the [No drive flt] (FLt), [Brk control] (bLC), [Output cont.] (OCC), [DC charging] (dCO), and [Input cont.] (LLC) assignments, and remains at 0. The change in state only takes effect once the configured time has elapsed, when the information becomes true.		
do 1S	**[DO1 active at]**		[1] (POS)
	Configuration of the operating logic: ☐ **[1]** (POS): State 1 when the information is true ☐ **[0]** (nEG): State 0 when the information is true The configuration [1] (POS) cannot be modified for the [No drive flt] (FLt), [Brk control] (bLC), [DC charging] (dCO), and [Input cont.] (LLC) assignments.		
do 1H	**[DO1 holding time]**	0 to 9999 ms	0
	The holding time cannot be set for the [No drive flt] (FLt), [Brk control] (bLC), [DC charging] (dCO), and [Input cont] (LLC) assignments, and remains at 0. The change in state only takes effect once the configured time has elapsed, when the information becomes false.		


(1) 0 to 9999 ms then 10.00 to 60.00 s on the integrated display terminal.

Configuration of analog outputs

Minimum and maximum values (output values):


The minimum output value, in volts or mA, corresponds to the lower limit of the assigned parameter and the maximum value corresponds to its upper limit. The minimum value may be greater than the maximum value:

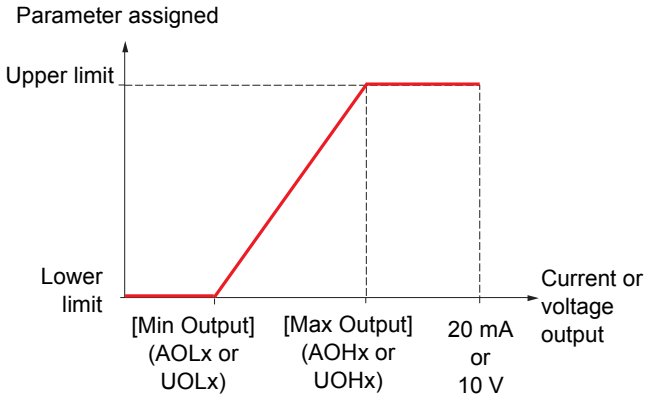

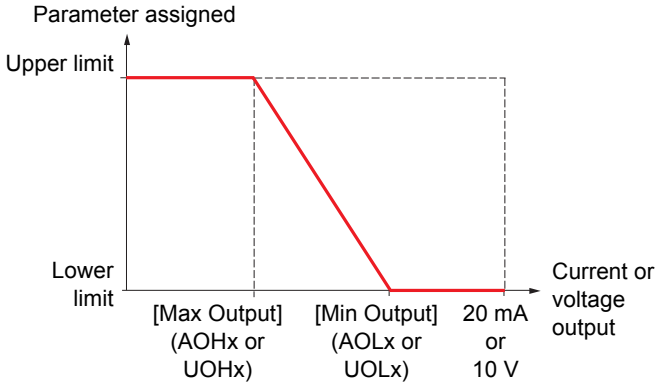

Outputs AO2 and AO3 configured as bipolar outputs (strongly recommended for signed parameters):

The [min Output] (UOLx) and [max Output] (UOHx) parameters are absolute values, although they function symmetrically. In the case of bipolar outputs, always set the maximum value higher than the minimum value.
The [max Output] (UOHx) corresponds to the upper limit of the assigned parameter, and the [min Output] (UOLx) corresponds to an average value between the upper and lower limits (0 for a signed and symmetrical parameter such as in the example below).

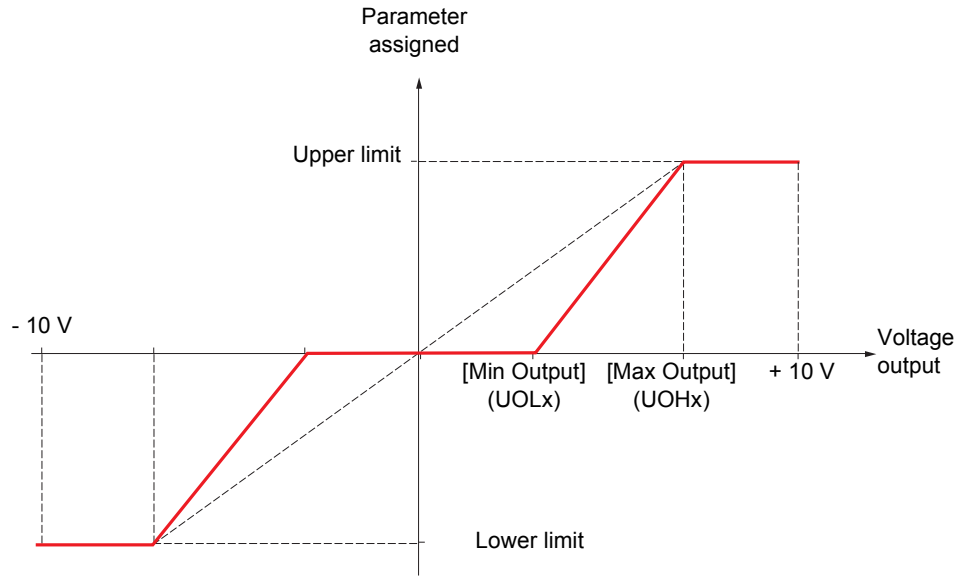


Scaling of the assigned parameter

The scale of the assigned parameter can be adapted in accordance with requirements by modifying the values of the lower and upper limits by means of two parameters for each analog output.
These parameters are given in %; 100% corresponds to the total variation range of the configured parameter, so:

- 100% = upper limit - lower limit For example, [Sign. torque] (Stq) which varies between -3 and +3 times the rated torque, 100% corresponds to 6 times the rated torque.

- The parameter [Scaling AOx min] (ASLx) modifies the lower limit: new value = lower limit + (range x ASLx). The value 0% (factory setting) does not modify the lower limit.
- The parameter [Scaling AOx max] (ASHx) modifies the upper limit: new value = lower limit + (range x ASLx). The value 100% (factory setting) does not modify the upper limit.
- [Scaling AOx min] (ASLx) must always be lower than [Scaling AOx max] (ASHx).

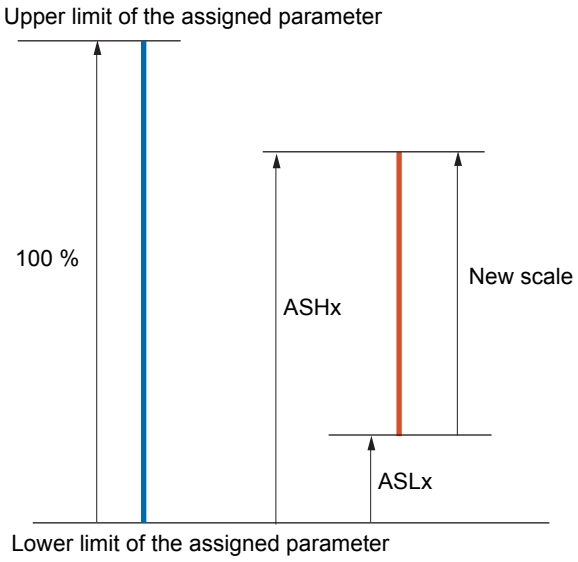

Application example 1

The value of the signed motor torque at the AO2 output is to be transferred with +/- 10 V, with a range of -2 Tr to +2 Tr.

The parameter [Sign. torque.] (Stq) varies between -3 and +3 times the rated torque, or a range of 6 times the rated torque.

[Scaling AO2 min] (ASL2) must modify the lower limit by 1x the rated torque, or 100/6 = 16.7% (new value = lower limit + (range x ASL2).

[Scaling AO2 max] (ASH2) must modify the upper limit by 1x the rated torque, or 100 - 100/6 = 83.3 % (new value = lower limit + (range x ASH2).

Application example 2

The value of the motor current at the AO2 output is to be transferred with 0 - 20 mA, range 2 In motor, In motor being the equivalent of a 0.8 In drive.

The parameter [I motor] (OCr) varies between 0 and 2 times the rated drive current, or a range of 2.5 times the rated drive current.

[Scaling AO2 min] (ASL2) must not modify the lower limit, which therefore remains at its factory setting of 0%.

[Scaling AO2 max] (ASH2) must modify the upper limit by 0.5x the rated motor torque, or 100 - 100/5 = 80 % (new value = lower limit + (range x ASH2).

Code	Name/Description	Adjustment range	Factory setting
AO1-	**[AO1 CONFIGURATION]**		
AO1	**[AO1 assignment]** ☐ **[No]** (nO): Not assigned ☐ **[I motor]** (OCr): Current in the motor, between 0 and 2 In (In = rated drive current indicated in the Installation Manual and on the drive nameplate). ☐ **[Motor freq.]** (OFr): Output frequency, from 0 to [Max frequency] (tFr) ☐ **[Ramp out.]** (OrP): From 0 to [Max frequency] (tFr) ☐ **[Motor torq.]** (trq): Motor torque, between 0 and 3 times the rated motor torque. ☐ **[Sign. torque]** (Stq): Signed motor torque, between -3 and +3 times the rated motor torque. The + sign corresponds to the motor mode and the - sign to the generator mode (braking). ☐ **[sign ramp]** (OrS) : Signed ramp output, between - [Max frequency] (tFr) and + [Max frequency] (tFr) ☐ **[PID ref.]** (OPS) : PID regulator reference between [Min PID reference] (PIP1) and [Max PID reference] (PIP2) ☐ **[PID feedback]** (OPF): PID regulator feedback between [Min PID feedback] (PIF1) and [Max PID feedback] (PIF2) ☐ **[PID error]** (OPE): PID regulator error between- 5 % and + 5 % of ([Max PID feedback] (PIF2) - [Min PID feedback] (PIF1)) ☐ **[PID Output]** (OPI) : PID regulator output between [Low speed] (LSP) and [High speed] (HSP) ☐ **[Mot. power]** (OPr): Motor power, between 0 and 2.5 times [Rated motor power] (nPr) ☐ **[Mot thermal]** (tHr): Motor thermal state, between 0 and 200% of the rated thermal state. ☐ **[Drv thermal]** (tHd): Drive thermal state, between 0 and 200% of the rated thermal state. ☐ **[Torque 4Q]** (tqMS) : Signed motor torque, between -3 and +3 times the rated motor torque. The + sign and the - sign correspond to the physical direction of the torque, regardless of mode (motor or generator). Example of usage: "master-slave" with the TORQUE CONTROL] (tOr-) function, page 187. ☐ **[Meas.mot.fr]** (OFrr): Measured motor speed. ☐ **[Sig. o/p frq.]** (OFS): Signed output frequency, between - [Max frequency] (tFr) and + [Max frequency] (tFr) ☐ **[Mot therm2]** (tHr2): Motor thermal state 2, between 0 and 200 % of the rated thermal state. ☐ **[Mot therm3]** (tHr3): Motor thermal state 3, between 0 and 200% of the rated thermal state. ☐ **[Uns. TrqRef]** (Utr): Torque reference, between 0 and 3 times the rated motor torque ☐ **[Uns. TrqRef]** (Utr): Signed torque reference, between - 3 and + 3 times the rated motor torque ☐ **[Torque lim.]** (tqL): Torque limit, between 0 and 3 times the rated motor torque ☐ **[Motor volt.]** (UOP): Voltage applied to the motor, between 0 and [Rated motor volt.] (UnS) ☐ **[dO1]** (dO1): Assignment to a logic output. This assignment can only appear if [DO1 assignment] (dO1) page 111 has been assigned. This is the only possible choice in this case, and is only displayed for informational purposes.		[No] (nO)
AO1t	**[AO1 Type]** ☐ **[Voltage]** (10U): **Voltage output** ☐ **[Current]** (0A): Current output		[Current] (0A)
AOL1	**[AO1 min Output]** The parameter can be accessed if [AO1 Type] (AO1t) = [Current] (0A)	0 to 20.0 mA	0 mA
AOH1	**[AO1 max Output]** The parameter can be accessed if [AO1 Type] (AO1t) = [Current] (0A)	0 to 20.0 mA	20.0 mA
UOL1	**[AO1 min Output]** The parameter can be accessed if [AO1 Type] (AO1t) = [Voltage] (10U)	0 to 10.0 V	0 V
UOH1	**[AO1 max Output]** The parameter can be accessed if [AO1 Type] (AO1t) = [Voltage] (10U)	0 to 10.0 V	10.0 V

Code	Name/Description	Adjustment range	Factory setting
AO1-	**[AO1 CONFIGURATION]** (continued)		
ASL1	❑ **[Scaling AO1 min]**	0 to 100.0 %	0 %
	Scaling of the lower limit of the assigned parameter, as a % of the maxiumum possible variation.		
ASH1	❑ **[Scaling AO1 max]**	0 to 100.0 %	100.0 %
	Scaling of the upper limit of the assigned parameter, as a % of the maxiumum possible variation.		
AO1F	❑ **[AO1 Filter]**	0 to 10.00 s	0 s
	Interference filtering. This parameter is forced to 0 if[AO1 asisgnment] (AO1) = [dO1] (dO1).		

Code	Name/Description	Adjustment range	Factory setting
AO2-	**[AO2 CONFIGURATION]** Can be accessed if a VW3A3202 option card has been inserted		
AO2	**[AO2 assignment]** Same assignments as AO1, without [dO1] (dO1).		[No] (nO)
AO2t 10U 0A n10U	**[AO2 Type]** ☐ **[Voltage]** (10U): **Voltage output** ☐ **[Current]** (0A): Current output ☐ **[Voltage +/-]** (n10U): Bipolar voltage output.		[Current] (0A)
AOL2	**[AO2 min Output]** The parameter can be accessed if [AO2 Type] (AO2t) = [Current] (0A)	0 to 20.0 mA	0 mA
AOH2	**[AO2 max Output]** The parameter can be accessed if [AO2 Type] (AO2t) = [Current] (0A)	0 to 20.0 mA	20.0 mA
uOL2	**[AO2 min Output]** The parameter can be accessed if [AO2 Type] (AO2t) = [Voltage] (10U) or [Voltage +/-] (n10U)	0 to 10.0 V	0 V
uOH2	**[AO2 max Output]** The parameter can be accessed if [AO2 Type] (AO2t) = [Voltage] (10U) or [Voltage +/-] (n10U)	0 to 10.0 V	10.0 V
ASL2	**[Scaling AO2 min]** Scaling of the lower limit of the assigned parameter, as a % of the maxiumum possible variation.	0 to 100.0 %	0 %
ASH2	**[Scaling AO2 max]** Scaling of the upper limit of the assigned parameter, as a % of the maxiumum possible variation.	0 to 100.0 %	100.0 %
AO2F	**[AO2 Filter]** Interference filtering.	0 to 10.00 s	0 s

Code	Name/Description	Adjustment range	Factory setting
AO3-	**[AO3 CONFIGURATION]** Can be accessed if a VW3A3202 option card has been inserted		
AO3	**[AO3 assignment]** Same assignments as AO1, without [dO1] (dO1).		[No] (nO)
AO3t 10U 0A n10U	**[AO3 Type]** ☐ **[Voltage]** (10U): **Voltage output** ☐ **[Current]** (0A): Current output ☐ **[Voltage +/-]** (n10U): Bipolar voltage output.		[Current] (0A)
AOL3	**[AO3 min Output]** The parameter can be accessed if [AO3 Type] (AO3t) = [Current] (0A)	0 to 20.0 mA	0 mA
AOH3	**[AO3 max Output]** The parameter can be accessed if [AO3 Type] (AO3t) = [Current] (0A)	0 to 20.0 mA	20.0 mA
uOL3	**[AO3 min Output]** The parameter can be accessed if [AO3 Type] (AO3t) = [Voltage] (10U) or [Voltage +/-] (n10U)	0 to 10.0 V	0 V
uOH3	**[AO3 max Output]** The parameter can be accessed if [AO3 Type] (AO3t) = [Voltage] (10U) or [Voltage +/-] (n10U)	0 to 10.0 V	10.0 V
ASL3	**[Scaling AO3 min]** Scaling of the lower limit of the assigned parameter, as a % of the maxiumum possible variation.	0 to 100.0 %	0 %
ASH3	**[Scaling AO3 max]** Scaling of the upper limit of the assigned parameter, as a % of the maxiumum possible variation.	0 to 100.0 %	100.0 %
AO3F	**[AO3 Filter]** Interference filtering.	0 to 10.00 s	0 s


[1.5 INPUTS / OUTPUTS CFG] (I-O-)

The following submenus group the alarms into 1 to 3 groups, each of which can be assigned to a relay or a logic output for remote signaling. These groups can also be displayed on the graphic display terminal (see [6 MONITORING CONFIG.] menu) and viewed via the [1.2 MONITORING] (SUP) menu.
When one or a number of alarms selected in a group occurs, this alarm group is activated.


Code	Name/Description	Adjustment range	Factory setting
A1C-	**[ALARM GRP1 DEFINITION]**		
	Selection to be made from the following list: ☐ **[LI6=PTC al.]** (PLA): LI6 = PTC probe alarm ☐ **[PTC1 alarm]** (P1A): Probe alarm 1 ☐ **[PTC2 alarm]** (P2A): Probe alarm 2 ☐ **[Ext. fault al.]** (EFA): External fault alarm ☐ **[Under V. al.]** (USA): Undervoltage alarm ☐ **[slipping al.]** (AnA): Slipping alarm ☐ **[I attained]** (CtA): Current threshold attained ([Current threshold] (Ctd) page 67) ☐ **[Freq.Th.att.]** (FtA): Frequency threshold attained ([Freq. threshold] (Ftd) page 68) ☐ **[Freq. Th. 2 attain.]** (F2A): Frequency threshold 2 attained ([Freq. Th. 2 attain] (F2d) page 68) ☐ **[Freq.ref.att]** (SrA): Frequency reference attained ☐ **[Th.mot. att.]** (tSA): Motor 1 thermal state attained ☐ **[Th.mot2 att]** (tS2): Motor 2 thermal state attained ☐ **[Th.mot3 att]** (tS3) : Motor 3 thermal state attained ☐ **[Uvolt warn]** (UPA): Undervoltage warning ☐ **[HSP attain.]** (FLA): High speed attained ☐ **[AI. °C drv]** (tHA): Drive overheating ☐ **[Load mvt al]** (bSA): Braking speed alarm ☐ **[Brk cont. al]** (bCA): Brake contact alarm ☐ **[PID error al]** (PEE): PID error alarm ☐ **[PID fdbk al.]** (PFA): PID feedback alarm ☐ **[AI2 AI. 4-20]** (AP2): Alarm indicating absence of 4-20 mA signal on input A12 ☐ **[AI3 AI. 4-20]** (AP3): Alarm indicating absence of 4-20 mA signal on input AI3 ☐ **[AI4 AI. 4-20]** (AP4): Alarm indicating absence of 4-20 mA signal on input AI4 ☐ **[Lim T/I att.]** (SSA): Torque limit alarm ☐ **[Th. drv. att.]** (tAd): Drive thermal state attained ☐ **[IGBT alarm]** (tJA): IGBT alarm ☐ **[Torque Control al.]** (rtA): Torque control alarm ☐ **[Brake R. al.]** (bOA): Braking resistor temperature alarm ☐ **[Option al.]** (APA): Alarm generated by an option card. ☐ **[Regen. underV. al.]** (UrA): Reserved. ☐ **[Rope slack alarm]** (rSdA) : Rope slack (see [Rope slack config.] (rSd) parameter page 176) ☐ **[High torque alarm]** (ttHA): Motor torque overshooting high threshold [High torque thd.] (ttH) page 67. ☐ **[Low torque alarm]** (ttLA) : Motor torque undershooting low threshold[Low torque thd.] (ttL) page 67. ☐ **[Freq. meter Alarm]** (FqLA) : Measured speed threshold attained: [Pulse warning thd.] (FqL) page 68. ☐ **[Dynamic load alarm]** (dLdA): Load variation detection (see[DYNAMIC LOAD DETECT.] (dLd-) page 241). See the multiple selection procedure on page 30 for the integrated display terminal, and page 21 for the graphic display terminal.		
A2C-	**[ALARM GRP2 DEFINITION]**		
	Identical to [ALARM GRP1 DEFINITION] (A1C-)		
A3C-	**[ALARM GRP3 DEFINITION]**		
	Identical to [ALARM GRP1 DEFINITION] (A1C-)		

[1.6 COMMAND] (CtL-)

With graphic display terminal:

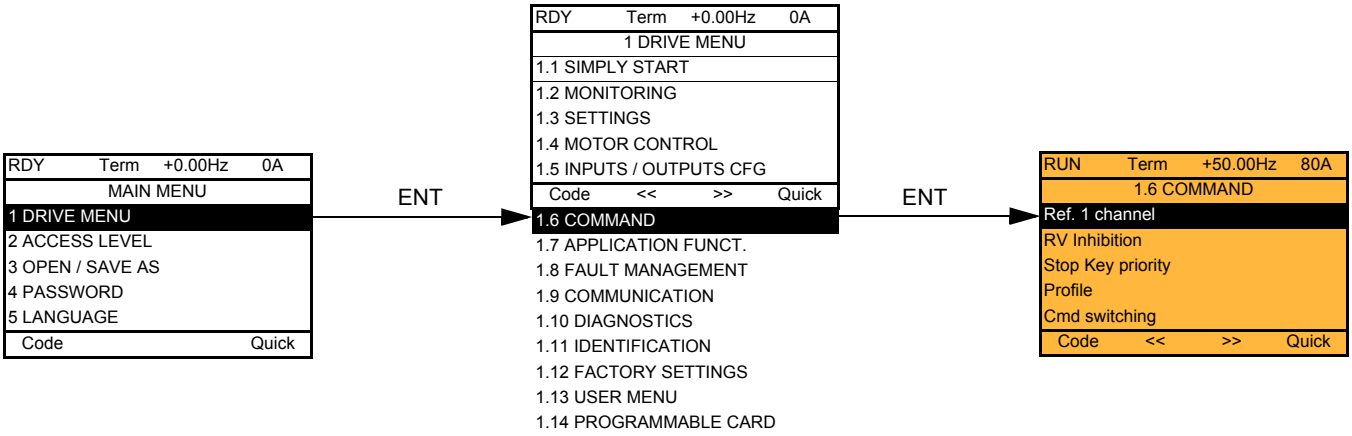

With integrated display terminal:

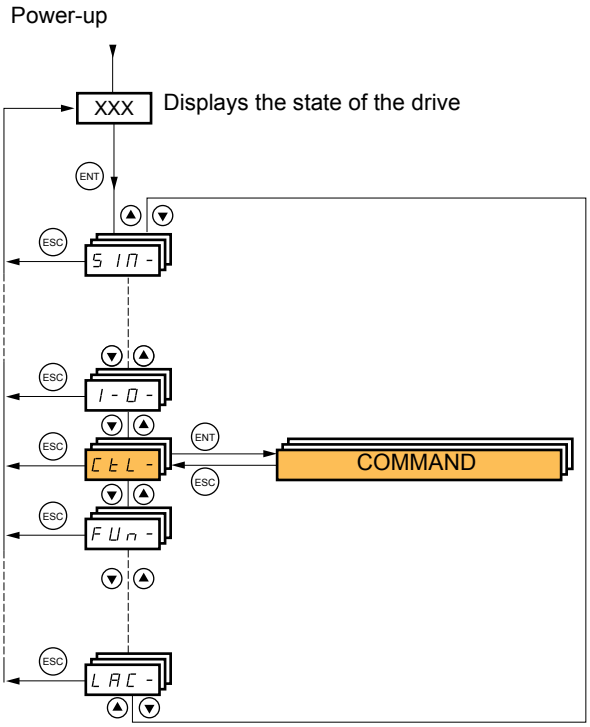

[1.6 COMMAND] (CtL-)

The parameters in the [1.6 COMMAND] (CtL) menu can only be modified when the drive is stopped and no run command is present.

Command and reference channels

Run commands (forward, reverse, stop, etc.) and references can be sent using the following channels:

Control	Reference
• Terminals: logic inputs LI • Graphic display terminal • Integrated Modbus • Integrated CANopen • Communication card • Controller Inside card	• Terminals: analog inputs AI, frequency input, encoder • Graphic display terminal • Integrated Modbus • Integrated CANopen • Communication card • Controller Inside card • +/- speed via the terminals • +/- speed via the graphic display terminal

The behavior of the Altivar 71 can be adapted according to requirements:

- [8 serie] (SE8): To replace an Altivar 58. See the Migration Manual.
- [Not separ.] (SIM): Command and reference are sent via the same channel.
- [Separate] (SEP): Command and reference may be sent via different channels.

In these configurations, control via the communication bus is performed in accordance with the DRIVECOM standard with only 5 freely-assignable bits (see Communication Parameters Manual). The application functions cannot be accessed via the communication interface.

- [I/O profile] (IO): The command and the reference can come from different channels. This configuration both simplifies and extends use via the communication interface.
  Commands may be sent via the logic inputs on the terminals or via the communication bus.
  When commands are sent via a bus, they are available on a word, which acts as virtual terminals containing only logic inputs.
  Application functions can be assigned to the bits in this word. More than one function can be assigned to the same bit.




Note: Stop commands from the terminals remain active even if the terminals are not the active command channel.



Note : The integrated Modbus channel has 2 physical communication ports:
- The Modbus network port
- The Modbus HMI port

The drive does not differentiate between these two ports, but recognizes the graphic display terminal irrespective of the port to which it is connected.

Reference channel for [Not separ.] (SIM), [Separate] (SEP) and [I/O profile] (IO) configurations, PID not configured

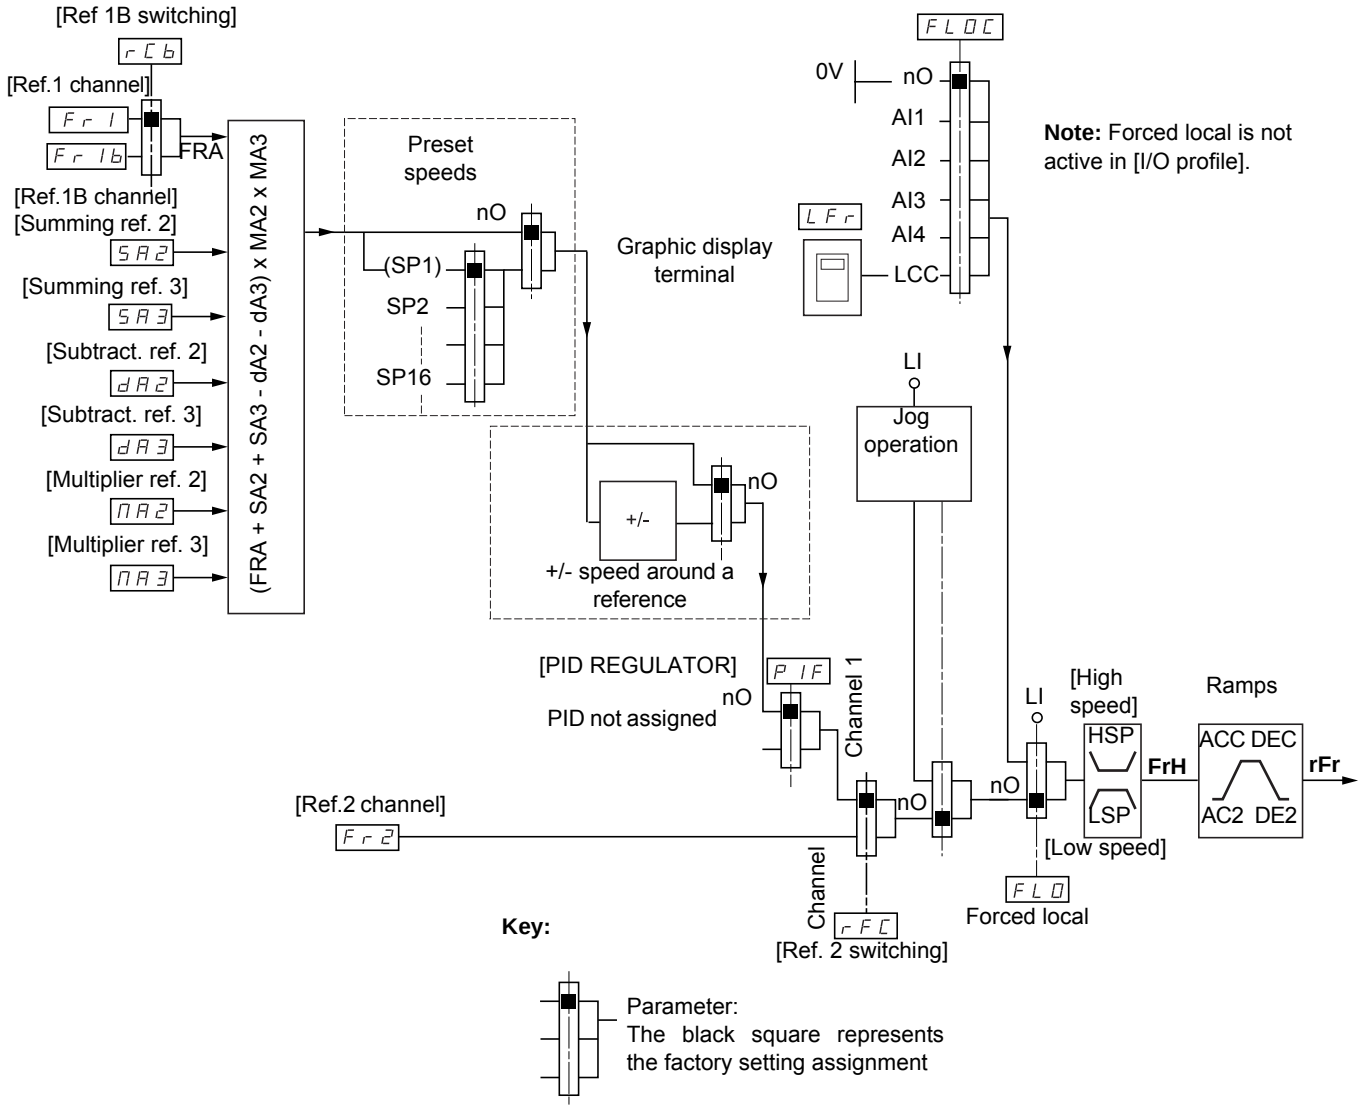

Instructions

Fr1, SA2, SA3, dA2, dA3, MA2, MA3:

- Terminals, graphic display terminal, integrated Modbus, integrated CANopen, communication card, Controller Inside card

Fr1b, for SEP and IO:

- Terminals, graphic display terminal, integrated Modbus, integrated CANopen, communication card, Controller Inside card

Fr1b, for SIM:


- Terminals, only accessible if Fr1 = terminals

Fr2:

- Terminals, graphic display terminal, integrated Modbus, integrated CANopen, communication card, Controller Inside card, **and +/- speed**

Note :[Ref.1B channel] (Fr1b) and [Ref 1B switching] (rCb) must be configured in the [1.7 APPLICATION FUNCT.] (Fun-) menu.

Reference channel for [Not separ.] (SIM), [Separate] (SEP) and [I/O profile] (IO) configurations, PID configured with PID references at the terminals

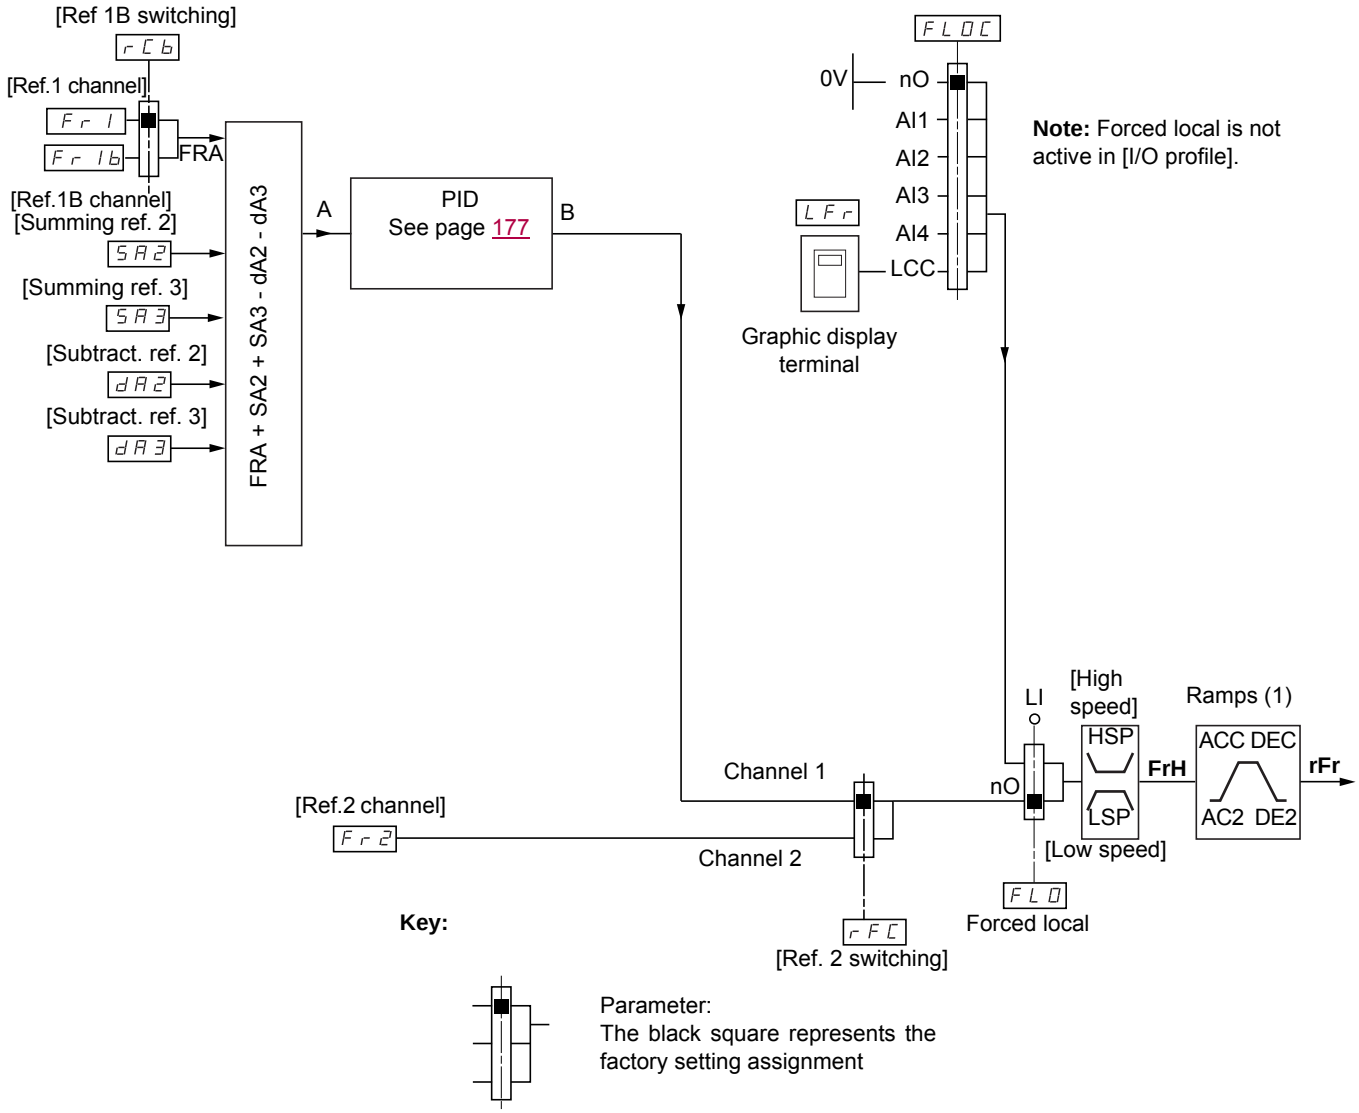

Instructions

Fr1:

- Terminals, graphic display terminal, integrated Modbus, integrated CANopen, communication card, Controller Inside card

Fr1b, for SEP and IO:

- Terminals, graphic display terminal, integrated Modbus, integrated CANopen, communication card, Controller Inside card

Fr1b, for SIM:

- Terminals, only accessible if Fr1 = terminals

SA2, SA3, dA2, dA3:

- Terminals only

Fr2:

- Terminals, graphic display terminal, integrated Modbus, integrated CANopen, communication card, Controller Inside card, **and +/- speed**

(1) Ramps not active if the PID function is active in automatic mode.


Note :[Ref.1B channel] (Fr1b) and [Ref 1B switching] (rCb) must be configured in the [1.7 APPLICATION FUNCT.] (Fun-) menu.

Command channel for [Not separ.] (SIM) configuration


Reference and command, not separate

The command channel is determined by the reference channel. Parameters Fr1, Fr2, rFC, FLO and FLOC are common to reference and command.

Example: if the reference is Fr1 = AI1 (analog input at the terminals), control is via LI (logic input at the terminals).

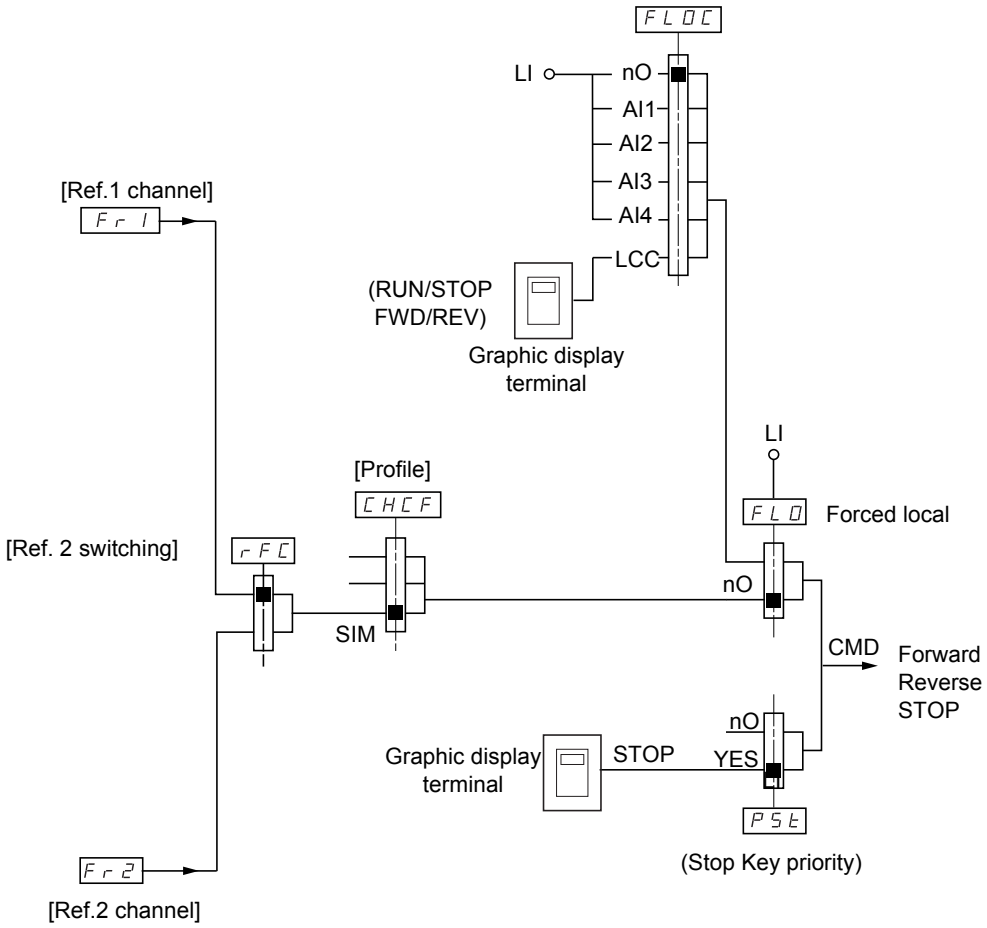

Key:



Parameter:
The black square represents
the factory setting assignment


Command channel for [Separate] (SEP) configuration

Separate reference and command


Parameters FLO and FLOC are common to reference and command.

Example: If the reference is in forced local mode via AI1 (analog input at the terminals), command in forced local mode is via LI (logic input at the terminals).

The command channels Cd1 and Cd2 are independent of the reference channels Fr1, Fr1b and Fr2.

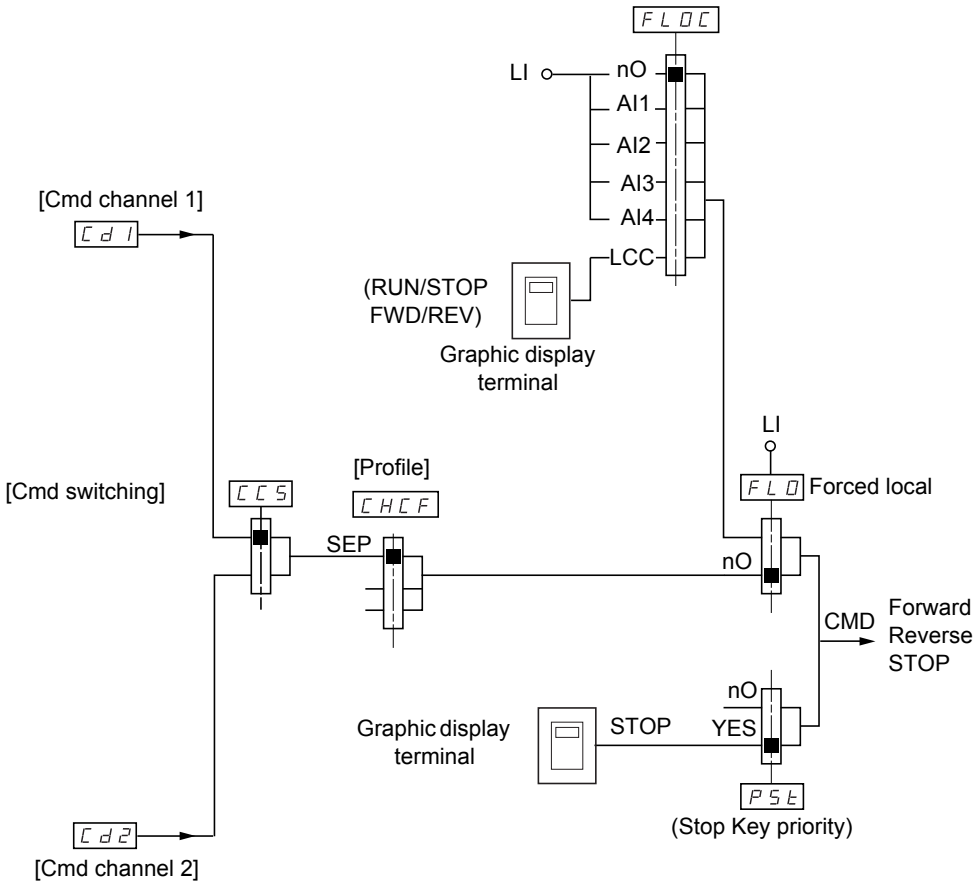

Key:



Parameter:
The black rectangle represents the factory setting assignment, except for [Profile].

Commands


Cd1, Cd2:

- Terminals, graphic display terminal, integrated Modbus, integrated CANopen, communication card, Controller Inside card


Command channel for [I/O profile] (IO) configuration

Separate reference and command, as in [Separate] (SEP) configuration

The command channels Cd1 and Cd2 are independent of the reference channels Fr1, Fr1b and Fr2.

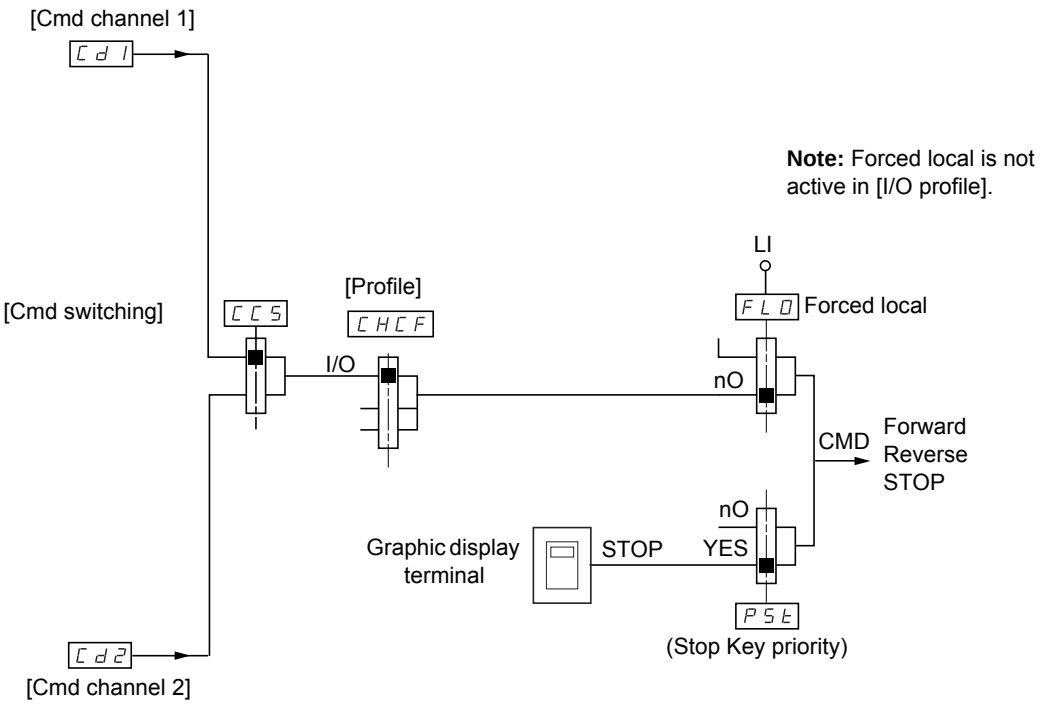

Key:



Parameter:
The black rectangle represents the factory setting assignment, except for [Profile].

Commands

Cd1, Cd2:

- Terminals, graphic display terminal, integrated Modbus, integrated CANopen, communication card, Controller Inside card

Command channel for [I/O profile] (IO) configuration

Selection of a command channel:

A command or an action can be assigned:

- To a fixed channel by selecting an LI input or a Cxxx bit:
  - By selecting e.g., LI3, this action will always be triggered by LI3 regardless of which command channel is switched.
  - By selecting e.g., C214, this action will always be triggered by integrated CANopen with bit 14 regardless of which command channel is switched.

- To a switchable channel by selecting a CDxx bit:
  - By selecting, e.g., CD11, this action will be triggered by
    LI12 if the terminals channel is active
    C111 if the integrated Modbus channel is active
    C211 if the integrated CANopen channel is active
    C311 if the communication card channel is active
    C411 if the Controller Inside card channel is active

If the active channel is the graphic display terminal, the functions and commands assigned to CDxx switchable internal bits are inactive.

Note:

- CD14 and CD15 can only be used for switching between 2 networks. They do not have equivalent logic inputs.

Terminals	Integrated Modbus	Integrated CANopen	Communication card	Controller Inside card	Internal bit, can be switched
					CD00
LI2 (1)	C101 (1)	C201 (1)	C301 (1)	C401 (1)	CD01
LI3	C102	C202	C302	C402	CD02
LI4	C103	C203	C303	C403	CD03
LI5	C104	C204	C304	C404	CD04
LI6	C105	C205	C305	C405	CD05
LI7	C106	C206	C306	C406	CD06
LI8	C107	C207	C307	C407	CD07
LI9	C108	C208	C308	C408	CD08
LI10	C109	C209	C309	C409	CD09
LI11	C110	C210	C310	C410	CD10
LI12	C111	C211	C311	C411	CD11
LI13	C112	C212	C312	C412	CD12
LI14	C113	C213	C313	C413	CD13
-	C114	C214	C314	C414	CD14
-	C115	C215	C315	C415	CD15

(1) If [2/3 wire control] (tCC) page 92 = [3 wire] (3C), LI2, C101, C201, C301, and C401 cannot be accessed.

Assignment conditions for logic inputs and control bits

The following elements are available for every command or function that can be assigned to a logic input or a control bit:

[LI1] (LI1) to [LI6] (LI6)	Drive with or without option
[LI7] (LI7) to [LI10] (LI10)	With VW3A3201 logic I/O card
[LI11] (LI11) to [LI14] (LI14)	With VW3A3202 extended I/O card
[C101] (C101) to [C110] (C110)	With integrated Modbus in [I/O profile] (IO) configuration
[C111] (C111) to [C115] (C115)	With integrated Modbus regardless of configuration
[C201] (C201) to [C210] (C210)	With integrated CANopen in [I/O profile] (IO) configuration
[C211] (C211) to [C215] (C215)	With integrated CANopen regardless of configuration
[C301] (C301) to [C310] (C310)	With a communication card in [I/O profile] (IO) configuration
[C311] (C311) to [C315] (C315)	With a communication card regardless of configuration
[C401] (C401) to [C410] (C410)	With Controller Inside card in [I/O profile] (IO) configuration
[C411] (C411) to [C415] (C415)	With Controller Inside card regardless of configuration
[CD00] (Cd00) to [CD10] (Cd10)	In [I/O profile] (IO) configuration
[CD11] (Cd11) to [CD15] (Cd15)	Regardless of configuration

Note : In [I/O profile] (IO) configuration, LI1 cannot be accessed and if [2/3 wire control] (tCC) page 92 = [3 wire] (3C), LI2, C101, C201, C301 and C401 cannot be accessed either.

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION

Inactive communication channels are not monitored (no lock following malfunction in the event of a communication bus failure). Make sure that the commands and functions assigned to bits C101 to C415 will not pose a risk in the event of the failure of the associated communication bus.

Failure to follow these instructions can result in death or serious injury.

Code	Name/Description	Adjustment range	Factory setting
Fr1	❑ **[Ref.1 channel]**		[AI1] (AI1)
AI1	☐ **[AI1]** (AI1): Analog input		
AI2	☐ **[AI2]** (AI2): Analog input		
AI3	☐ **[AI3]** (AI3): Analog input, if VW3A3202 extension card has been inserted		
AI4	☐ **[AI4]** (AI4): Analog input, if VW3A3202 extension card has been inserted		
LCC	☐ **[HMI]** (LCC): Graphic display terminal		
Mdb	☐ **[Modbus]** (Mdb): Integrated Modbus		
CAn	☐ **[CANopen]** (CAn): Integrated CANopen		
nEt	☐ **[Com. card]** (nEt): Communication card (if inserted)		
APP	☐ **[C.Insid. card]** (APP): Controller Inside card (if inserted)		
PI	☐ **[RP]** (PI): Frequency input, if VW3A3202 extension card has been inserted,		
PG	☐ **[Encoder]** (PG): Encoder input, if encoder card has been inserted		
rin	❑ **[RV Inhibition]**		[No] (nO)
nO	☐ **[No]** (nO)		
YES	☐ **[Yes]** (YES) Inhibition of movement in reverse direction, does not apply to direction requests sent by logic inputs. - Reverse direction requests sent by logic inputs are taken into account. - Reverse direction requests sent by the graphic display terminal are not taken into account. - Reverse direction requests sent by the line are not taken into account. - Any reverse speed reference originating from the PID, summing input, etc, will stop the motor.		
PSt	❑ **[Stop Key priority]**		[Yes] (YES)
nO	☐ **[No]** (nO)		
YES	☐ **[Yes]** (YES): Gives priority to the STOP key on the graphic display terminal when the graphic display terminal is not enabled as the command channel. Press and hold down ENT for 2 seconds in order for any change in the assignment of [Stop Key priority] (PSt) to be taken into account. This will be a freewheel stop. If the active command channel is the graphic display terminal, the stop will be performed according to the [Type of stop] (Stt) page 144 irrespective of the configuration of [Stop Key priority] (PSt).		
CHCF	❑ **[Profile]**		[Not separ.] (SIM)
SE8	☐ **[8 serie]** (SE8): ATV58 interchangeability (see Migration Manual). The[8 serie] (SE8) configuration is used to load, via PC-Software, for example, an ATV58 drive configuration in an ATV71 that has already been set to this configuration.This assignment cannot be accessed if a Controller Inside card has been inserted. ☞ **Note:** Modifications to the configuration of the ATV71 must only be made using PC-Software when it is in this configuration, otherwise operation cannot be guaranteed.		
SIM	☐ **[Not separ.]** (SIM): Reference and command, not separate		
SEP	☐ **[Separate]** (SEP): Separate reference and command. This assignment cannot be accessed in [I/O profile] (IO).		
IO	☐ **[I/O profile]** (IO): I/O profile When [8 serie] (SE8) is selected and [I/O profile] (IO) is deselected, the drive automatically returns to the factory setting (this is mandatory). This factory setting only affects the [1 DRIVE MENU] menu. It does not affect either [1.9 COMMUNICATION] or [1.5 PROGRAMMABLE CARD]. - With the graphic display terminal, a screen appears to perform this operation. Follow the instructions on the screen. - With the integrated display terminal, press ENT and hold it down (for 2 s). This will save the selection and return to the factory setting.		

[1.6 COMMAND] (CtL-)

Code	Name/Description	Adjustment range	Factory setting
CCS	**❑ [Cmd switching]** The parameter can be accessed if [Profile] (CHCF) = [Separate] (SEP) or [I/O profile] (IO) ☐ **[ch1 active]** (Cd1): [Cmd channel 1] (Cd1) active (no switching) ☐ **[ch2 active]** (Cd2): [Cmd channel 2] (Cd2) active (no switching) ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127 (not CDOO to CD14). If the assigned input or bit is at 0, channel [Cmd channel 1] (Cd1) is active. If the assigned input or bit is at 1, channel [Cmd channel 2] (Cd2) is active.		[ch1 active] (Cd1)
Cd1 tEr LCC Mdb CAn nEt APP	**❑ [Cmd channel 1]** ☐ **[Terminals]** (tEr): Terminals ☐ **[HMI]** (LCC): Graphic display terminal ☐ **[Modbus]** (Mdb): Integrated Modbus ☐ **[CANopen]** (CAn): Integrated CANopen ☐ **[Com. card]** (nEt): Communication card (if inserted) ☐ **[C.Insid. card]** (APP): Controller Inside card (if inserted) The parameter is available if [Profile] (CHCF) = [Separate] (SEP) or [I/O profile] (IO).		[Terminals] (tEr)
Cd2 tEr LCC Mdb CAn nEt APP	**❑ [Cmd channel 2]** ☐ **[Terminals]** (tEr): Terminals ☐ **[HMI]** (LCC): Graphic display terminal ☐ **[Modbus]** (Mdb): Integrated Modbus ☐ **[CANopen]** (CAn): Integrated CANopen ☐ **[Com. card]** (nEt): Communication card (if inserted) ☐ **[C.Insid. card]** (APP): Controller Inside card (if inserted) The parameter is available if [Profile] (CHCF) = [Separate] (SEP) or [I/O profile] (IO).		[Modbus] (Mdb)
rFC Fr1 Fr2 LI1 - - -	**❑ [Ref. 2 switching]** ☐ **[ch1 active]** (Fr1): no switching, [Ref.1 channel] (Fr1) active ☐ **[ch2 active]** (Fr2): no switching, [Ref.2 channel] (Fr2) active ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127 (not CDOO to CD14). If the assigned input or bit is at 0, channel [Ref.1 channel] (Fr1) is active. If the assigned bit or input is at 1, channel [Ref.2 channel] (Fr2) is active.		[ch1 active] (Fr1)
Fr2 no AI1 AI2 AI3 AI4 UPdt LCC Mdb CAn nEt APP PI PG	**❑ [Ref.2 channel]** ☐ **[No]** (nO): Not assigned. If [Profile] (CHCF) = [Not separ.] (SIM) the command is at the terminals with a zero reference. If [Profile] (CHCF) = [Separate] (SEP) or [I/O profile] (IO) the reference is zero. ☐ **[AI1]** (AI1): Analog input ☐ **[AI2]** (AI2): Analog input ☐ **[AI3]** (AI3): Analog input, if VW3A3202 extension card has been inserted ☐ **[AI4]** (AI4): Analog input, if VW3A3202 extension card has been inserted ☐ **[+/- Speed]** (UPdt) : +/- Speed command ☐ **[HMI]** (LCC): Graphic display terminal ☐ **[Modbus]** (Mdb): Integrated Modbus ☐ **[CANopen]** (CAn): Integrated CANopen ☐ **[Com. card]** (nEt): Communication card (if inserted) ☐ **[C.Insid. card]** (APP): Controller Inside card (if inserted) ☐ **[RP]** (PI): Frequency input, if VW3A3202 extension card has been inserted ☐ **[Encoder]** (PG): Encoder input, if encoder card has been inserted		[No] (nO)

Code	Name/Description	Adjustment range	Factory setting
CoP	❏ **[Copy channel 1 <> 2]** Can be used to copy the current reference and/or the command by means of switching, in order to avoid speed surges, for example. If [Profile] (CHCF) page 128 = [Not separ.] (SIM) or [Separate] (SEP), copying will only be possible from channel 1 to channel 2. If [Profile] (CHCF) = [I/O profile] (IO), copying will be possible in both directions. nO **[No]** (nO): No copy SP **[Reference]** (SP): Copy reference Cd **[Command]** (Cd): Copy command ALL **[Cmd + ref.]** (ALL): Copy command and reference - A reference or a command cannot be copied to a channel on the terminals. - The reference copied is FrH (before ramp) unless the destination channel reference is set via +/- speed. In this case, the reference copied is rFr (after ramp). **⚠ WARNING** **UNINTENDED EQUIPMENT OPERATION** Copying the command and/or reference can change the direction of rotation. Check that this is safe. **Failure to follow these instructions can result in death or serious injury.**		[No] (nO)

[1.6 COMMAND] (CtL-)

As the graphic display terminal may be selected as the command and/or reference channel, its action modes can be configured.
The parameters on this page can only be accessed on the graphic display terminal, and not on the integrated display terminal.


Comments:

- The display terminal command/reference is only active if the command and/or reference channels from the terminal are active with the exception of [T/K] (command via the display terminal), which takes priority over these channels. Press [T/K] (command via the display terminal) again to revert control to the selected channel.
- Command and reference via the display terminal are impossible if the latter is connected to more than one drive.
- The JOG, preset speed and +/- speed functions can only be accessed if [Profile] (CHCF) = [Not separ.] (SIM).
- The preset PID reference functions can only be accessed if [Profile] (CHCF) = [Not separ.] (SIM) or [Separate] (SEP)
- The [T/K] (command via the display terminal) can be accessed regardless of the [Profile] (CHCF).


Name/Description	Adjustment range	Factory setting
❏ **[F1 key assignment]**		[No]
☐ **[No]**: Not assigned ☐ **[Jog]** : JOG operation ☐ **[Preset spd2]**: Press the key to run the drive at the 2nd preset speed [Preset speed 2] (SP2) page 151. Press STOP to stop the drive. ☐ **[Preset spd3]**: Press the key to run the drive at the 3rd preset speed [Preset speed 3] (SP3) page 151. Press STOP to stop the drive. ☐ **[PID ref. 2]**: Sets a PID reference equal to the 2nd preset PID reference [Preset ref. PID 2] (rP2) page 185, without sending a run command. Only operates if [Ref.1 channel] (Fr1) = [HMI] (LCC). Does not operate with the [T/K] function. ☐ **[PID ref. 3]** : Sets a PID reference equal to the 3rd preset PID reference [Preset ref. PID 3] (rP3) page 185, without sending a run command. Only operates if [Ref.1 channel] (Fr1) = [HMI] (LCC). Does not operate with the [T/K] function. ☐ **[+speed]**: Faster, only operates if [Ref.2 channel] (Fr2) = [HMI] (LCC). Press the key to run the drive and increase the speed. Press STOP to stop the drive. ☐ **[- speed]**: Slower, only operates if [Ref.2 channel] (Fr2) = [HMI] (LCC) and if a different key has been assigned to [+ speed]. Press the key to run the drive and decrease the speed. Press STOP to stop the drive. ☐ **[T/K]**: Command via the display terminal: takes priority over[Cmd switching] (CCS) and over [Ref. 2 switching] (rFC).		
❏ **[F2 key assignment]** Identical to [F1 key assignment].		[No]
❏ **[F3 key assignment]** Identical to [F1 key assignment].		[No]
❏ **[F4 key assignment]** Identical to [F1 key assignment].		[No]
❏ **[HMI cmd.]** When the [T/K] function is assigned to a key and that function is active, this parameter defines the behavior at the moment when control returns to the graphic display terminal. ☐ **[Stop]** : Stops the drive (although the controlled direction of operation and reference of the previous channel are copied (to be taken into account on the next RUN command)). ☐ **[Bumpless]**: Does not stop the drive (the controlled direction of operation and the reference of the previous channel are copied).		[Stop]

[1.7 APPLICATION FUNCT.] (FUn-)

With graphic display terminal:

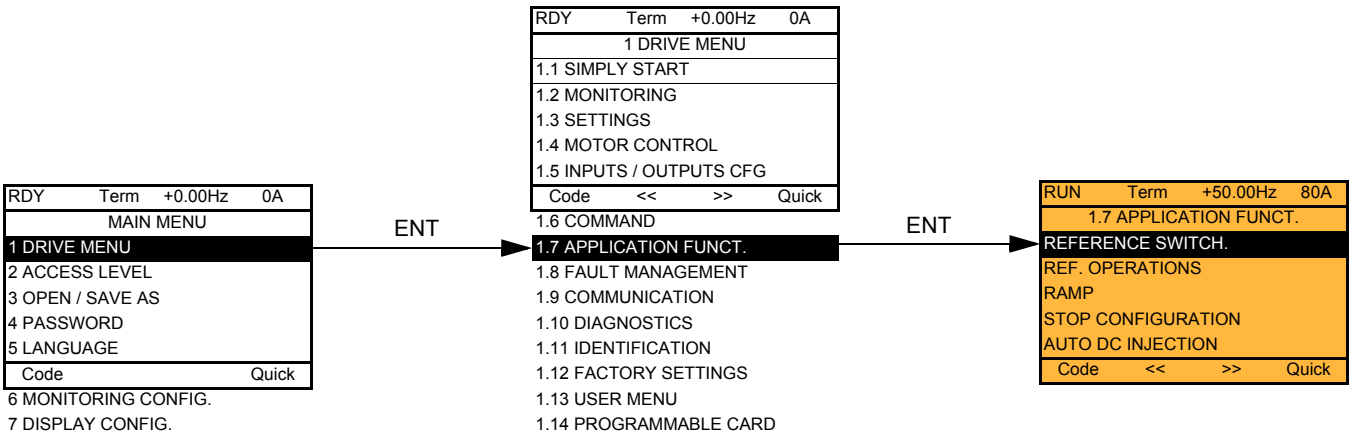

With integrated display terminal:

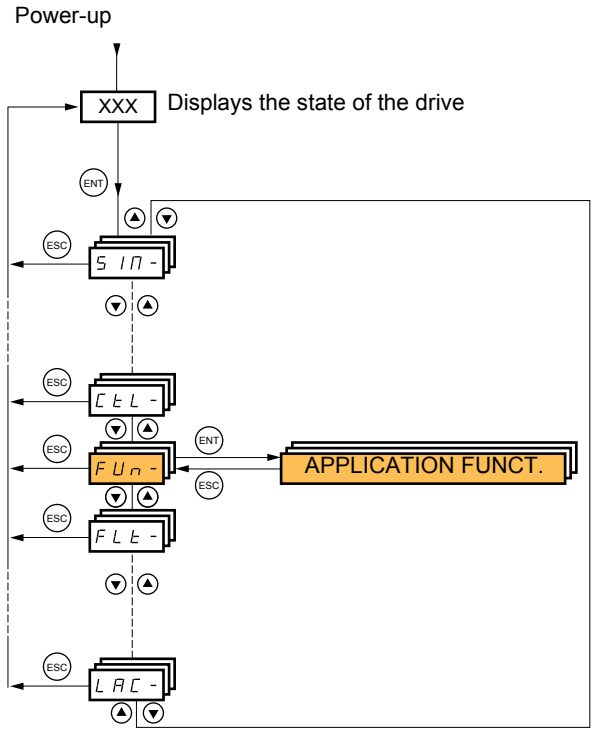

Summary of functions:

Code	Name	Page
rEF-	[REFERENCE SWITCH.]	138
oAI-	[REF. OPERATIONS]	139
rPt-	[RAMP]	140
Stt-	[STOP CONFIGURATION]	144
AdC-	[AUTO DC INJECTION]	146
JoG-	[JOG]	148
PSS-	[PRESET SPEEDS]	150
uPd-	[+/- SPEED]	153
SrE-	[+/-SPEED AROUND REF.]	155
SPM-	[MEMO REFERENCE]	156
FLI-	[FLUXING BY LI]	157
LSt-	[LIMIT SWITCHES]	159
bLC-	[BRAKE LOGIC CONTROL]	164
ELM-	[EXTERNAL WEIGHT MEAS.]	171
HSH-	[HIGH SPEED HOISTING]	176
PId-	[PID REGULATOR]	181
PrI-	[PID PRESET REFERENCES]	185
tor-	[TORQUE CONTROL]	187
toL-	[TORQUE LIMITATION]	190
CLI-	[2nd CURRENT LIMIT.]	192
LLC-	[LINE CONTACTOR COMMAND]	194
oCC-	[OUTPUT CONTACTOR CMD]	196
LPo-	[POSITIONING BY SENSORS]	200
nLP-	[PARAM. SET SWITCHING]	203
nMC-	[MULTIMOTORS/CONFIG.]	208
tnL-	[AUTO TUNING BY LI]	208
tro-	[TRAVERSE CONTROL]	214
rFt-	[EVACUATION]	216
HFF-	[HALF FLOOR]	217
dCo-	[DC BUS SUPPLY]	218
AFE-	[REGEN CONNECTION]	219

[1.7 APPLICATION FUNCT.] (FUn-)

The parameters in the [1.7 APPLICATION FUNCT.] (FUn-) menu can only be modified when the drive is stopped and there is no run command, except for parameters with a ↻ symbol in the code column, which can be modified with the drive running or stopped.

☞ **Note: Compatibility of functions**
The choice of application functions may be limited by the number of I/O and by the fact that some functions are incompatible with one another. Functions that are not listed in the table below are fully compatible.
If there is an incompatibility between functions, the first function configured will prevent the others being configured.

Each of the functions on the following pages can be assigned to one of the inputs or outputs.
A single input can activate several functions at the same time (reverse and 2nd ramp for example), **The user must therefore ensure that these functions can be used at the same time.** It is only possible to assign one input to several functions at [Advanced] (AdU) and [Expert] (EPr) levels.

Before assigning a command, reference or function to an input or output, the user must make sure that this input or output has not already been assigned and that another input or output has not been assigned to an incompatible or undesirable function.
The drive factory setting or macro configurations automatically configure functions, **which may prevent other functions being assigned. It may be necessary to unconfigure one or more functions in order to be able to enable another.** Check the compatibility table below.

Compatibility table

	Reference operations (page 139)	+/- speed (3) (page 153)	Management of limit switches (page 159)	Preset speeds (page 150)	PID regulator (page 181)	Traverse control (page 214)	JOG operation (page 148)	Brake logic control (page 164)	Catch on the fly (page 226)	DC injection stop (page 144)	Fast stop (page 144)	Freewheel stop (page 144)	+/- speed around a reference (page 155)	High speed hoisting (page 176)	Torque control (page 187)	Load sharing (page 88)	Positioning by sensors (page 200)	Open-loop synchronous motor (page 76)
Reference operations (page 139)				↑	●(4)		↑								●(1)			
+/- speed (3) (page 153)						●	●								●(1)			
Management of limit switches (page 159)					●													
Preset speeds (page 150)	←						↑								●(1)			
PID regulator (page 181)	●(4)		●			●	●	●					●	●	●(1)	●	●	
Traverse control (page 214)		●			●		●						●	●	●(1)			
JOG operation (page 148)	←	●		←	●	●		●					●	●	●(1)			
Brake logic control (page 164)					●		●		●	●					●			●
Catch on the fly (page 226)								●							●(1)			
DC injection stop (page 144)								●			●(2)	↑						●
Fast stop (page 144)										●(2)		↑						
Freewheel stop (page 144)										←	←							
+/- speed around a reference (page 155)					●	●	●								●(1)			
High speed hoisting (page 176)					●	●	●								●			
Torque control (page 187)	●(1)	●(1)		●(1)	●(1)	●(1)	●(1)	●	●(1)				●(1)	●		●	●(1)	●
Load sharing (page 88)					●										●			
Positioning by sensors (page 200)					●										●(1)			
Open-loop synchronous motor (page 76)								●		●					●			

(1) Torque control and these functions are only incompatible while torque control mode is active.
(2) Priority is given to the first of these two stop modes to be activated.
(3) Excluding special application with reference channel Fr2 (see diagrams on pages 121 and 122).
(4) Only the multiplier reference is incompatible with the PID regulator.

● Incompatible functions Compatible functions Not applicable

Priority functions (functions, which cannot be active at the same time):

← ↑ The function indicated by the arrow has priority over the other.

Stop functions have priority over run commands.
Speed references via logic command have priority over analog references.

Note: This compatibility table does not affect commands that can be assigned to the keys of the graphic display terminal (see page 131).

Incompatible functions

The following functions will be inaccessible or deactivated in the cases described below:

Automatic restart

This is only possible for control type [2/3 wire control] (tCC) = [2 wire] (2C) and [2 wire type] (tCt) = [Level] (LEL) or [Fwd priority] (PFO). See page 92.

Catch a spinning load

This is only possible for control type [2/3 wire control] (tCC) = [2 wire] (2C) and [2 wire type] (tCt) = [Level] (LEL) or [Fwd priority] (PFO). See page 92.
This function is locked if automatic injection on stop [Auto DC injection] (AdC) = [Continuous] (Ct). See page 146.

The SUP- monitoring menu (page 45) can be used to display the functions assigned to each input in order to check their compatibility.

When a function is assigned, a ✓ appears on the graphic display terminal, as illustrated in the example below:

RDY Term +0.00Hz 0A	
1.7 APPLICATION FUNCT.	
REFERENCE SWITCH.	
REF. OPERATIONS	
RAMP	✓
STOP CONFIGURATION	
AUTO DC INJECTION	
Code << >>	Quick

JOG

If you attempt to assign a function that is incompatible with another function that has already been assigned, an alarm message will appear:

With the graphic display terminal:


RDY Term +0.00Hz 0A
INCOMPATIBILITY
The function can't be assigned because an incompatible function is already selected. See programming book.
ENT or ESC to continue

With the integrated display terminal:
COMP flashes until ENT or ESC is pressed.


When you assign a logic input, an analog input, a reference channel or a bit to a function, pressing the HELP button will display the functions that may already have been activated by this input, bit or channel.

When a logic input, an analog input, a reference channel or a bit that has already been assigned is assigned to another function, the following screens appear:

With the graphic display terminal:

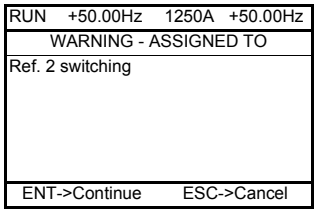


If the access level permits this new assignment, pressing ENT confirms the assignment.
If the access level does not permit this new assignment, pressing ENT results in the following display:

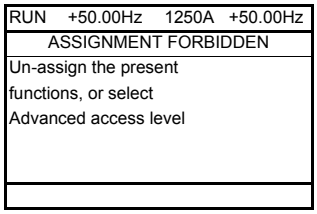

With the integrated display terminal:

The code for the first function, which is already assigned, is displayed flashing.
If the access level permits this new assignment, pressing ENT confirms the assignment.
If the access level does not permit this new assignment, pressing ENT has no effect, and the message continues to flash. It is only possible to exit by pressing ESC.

Summing input/Subtracting input/Multiplier



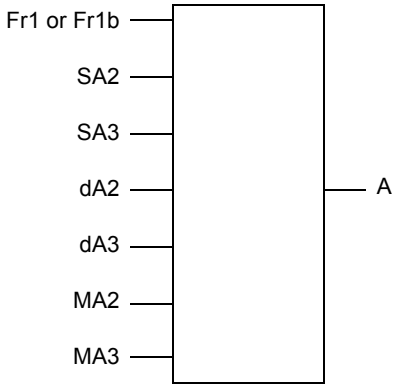


A = (Fr1 or Fr1b + SA2 + SA3 - dA2 - dA3) x MA2 x MA3

- If SA2, SA3, dA2, dA3 are not assigned, they are set to 0.
- If MA2, MA3 are not assigned, they are set to 1.
- A is limited by the minimum LSP and maximum HSP parameters.
- For multiplication, the signal on MA2 or MA3 is interpreted as a %; 100% corresponds to the maximum value of the corresponding input. If MA2 or MA3 is sent via the communication bus or graphic display terminal, an MFr multiplication variable, page 51 must be sent via the bus or graphic display terminal.
- Reversal of the direction of operation in the event of a negative result can be inhibited (see page 128).

Code	Name/Description	Adjustment range	Factory setting
rEF-	**[REFERENCE SWITCH.]**		
rCb	**[Ref 1B switching]** See the diagrams on pages 121 and 122. ☐ **[ch1 active]** (Fr1): no switching, [Ref.1 channel] (Fr1) active ☐ **[ch1B active]** (Fr1b): no switching, [Ref.1B channel] (Fr1b) active ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127 (not CDOO to CD14). • If the assigned input or bit is at 0, [Ref.1 channel] (Fr1) is active (see page 128). • If the assigned input or bit is at 1, [Ref.1B channel] (Fr1b) is active. [Ref 1B switching] (rCb) is forced to [ch1 active] (Fr1) if [Profile] (CHCF) = [Not separ.] (SIM) with [Ref.1 channel] (Fr1) assigned via the terminals (analog inputs, encoder, pulse input); see page 128.		[ch1 active] (Fr1)
Fr1b	**[Ref.1B channel]** ☐ **[No]** (nO): Not assigned ☐ **[AI1]** (AI1): Analog input ☐ **[AI2]** (AI2): Analog input ☐ **[AI3]** (AI3): Analog input, if VW3A3202 extension card has been inserted ☐ **[AI4]** (AI4): Analog input, if VW3A3202 extension card has been inserted ☐ **[HMI]** (LCC): Graphic display terminal ☐ **[Modbus]** (Mdb): Integrated Modbus ☐ **[CANopen]** (CAn): Integrated CANopen ☐ **[Com. card]** (nEt): Communication card (if inserted) ☐ **[C.Insid. card]** (APP): Controller Inside card (if inserted) ☐ **[RP]** (PI): Frequency input, if VW3A3202 extension card has been inserted ☐ **[Encoder]** (PG): Encoder input, if encoder card has been inserted **Note**: In the following instances, only assignments via the terminals are possible: - [Profile] (CHCF) = [Not separ.] (SIM) with [Ref.1 channel] (Fr1) assigned via the terminals (analog inputs, encoder, pulse input); see page 128. - PID configured with PID references via the terminals		[No] (nO)

Code	Name/Description	Adjustment range	Factory setting
oA1-	**[REF. OPERATIONS]** Reference = (Fr1 or Fr1b + SA2 + SA3 - dA2 - dA3) x MA2 x MA3. See the diagrams on pages 121 and 122. **Note:** This function cannot be used with certain other functions. Follow the instructions on page 133.		
SA2	❑ **[Summing ref. 2]** Selection of a reference to be added to [Ref.1 channel] (Fr1) or [Ref.1B channel] (Fr1b). ☐ **[No]** (nO): No source assigned ☐ **[AI1]** (AI1): Analog input ☐ **[AI2]** (AI2): Analog input ☐ **[AI3]** (AI3): Analog input, if VW3A3202 extension card has been inserted ☐ **[AI4]** (AI4): Analog input, if VW3A3202 extension card has been inserted ☐ **[HMI]** (LCC): Graphic display terminal ☐ **[Modbus]** (Mdb): Integrated Modbus ☐ **[CANopen]** (CAn): Integrated CANopen ☐ **[Com. card]** (nEt): Communication card (if inserted) ☐ **[C.Insid. card]** (APP): Controller Inside card (if inserted) ☐ **[RP]** (PI): Frequency input, if VW3A3202 extension card has been inserted ☐ **[Encoder]** (PG): Encoder input, if encoder card has been inserted ☐ **[Network AI]** (AIU1): Virtual input via communication bus, can be configured using [AI net. channel] (AIC1) page 101. **⚠ WARNING** **UNINTENDED EQUIPMENT OPERATION** If the equipment switches to forced local mode (see page 248), the virtual input remains fixed at the last value transmitted. Do not use the virtual input and forced local mode in the same configuration. **Failure to follow these instructions can result in death or serious injury.**	[No] (nO)	
SA3	❑ **[Summing ref. 3]** Selection of a reference to be added to [Ref.1 channel] (Fr1) or [Ref.1B channel] (Fr1b). • Possible assignments are identical to [Summing ref. 2] (SA2) above.	[No] (nO)	
dA2	❑ **[Subtract. ref. 2]** Selection of a reference to be subtracted from [Ref.1 channel] (Fr1) or [Ref.1B channel] (Fr1b). • Possible assignments are identical to [Summing ref. 2] (SA2) above.	[No] (nO)	
dA3	❑ **[Subtract. ref. 3]** Selection of a reference to be subtracted from [Ref.1 channel] (Fr1) or [Ref.1B channel] (Fr1b). • Possible assignments are identical to [Summing ref. 2] (SA2) above.	[No] (nO)	
MA2	❑ **[Multiplier ref. 2]** Selection of a multiplier reference [Ref.1 channel] (Fr1) or [Ref.1B channel] (Fr1b). • Possible assignments are identical to [Summing ref. 2] (SA2) above.	[No] (nO)	
MA3	❑ **[Multiplier ref. 3]** Selection of a multiplier reference [Ref.1 channel] (Fr1) or [Ref.1B channel] (Fr1b). • Possible assignments are identical to [Summing ref. 2] (SA2) above.	[No] (nO)	

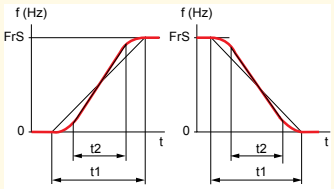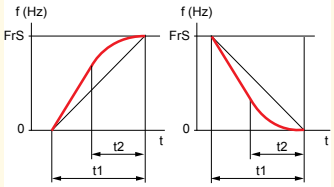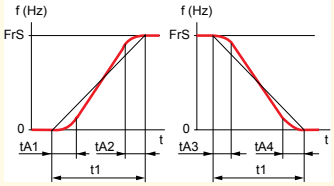Code	Name/Description	Adjustment range	Factory setting
rPt-	**[RAMP]**		
rPt LIn S U CUS	**[Ramp type]** ☐ **[Linear]** (LIn) ☐ **[S ramp]** (S) ☐ **[U ramp]** (U) ☐ **[Customized]** (CUS) S ramps  The rounding coefficient is fixed, where t2 = 0.6 x t1 and t1 = set ramp time. U ramps  The rounding coefficient is fixed, where t2 = 0.5 x t1 and t1 = set ramp time. Customized ramps  tA1: adjustable from 0 to 100% tA2: adjustable from 0 to (100% - tA1) tA3: adjustable from 0 to 100% tA4: adjustable from 0 to (100% - tA3) As a % of t1, where t1 = set ramp time		[Linear] (LIn)
Inr 0.01 0.1 1	**[Ramp increment]** (1) ☐ **[0,01]**: Ramp up to 99.99 seconds ☐ **[0,1]**: Ramp up to 999.9 seconds ☐ **[1]**: Ramp up to 6000 seconds This parameter is valid for [Acceleration] (ACC), [Deceleration] (dEC), [Acceleration 2] (AC2) and [Deceleration 2] (dE2).		[0,1] (0.1)
ACC	**[Acceleration]** (1) Time to accelerate from 0 to the [Rated motor freq.] (FrS) (page 70). Make sure that this value is compatible with the inertia being driven.	0.01 to 6000 s (2)	3.0 s
dEC	**[Deceleration]** (1) Time to decelerate from the [Rated motor freq.] (FrS) (page 70) to 0. Make sure that this value is compatible with the inertia being driven.	0.01 to 6000 s (2)	3.0 s

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.
(2) Range 0.01 to 99.99 s or 0.1 to 999.9 s or 1 to 6000 s according to [Ramp increment] (Inr).

Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting
	[RAMP] (continued)		
tA1	**[Begin Acc round]** (1) - Rounding of start of acceleration ramp as a % of the [Acceleration] (ACC) or [Acceleration 2] (AC2) ramp time. - Can be set between 0 and 100% - The parameter can be accessed if the [Ramp type] (rPt) is [Customized] (CUS).	0 to 100%	10%
tA2	**[End Acc round]** (1) - Rounding of end of acceleration ramp as a % of the [Acceleration] (ACC) or [Acceleration 2] (AC2) ramp time. - Can be set between 0 and (100% - [Begin Acc round] (tA1)) - The parameter can be accessed if the [Ramp type] (rPt) is [Customized] (CUS).		10%
tA3	**[Begin Dec round]** (1) - Rounding of start of deceleration ramp as a % of the [Deceleration] (dEC) or [Deceleration 2] (dE2) ramp time. - Can be set between 0 and 100% - The parameter can be accessed if the [Ramp type] (rPt) is [Customized] (CUS).	0 to 100%	10%
tA4	**[End Dec round]** (1) - Rounding of end of deceleration ramp as a % of the [Deceleration] (dEC) or [Deceleration 2] (dE2) ramp time. - Can be set between 0 and (100% - [Begin Dec round] (tA3)) - The parameter can be accessed if the [Ramp type] (rPt) is [Customized] (CUS).		10%

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-) menu.

Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting
	[RAMP] (continued)		
FrE	**[Ramp 2 threshold]**	0 to 500 or 599 Hz according to rating	0 Hz
	Ramp switching threshold The 2nd ramp is switched if the value of Frt is not 0 (0 deactivates the function) and the output frequency is greater than Frt. Threshold ramp switching can be combined with [Ramp switch ass.] (rPS) switching as follows: LI or bit / Frequency / Ramp: 0 / <Frt / ACC, dEC; 0 / >Frt / AC2, dE2; 1 / <Frt / AC2, dE2; 1 / >Frt / AC2, dE2		
rPS nO LI1 - - -	**[Ramp switch ass.]** ☐ **[No]** (nO): Not assigned ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. - ACC and dEC are enabled when the assigned input or bit is at 0. - AC2 and dE2 are enabled when the assigned input or bit is at 1.		[No] (nO)
AC2 ( )	**[Acceleration 2]** (1) Time to accelerate from 0 to the [Rated motor freq.] (FrS). Make sure that this value is compatible with the inertia being driven. The parameter can be accessed if [Ramp 2 threshold] (Frt) > 0 or if [Ramp switch ass.] (rPS) is assigned.	0.01 to 6000 s (2)	5.0 s
dE2 ( )	**[Deceleration 2]** (1) Time to decelerate from [Rated motor freq.] (FrS) to 0. Make sure that this value is compatible with the inertia being driven. The parameter can be accessed if [Ramp 2 threshold] (Frt) > 0 or if [Ramp switch ass.] (rPS) is assigned.	0.01 to 6000 s (2)	5.0 s

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.
(2) Range 0.01 to 99.99 s or 0.1 to 999.9 s or 1 to 6000 s according to [Ramp increment] (Inr) page 140.

( ) Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting
brA	❑ **[Dec ramp adapt.]**		[Yes] (YES)

Activating this function automatically adapts the deceleration ramp, if this has been set at too low a value for the inertia of the load, which can cause an overvoltage fault.

nO ☐ **[No]** (nO): Function inactive

YES ☐ **[Yes]** (YES): Function active, for applications that do not require strong deceleration.

The following selections appear depending on the rating of the drive and [Motor control type] (Ctt) page 73. They enable stronger deceleration to be obtained than with [Yes] (YES). Use comparative testing to determine your selection.

When [Dec ramp adapt.] (brA) is configured on [High torq. x] (dYnx), the dynamic performances for braking are improved by the addition of a current flow component. The aim is to increase the iron loss and magnetic energy stored in the motor.

dYnA ☐ **[High torq. A]** (dYnA): Addition of a constant current flow component.

dYnb ☐ **[High torq. B]** (dYnb): Addition of a current flow component oscillating at 100 Hz.

dYnC ☐ **[High torq. C]** (dYnC): Addition of a current flow component oscillating at 200 Hz but with a greater amplitude.

[Dec ramp adapt.] (brA) is forced to [No] (nO) if the brake logic control[Brake assignment] (bLC) is assigned (page 164), or if [Braking balance] (bbA) page 88 = [Yes] (YES). The factory setting changes to [High torq. A] (dYnA) with certain ratings if [Sinus filter] (OFI) page 84 = [Yes] (YES).

The function is incompatible with applications requiring:

- Positioning on a ramp
- The use of a braking resistor (the resistor would not operate correctly)

CAUTION

Do not use [High torq. A] (dYnA), [High torq. B] (dYnB) or [High torq. C] (dYnC) configurations if the motor is a permanent magnet synchronous motor, as it will be demagnetized.

Failure to follow this instruction can result in equipment damage.

Code	Name/Description	Adjustment range	Factory setting
StC-	**[STOP CONFIGURATION]** **Note:** Some types of stop cannot be used with all other functions. Follow the instructions on page 133.		
Stt rMP FSt nSt dCI	**[Type of stop]**		[Ramp stop] (rMP)
	Stop mode on disappearance of the run command or appearance of a stop command. ☐ **[Ramp stop]** (rMP): Stop on ramp. ☐ **[Fast stop]** (FSt): Fast stop ☐ **[Freewheel stop]** (nSt): Freewheel stop ☐ **[DC injection]** (dCI): DC injection stop **Note:** If the "brake logic" function on page 164 has been enabled, or if [Low speed time out] (tLS) page 62 or 184 is not 0, only ramp type stops may be configured.		
FFt ()	**[Freewheel stop Thd.]** (1)	0.0 to 599 Hz	0.0 Hz
	This parameter supports switching from a ramp stop or a fast stop to a freewheel stop below a low speed threshold. It can be accessed if [Type of stop] (Stt) = [Fast stop] (FSt) or [Ramp stop] (rMP). ☐ 0.0: Does not switch to freewheel stop. ☐ 0.1 to 599 Hz: Speed threshold below which the motor will switch to freewheel stop.		
nSt nO LI1 - - C101 - - - CD00 -	**[Freewheel stop ass.]**		[No] (nO)
	☐ **[No]** (nO): Not assigned ☐ **[LI1]** (LI1) to **[LI6]** (LI6) ☐ **[LI7]** (LI7) to **[LI10]** (LI10): If VW3A3201 logic I/O card has been inserted ☐ **[LI11]** (LI11) to **[LI14]** (LI14): If VW3A3202 extended I/O card has been inserted ☐ **[C101]** (C101) to **[C115]** (C115): With integrated Modbus in [I/O profile] (IO) ☐ **[C201]** (C201) to **[C215]** (C215): With integrated CANopen in [I/O profile] (IO) ☐ **[C301]** (C301) to **[C315]** (C315): With a communication card in [I/O profile] (IO) ☐ **[C401]** (C401) to **[C415]** (C415): With a Controller Inside card in [I/O profile] (IO) ☐ **[CD00]** (Cd00) to **[CD13]** (Cd13): In [I/O profile] can be switched with possible logic inputs ☐ **[CD14]** (Cd14) to **[CD15]** (Cd15): In [I/O profile] can be switched without logic inputs The stop is activated when the input or the bit changes to 0. If the input returns to state 1 and the run command is still active, the motor will only restart if [2/3 wire control] (tCC) page 92 = [2 wire] (2C) and the [2 wire type] (tCt) = [Level] (LEL) or [Fwd priority] (PFO). If not, a new run command must be sent.		
FSt nO LI1 - - -	**[Fast stop assign.]**		[No] (nO)
	Note: This function cannot be used with certain other functions. Follow the instructions on page 133. ☐ **[No]** (nO): Not assigned ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. The stop is activated when the input changes to 0 or the bit changes to 1 (bit in [I/O profile] (IO) at 0). If the input returns to state 1 and the run command is still active, the motor will only restart if [2/3 wire control] (tCC) page 92 = [2 wire] (2C) and the [2 wire type] (tCt) = [Level] (LEL) or [Fwd priority] (PFO). If not, a new run command must be sent.		
dCF ()	**[Ramp divider]** (1)	0 to 10	4
	The parameter can be accessed if [Type of stop] (Stt) = [Fast stop] (FSt) and if [Fast stop assign.] (FSt) is not [No] (nO). The ramp that is enabled (dEC or dE2) is then divided by this coefficient when stop requests are sent. Value 0 corresponds to a minimum ramp time.		

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.

() Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting
	[STOP CONFIGURATION] (continued)		
dC1	**[DC injection assign.]**		[No] (nO)
	Note: This function cannot be used with certain other functions. Follow the instructions on page 133.		
nO	☐ **[No]** (nO): Not assigned		
LI1 - - -	☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127.		
	DC injection braking is initiated when the assigned input or bit changes to state 1. If the input returns to state 1 and the run command is still active, the motor will only restart if [2/3 wire control] (tCC) page 92 = [2 wire] (2C) and [2 wire type] (tCt) = [Level] (LEL) or [Fwd priority] (PFO). If not, a new run command must be sent.		
IdC	**[DC inject. level 1]** (1) (3)	0.1 to 1.41 In (2)	0.64 In (2)
	Level of DC injection braking current activated via logic input or selected as stop mode. The parameter can be accessed if [Type of stop] (Stt) = [DC injection] (dCI) or if [DC injection assign.] (dCI) is not [No] (nO).		
	CAUTION Check that the motor will withstand this current without overheating. **Failure to follow this instruction can result in equipment damage.**		
tdI	**[DC injection time 1]** (1) (3)	0.1 to 30 s	0.5 s
	Maximum current injection time [DC inject. level 1] (IdC). After this time the injection current becomes [DC inject. level 2] (IdC2). The parameter can be accessed if [Type of stop] (Stt) = [DC injection] (dCI) or if [DC injection assign.] (dCI) is not [No] (nO).		
IdC2	**[DC inject. level 2]** (1) (3)	0.1 In (2) to [DC inject. level 1] (IdC)	0.5 In (2)
	Injection current activated by logic input or selected as stop mode, once period of time [DC injection time 1] (tdI) has elapsed. The parameter can be accessed if [Type of stop] (Stt) = [DC injection] (dCI) or if [DC injection assign.] (dCI) is not [No] (nO).		
	CAUTION Check that the motor will withstand this current without overheating. **Failure to follow this instruction can result in equipment damage.**		
tdC	**[DC injection time 2]** (1) (3)	0.1 to 30 s	0.5 s
	Maximum injection time [DC inject. level 2] (IdC2) for injection, selected as stop mode only. The parameter can be accessed if [Stop type] (Stt) = [DC injection] (dCI).		
dotd	**[Dis. operat opt code]**		**[Ramp stop]** (rMp)
nSt rMP	Disable operation stop mode. **[Freewheel]** (nSt): the drive stops in freewheel when going from Operation enable to Switched on state. **[Ramp stop]** (rMp): the drive stops on ramp when going from Operation enable to Switched on state.		

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.
(2) In corresponds to the rated drive current indicated in the Installation Manual and on the drive nameplate.
(3) Warning: These settings are independent of the [AUTO DC INJECTION] (AdC-) function.


Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting
AdC-	**[AUTO DC INJECTION]**		
AdC	**[Auto DC injection]**		[Yes] (YES)
	Automatic current injection on stopping (at the end of the ramp) ☐ **[No]** (nO): No injection. ☐ **[Yes]** (YES): Adjustable injection time. ☐ **[Continuous]** (Ct): Continuous standstill injection. **Warning**, there is an interlock between this function and [Motor fluxing] (FLU) page 157. If [Motor fluxing] (FLU) = [Continuous] (FCt) [Auto DC injection] (Adc) must be [No] (nO). **Note:** This parameter gives rise to the injection of current even if a run command has not been sent. It can be accessed with the drive running.		
SdC1	**[Auto DC inj. level 1]** (1)	0 to 1.2 In (2)	0.7 In (2)
	Level of standstill DC injection current [Auto DC injection] (AdC) is not [No] (nO). This parameter is forced to 0 if [Motor control type] (Ctt) page 73 = [Sync. mot.] (SYn).. **CAUTION** Check that the motor will withstand this current without overheating. **Failure to follow this instruction can result in equipment damage.**		
tdC1	**[Auto DC inj. time 1]** (1)	0.1 to 30 s	0.5 s
	Standstill injection time. The parameter can be accessed if [Auto DC injection] (AdC) is not [No] (nO). If [Motor control type] (Ctt) page 73 = [FVC] (FUC) or [Sync. mot.](SYn) this time corresponds to the zero speed maintenance time.		
SdC2	**[Auto DC inj. level 2]** (1)	0 to 1.2 In (2)	0.5 In (2)
	2nd level of standstill DC injection current. The parameter can be accessed if [Auto DC injection] (AdC) is not [No] (nO). This parameter is forced to 0 if [Motor control type] (Ctt) page 73 = [Sync. mot.] (SYn).. **CAUTION** Check that the motor will withstand this current without overheating. **Failure to follow this instruction can result in equipment damage.**		

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.
(2) In corresponds to the rated drive current indicated in the Installation Manual and on the drive nameplate.

Parameter that can be modified during operation or when stopped.


Code	Name/Description	Adjustment range	Factory setting
	[AUTO DC INJECTION] (continued)		
tdC2	**[Auto DC inj. time 2]** (1) 2nd standstill injection time. The parameter can be accessed if [Auto DC injection] (AdC) = [Yes] (YES.)	0 to 30 s	0 s

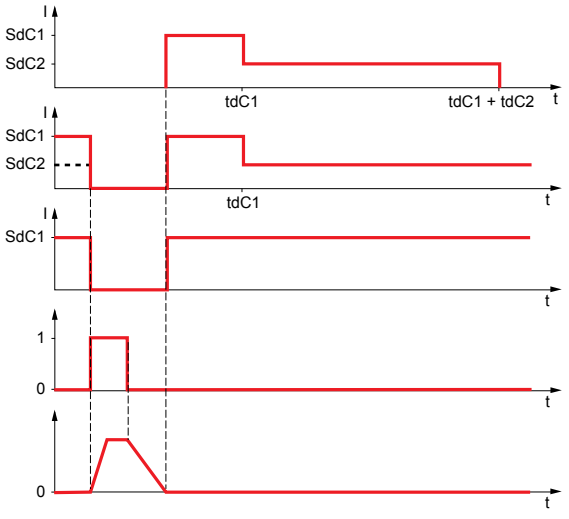AdC	SdC2	Operation
YES	x	
Ct	≠ 0	
Ct	= 0	
Run command		
Speed		

Note: When [Motor control type] (Ctt) page 73 = [FVC] (FUC):
[Auto DC inj. level 1] (SdC1), [Auto DC inj. level 2] (SdC2) and [Auto DC inj. time 2] (tdC2) cannot be accessed, only [Auto DC inj. time 1] (tdC1) can be accessed. This then corresponds to a zero speed maintenance time.

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-) menu.

Parameter that can be modified during operation or when stopped.

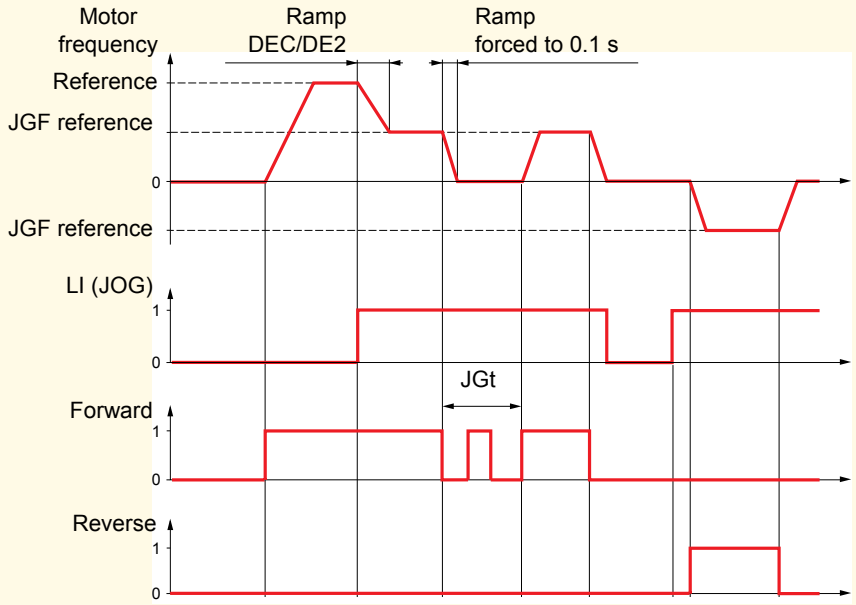Code	Name/Description	Adjustment range	Factory setting
JoG-	**[JOG]** **Note:** This function cannot be used with certain other functions. Follow the instructions on page 133.		
JoG	**❑ [JOG]** Pulse operation. **The JOG function is only active if the command channel and the reference channels are on the terminals.** Selecting the assigned logic input or bit activates the function. ☐ **[No]** (nO): Not assigned ☐ **[LI1]** (LI1) to **[LI6]** (LI6) ☐ **[LI7]** (LI7) to **[LI10]** (LI10): If VW3A3201 logic I/O card has been inserted ☐ **[LI11]** (LI11) to **[LI14]** (LI14): If VW3A3202 extended I/O card has been inserted ☐ **[C101]** (C101) to **[C115]** (C115): With integrated Modbus in [I/O profile] (IO) profile ☐ **[C201]** (C201) to **[C215]** (C215): With integrated CANopen in [I/O profile] (IO) profile ☐ **[C301]** (C301) to **[C315]** (C315): With a communication card in [I/O profile] (IO) profile ☐ **[C401]** (C401) to **[C415]** (C415): With a Controller Inside card in [I/O profile] (IO) profile ☐ **[CD00]** (Cd00) to **[CD13]** (Cd13): In [I/O profile] profile can be switched with possible logic inputs ☐ **[CD14]** (Cd14) to **[CD15]** (Cd15): In [I/O profile] profile can be switched without logic inputs The function is active when the assigned input or bit is at 1. Example: 2-wire control operation (tCC = 2C)  	[No] (nO)	
JGF	**❑ [Jog frequency]** (1) The parameter can be accessed if [JOG] (JOG) is not [No] (nO). Reference in jog operation	0 to 10 Hz	10 Hz
JGt	**❑ [Jog delay]** (1) The parameter can be accessed if [JOG] (JOG) is not [No] (nO). Anti-repeat delay between 2 consecutive jog operations.	0 to 2.0 s	0.5 s

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-) menu.

Parameter that can be modified during operation or when stopped.

Preset speeds

2, 4, 8 or 16 speeds can be preset, requiring 1, 2, 3 or 4 logic inputs respectively.

Note: **You must configure 2 and 4 speeds in order to obtain 4 speeds.**
You must configure 2, 4 and 8 speeds in order to obtain 8 speeds.
You must configure 2, 4, 8, and 16 speeds in order to obtain 16 speeds.

Combination table for preset speed inputs

16 speeds LI (PS16)	8 speeds LI (PS8)	4 speeds LI (PS4)	2 speeds LI (PS2)	Speed reference
0	0	0	0	Reference (1)
0	0	0	1	SP2
0	0	1	0	SP3
0	0	1	1	SP4
0	1	0	0	SP5
0	1	0	1	SP6
0	1	1	0	SP7
0	1	1	1	SP8
1	0	0	0	SP9
1	0	0	1	SP10
1	0	1	0	SP11
1	0	1	1	SP12
1	1	0	0	SP13
1	1	0	1	SP14
1	1	1	0	SP15
1	1	1	1	SP16

(1) See the diagram on page 121: Reference 1 = (SP1).

Code	Name/Description	Adjustment range	Factory setting
PSS-	**[PRESET SPEEDS]** **Note:** This function cannot be used with certain other functions. Follow the instructions on page 133.		
PS2	**[2 preset speeds]**		[No] (nO)
no	☐ **[No]** (nO): Function inactive		
LI1 - - -	☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127.		
PS4	**[4 preset speeds]**		[No] (nO)
no	☐ **[No]** (nO): Function inactive		
LI1 - - -	☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. To obtain 4 speeds you must also configure 2 speeds.		
PS8	**[8 preset speeds]**		[No] (nO)
no	☐ **[No]** (nO): Function inactive		
LI1 - - -	☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. To obtain 8 speeds you must also configure 2 and 4 speeds.		
PS16	**[16 preset speeds]**		[No] (nO)
no	☐ **[No]** (nO): Function inactive		
LI1 - - -	☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. To obtain 16 speeds you must also configure 2, 4 and 8 speeds.		

Code	Name/Description		Adjustment range	Factory setting
	[PRESET SPEEDS] (continued)			
SP2 ( )	❑ [Preset speed 2]	(1)	0 to 599 Hz	10 Hz
SP3 ( )	❑ [Preset speed 3]	(1)		15 Hz
SP4 ( )	❑ [Preset speed 4]	(1)		20 Hz
SP5 ( )	❑ [Preset speed 5]	(1)		25 Hz
SP6 ( )	❑ [Preset speed 6]	(1)		30 Hz
SP7 ( )	❑ [Preset speed 7]	(1)		35 Hz
SP8 ( )	❑ [Preset speed 8]	(1)		40 Hz
SP9 ( )	❑ [Preset speed 9]	(1)		45 Hz
SP10 ( )	❑ [Preset speed 10]	(1)		50 Hz
SP11 ( )	❑ [Preset speed 11]	(1)		55 Hz
SP12 ( )	❑ [Preset speed 12]	(1)		60 Hz
SP13 ( )	❑ [Preset speed 13]	(1)		70 Hz
SP14 ( )	❑ [Preset speed 14]	(1)		80 Hz
SP15 ( )	❑ [Preset speed 15]	(1)		90 Hz
SP16 ( )	❑ [Preset speed 16]	(1)		100 Hz
	The appearance of these [Preset speed x] (SPx) parameters is determined by the number of speeds configured.			

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-) menu.

( ) Parameter that can be modified during operation or when stopped.

+/- speed

Two types of operation are available.

1. **Use of single action buttons:** Two logic inputs are required in addition to the operating direction(s).
   The input assigned to the “+ speed” command increases the speed, the input assigned to the “- speed” command decreases the speed.


2. **Use of double action buttons:** Only one logic input assigned to “+ speed” is required.

+/- speed with double-press buttons:


Description: 1 button pressed twice (2 steps) for each direction of rotation. A contact closes each time the button is pressed.

	Released (- speed)	1st press (speed maintained)	2nd press (faster)
Forward button	–	a	a and b
Reverse button	–	c	c and d

Example of wiring:



LI1: forward
LIx: Reverse
LIy: + speed

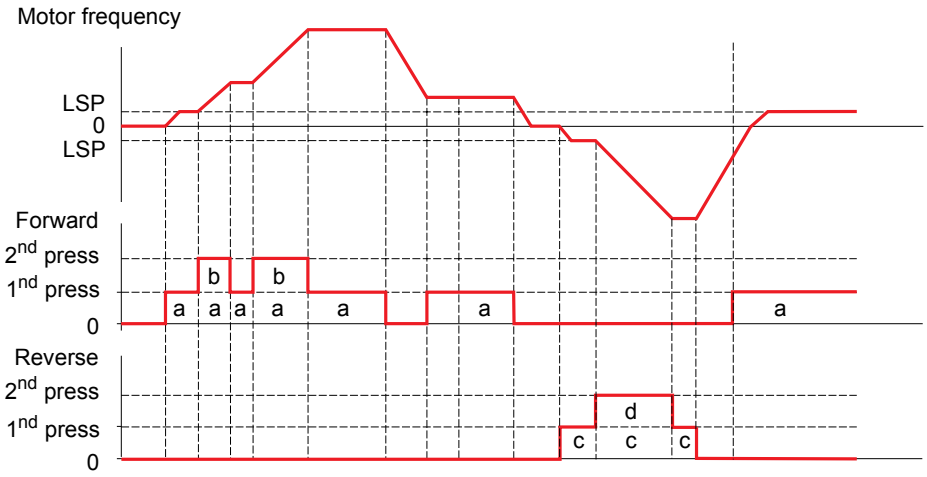

Do not use this +/-speed type with 3-wire control.

Whichever type of operation is selected, the max. speed is set by [High speed] (HSP) (see page 44).

Note:
If the reference is switched via rFC (see page 129) from any one reference channel to another reference channel with "+/- speed", the value of reference rFr (after ramp) may be copied at the same time in accordance with the [Copy channel 1 --> 2] (COP) parameter, see page 130.
If the reference is switched via rFC (see page 129) from one reference channel to any other reference channel with "+/- speed", the value of reference rFr (after ramp) is always copied at the same time.


This prevents the speed being incorrectly reset to zero when switching takes place.

Code	Name/Description	Adjustment range	Factory setting
uPd-	**[+/- SPEED]** Function can be accessed if reference channel [Ref.2 channel] (Fr2) = [+/-Speed] (UPdt) see page 129. **Note:** This function cannot be used with certain other functions. Follow the instructions on page 133.		
uSP	**[+ speed assignment]** ☐ **[No]** (nO): Function inactive ☐ **[LI1]** (LI1) to **[LI6]** (LI6) ☐ **[LI7]** (LI7) to **[LI10]** (LI10): If VW3A3201 logic I/O card has been inserted ☐ **[LI11]** (LI11) to **[LI14]** (LI14): If VW3A3202 extended I/O card has been inserted ☐ **[C101]** (C101) to **[C115]** (C115): With integrated Modbus in [I/O profile] (IO) ☐ **[C201]** (C201) to **[C215]** (C215): With integrated CANopen in [I/O profile] (IO) ☐ **[C301]** (C301) to **[C315]** (C315): With a communication card in [I/O profile] (IO) ☐ **[C401]** (C401) to **[C415]** (C415): With a Controller Inside card in [I/O profile] (IO) ☐ **[CD00]** (Cd00) to **[CD13]** (Cd13): In [I/O profile] can be switched with possible logic inputs ☐ **[CD14]** (Cd14) to **[CD15]** (Cd15): In [I/O profile] can be switched without logic inputs Function active if the assigned input or bit is at 1.	[No] (nO)	
dSP	**[-Speed assignment]** ☐ **[No]** (nO): Function inactive ☐ **[LI1]** (LI1) to **[LI6]** (LI6) ☐ **[LI7]** (LI7) to **[LI10]** (LI10): If VW3A3201 logic I/O card has been inserted ☐ **[LI11]** (LI11) to **[LI14]** (LI14): If VW3A3202 extended I/O card has been inserted ☐ **[C101]** (C101) to **[C115]** (C115): With integrated Modbus in [I/O profile] (IO) ☐ **[C201]** (C201) to **[C215]** (C215): With integrated CANopen in [I/O profile] (IO) ☐ **[C301]** (C301) to **[C315]** (C315): With a communication card in [I/O profile] (IO) ☐ **[C401]** (C401) to **[C415]** (C415): With a Controller Inside card in [I/O profile] (IO) ☐ **[CD00]** (Cd00) to **[CD13]** (Cd13): In [I/O profile] can be switched with possible logic inputs ☐ **[CD14]** (Cd14) to **[CD15]** (Cd15): In [I/O profile] can be switched without logic inputs Function active if the assigned input or bit is at 1.	[No] (nO)	
Str	**[Reference saved]** Associated with the "+/- speed" function, this parameter can be used to save the reference: • When the run commands disappear (saved to RAM) • When the line supply or the run commands disappear (saved to EEPROM) Therefore, the next time the drive starts up, the speed reference is the last reference saved. ☐ **[No]** (nO): No save (the next time the drive starts up, the speed reference is [Low speed] (LSP), see page 44) ☐ **[RAM]** (rAM): Saved in RAM ☐ **[EEprom]** (EEP): Saved in EEPROM	[No] (nO)	
SrE	**[+/-Speed reference]** Allow to choose the type of +/- speed reference. ☐ **[No]** (nO): The reference is given by the measured motor speed. ☐ **[Yes]** (YES): The reference is given by Fr2.	[No] (nO)	

+/- speed around a reference

The reference is given by Fr1 or Fr1b with summing/subtraction/multiplication functions and preset speeds if relevant (see the diagram on page 121. For improved clarity, we will call this reference A. The action of the +speed and -speed buttons can be set as a % of this reference A. On stopping, the reference (A +/- speed) is not saved, so the drive restarts with reference A+ only.
The maximum total reference is always limited by [High speed] (HSP) and the minimum reference by [Low speed] (LSP), see page 44.

Example of 2-wire control:

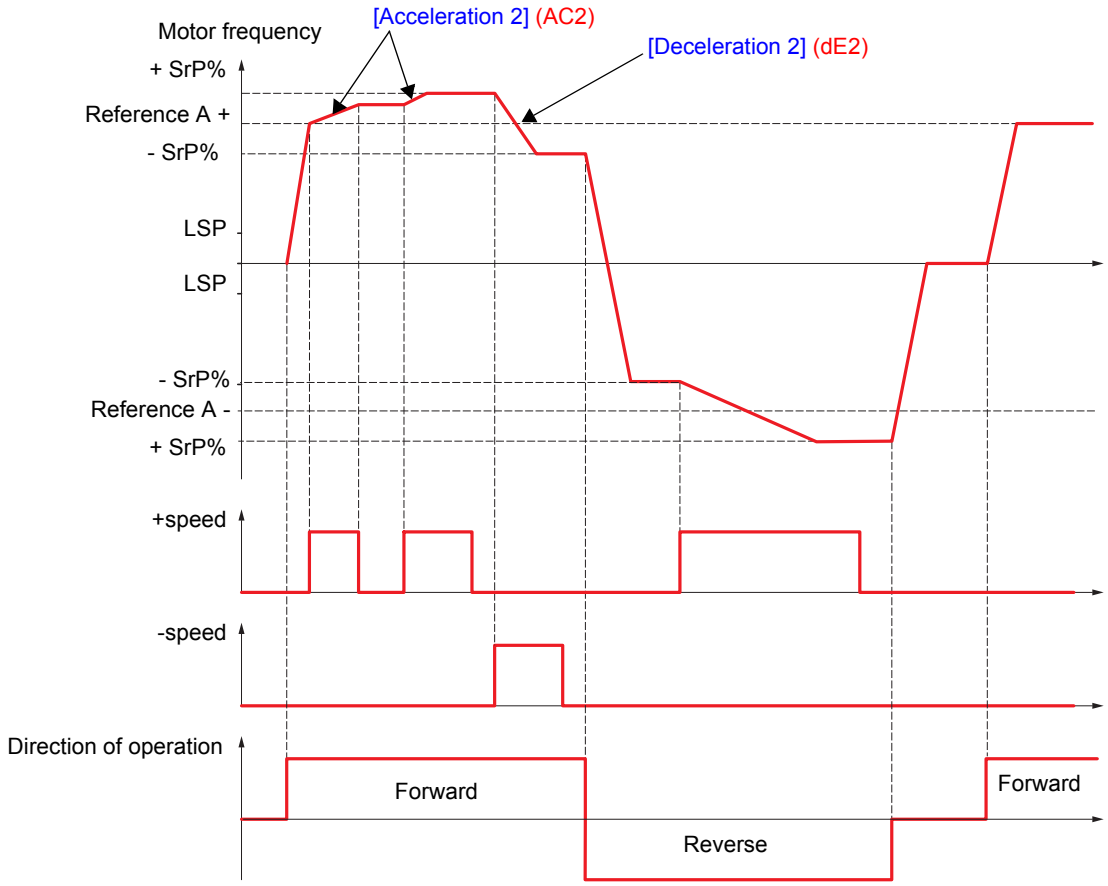

Code	Name/Description	Adjustment range	Factory setting
SrE-	**[+/-SPEED AROUND REF.]** The function can be accessed for reference channel [Ref.1 channel] (Fr1). **Note:** This function cannot be used with certain other functions. Follow the instructions on page 133.		
uS1 no LI1 - - -	**[+ speed assignment]** ☐ **[No]** (nO): Function inactive ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. Function active if the assigned input or bit is at 1.		[No] (nO)
dS1 no LI1 - - -	**[-Speed assignment]** ☐ **[No]** (nO): Function inactive ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. Function active if the assigned input or bit is at 1.		[No] (nO)
SrP ( )	**[+/-Speed limitation]** This parameter limits the variation range with +/- speed as a % of the reference. The ramps used in this function are[Acceleration 2] (AC2) and [Deceleration 2] (dE2). The parameter can be accessed if +/- speed is assigned.	0 to 50 %	10 %
AC2	**[Acceleration 2]** (1) Time to accelerate from 0 to the [Rated motor freq.] (FrS). Make sure that this value is compatible with the inertia being driven. The parameter can be accessed if +/- speed is assigned.	0.01 to 6000 s (2)	5.0 s
dE2	**[Deceleration 2]** (1) Time to decelerate from the [Rated motor freq.] (FrS) to 0. Make sure that this value is compatible with the inertia being driven. The parameter can be accessed if +/- speed is assigned.	0.01 to 6000 s (2)	5.0 s


(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.
(2) Range 0.01 to 99.99 s or 0.1 to 999.9 s or 1 to 6000 s according to [Ramp increment] (Inr) page 140.

( ) Parameter that can be modified during operation or when stopped.

Save reference

Saving a speed reference value using a logic input command lasting longer than 0.1 s.

- This function is used to control the speed of several drives alternately via a single analog reference and one logic input for each drive.
- It is also used to confirm a line reference (communication bus or network) on several drives via a logic input. This allows movements to be synchronized by getting rid of variations when the reference is set.
- The reference is acquired 100 ms after the rising edge of the request. A new reference is not then acquired until a new request is made.

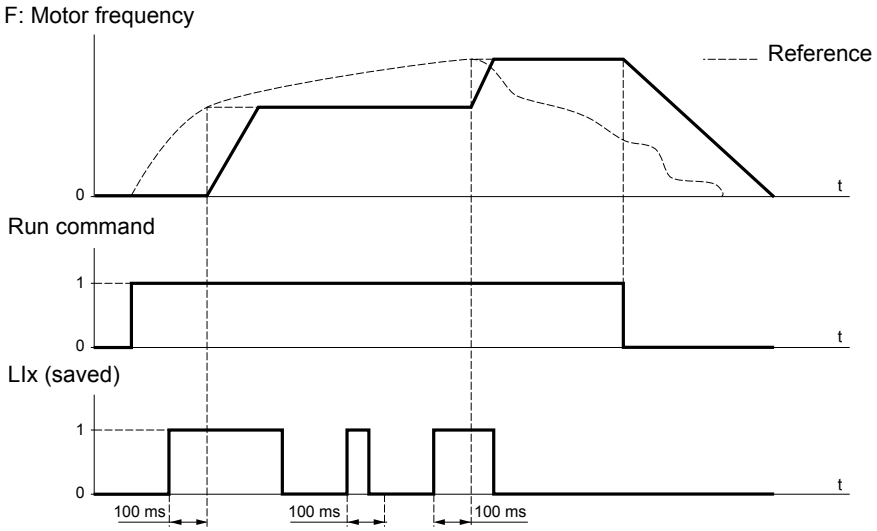

Code	Name/Description	Adjustment range	Factory setting
SPn-	**[MEMO REFERENCE]**		
SPn	❑ **[Ref. memo ass.]**		[No] (nO)
nO LI1 - LI14	☐ **[No]** (nO): Function inactive ☐ **[LI1]** (LI1) to **[LI6]** (LI6) ☐ **[LI7]** (LI7) to **[LI10]** (LI10): If VW3A3201 logic I/O card has been inserted ☐ **[LI11]** (LI11) to **[LI14]** (LI14): If VW3A3202 extended I/O card has been inserted Assignment to a logic input Function active if the assigned input is at 1.		

Code	Name/Description	Adjustment range	Factory setting
FLI-	**[FLUXING BY LI]**		
FLU	**[Motor fluxing]**	(1)	[No] (FnO)
	☐ **[Not cont.]** (FnC): Non-continuous mode ☐ **[Continuous]** (FCt): Continuous mode. This option is not possible if [Auto DC injection] (AdC) page 146 is [Yes] (YES) or if [Type of stop] (Stt) page 144 is [Freewheel] (nSt). ☐ **[No]** (FnO): Function inactive This option is not possible if [Motor control type] (Ctt) page 73 = [SVCI] (CUC) or [FVC] (FUC). If [Motor control type] (Ctt) page 73 = [SVCI] (CUC), [FVC] (FUC) or [Sync. mot.] (SYn) or [SVC V] (UUC) at and above ATV71HD55M3X, ATV71HD90N4 and ATV71HC11Y, the factory setting is replaced by [Not cont.] (FnC). In order to obtain rapid high torque on startup, magnetic flux needs to already have been established in the motor. • In [Continuous] (FCt) mode, the drive automatically builds up flux when it is powered up. • In [Not cont.] (FnC) mode, fluxing occurs when the motor starts up. The flux current is greater than nCr (configured rated motor current) when the flux is established and is then adjusted to the motor magnetizing current... **CAUTION** Check that the motor will withstand this current without overheating. **Failure to follow this instruction can result in equipment damage.** If [Motor control type] (Ctt) page 73 = [Sync. mot.] (SYn), the [Motor fluxing] (FLU) parameter causes the alignment of the rotor and not the fluxing. If [Brake assignment] (bLC) page 164 is not [No] (nO), the [Motor fluxing] (FLU) parameter has no effect.		
FLI	**[Fluxing assignment]**		[No] (nO)
	☐ **[No]** (nO): Function inactive ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. Assignment is only possible if [Motor fluxing] (FLU) = [Not cont.] (FnC). - If an LI or a bit is assigned to the motor fluxing command, flux is built up when the assigned input or bit is at 1. - If an LI or a bit has not been assigned, or if the assigned LI or bit is at 0 when a run command is sent, fluxing occurs when the motor starts.		

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-) menu.


Parameter that can be modified during operation or when stopped.

Limit switch management

This function can be used to manage trajectory limits using limit switches.

The stop mode is configurable.
When the stop contact is activated, startup in the other direction is authorized.

Example:

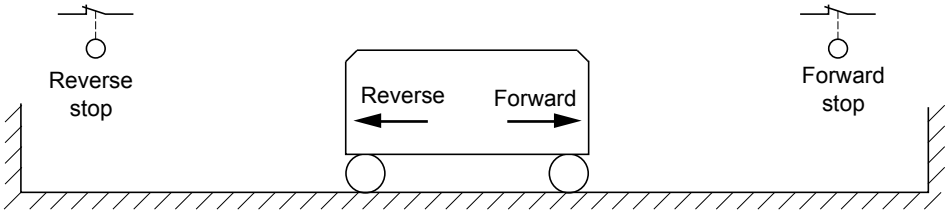

The stop is activated when the input is at 0 (contact open).

Code	Name/Description	Adjustment range	Factory setting
LSt-	**[LIMIT SWITCHES]** **Note:** This function cannot be used with certain other functions. Follow the instructions on page 133.		
LAF	**[Stop FW limit sw.]** ☐ **[No]** (nO): Function inactive ☐ **[LI1]** (LI1) to **[LI6]** (LI6) ☐ **[LI7]** (LI7) to **[LI10]** (LI10): If VW3A3201 logic I/O card has been inserted ☐ **[LI11]** (LI11) to **[LI14]** (LI14): If VW3A3202 extended I/O card has been inserted ☐ **[C101]** (C101) to **[C115]** (C115): With integrated Modbus in [I/O profile] (IO) ☐ **[C201]** (C201) to **[C215]** (C215): With integrated CANopen in [I/O profile] (IO) ☐ **[C301]** (C301) to **[C315]** (C315): With a communication card in [I/O profile] (IO) ☐ **[C401]** (C401) to **[C415]** (C415): With a Controller Inside card in [I/O profile] (IO) ☐ **[CD00]** (Cd00) to **[CD13]** (Cd13): In [I/O profile] (IO) can be switched with possible logic inputs ☐ **[CD14]** (Cd14) to **[CD15]** (Cd15): In [I/O profile] (IO) can be switched without logic inputs		[No] (nO)
LAr	**[Stop RV limit sw.]** Same assignments possible as for [Stop FW limit sw.] (LAF) below.		[No] (nO)
LAS	**[Stop type]** ☐ **[Ramp stop]** (rMP) ☐ **[Fast stop]** (FSt) ☐ **[Freewheel]** (nSt) When the assigned input changes to 0, the stop is controlled in accordance with the selected type. Restarting is only authorized for the other operating direction once the motor has stopped. If the two inputs [Stop FW limit sw.] (LAF) and [Stop RV limit sw.] (LAr) are assigned and at state 0, restarting will be impossible. The parameter can be accessed if [Stop FW limit sw.] (LAF) or [Stop RV limit sw.] (LAr) is assigned.		[Freewheel] (nSt)

Brake logic control

Used to control an electromagnetic brake by the drive, for horizontal and vertical hoisting applications, and for unbalanced machines.

Principle:

Vertical hoisting movement:

Maintain motor torque in the driving load holding direction during brake opening and closing, in order to hold the load, start smoothly when the brake is released and stop smoothly when the brake is engaged.

Horizontal movement:

Synchronize brake release with the build-up of torque during startup and brake engage at zero speed on stopping, to prevent jolting.

Instructions for brake logic control for a vertical hoisting application:

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION

Check that the selected settings and configurations will not result in the dropping or loss of control of the load being lifted.


Failure to follow these instructions can result in death or serious injury.

1. Brake impulse (bIP): YES. Ensure that the direction of rotation FW corresponds to lifting the load.
   For applications in which the load being lowered is very different from the load being lifted, set BIP = 2 Ibr (e.g., ascent always with a load and descent always without a load).
2. Brake release current (Ibr and Ird if BIP = 2 Ibr): Adjust the brake release current to the rated current indicated on the motor.
   During testing, adjust the brake release current in order to hold the load smoothly.
3. Acceleration time: For hoisting applications it is advisable to set the acceleration ramps to more than 0.5 seconds. Ensure that the drive does not exceed the current limit.
   The same recommendation applies for deceleration.
   Reminder: For a hoisting movement, a braking resistor should be used.
4. Brake release time (brt): Set according to the type of brake. It is the time required for the mechanical brake to release.
5. Brake release frequency (bIr), in open-loop mode only: Leave in [Auto], adjust if necessary.
6. Brake engage frequency (bEn): Leave in [Auto], adjust if necessary.
7. Brake engage time (bEt): Set according to the type of brake. It is the time required for the mechanical brake to engage.
8. (brH4) must be enabled and the related alarm (bSA) must be managed.

Instructions for brake logic control for a horizontal hoisting application:


1. Brake impulse (bIP): No
2. Brake release current (Ibr): Set to 0.
3. Brake release time (brt): Set according to the type of brake. It is the time required for the mechanical brake to release.
4. Brake engage frequency (bEn), in open-loop mode only: Leave in [Auto], adjust if necessary.
5. Brake engage time (bEt): Set according to the type of brake. It is the time required for the mechanical brake to engage.

Brake logic control, horizontal movement in open-loop mode

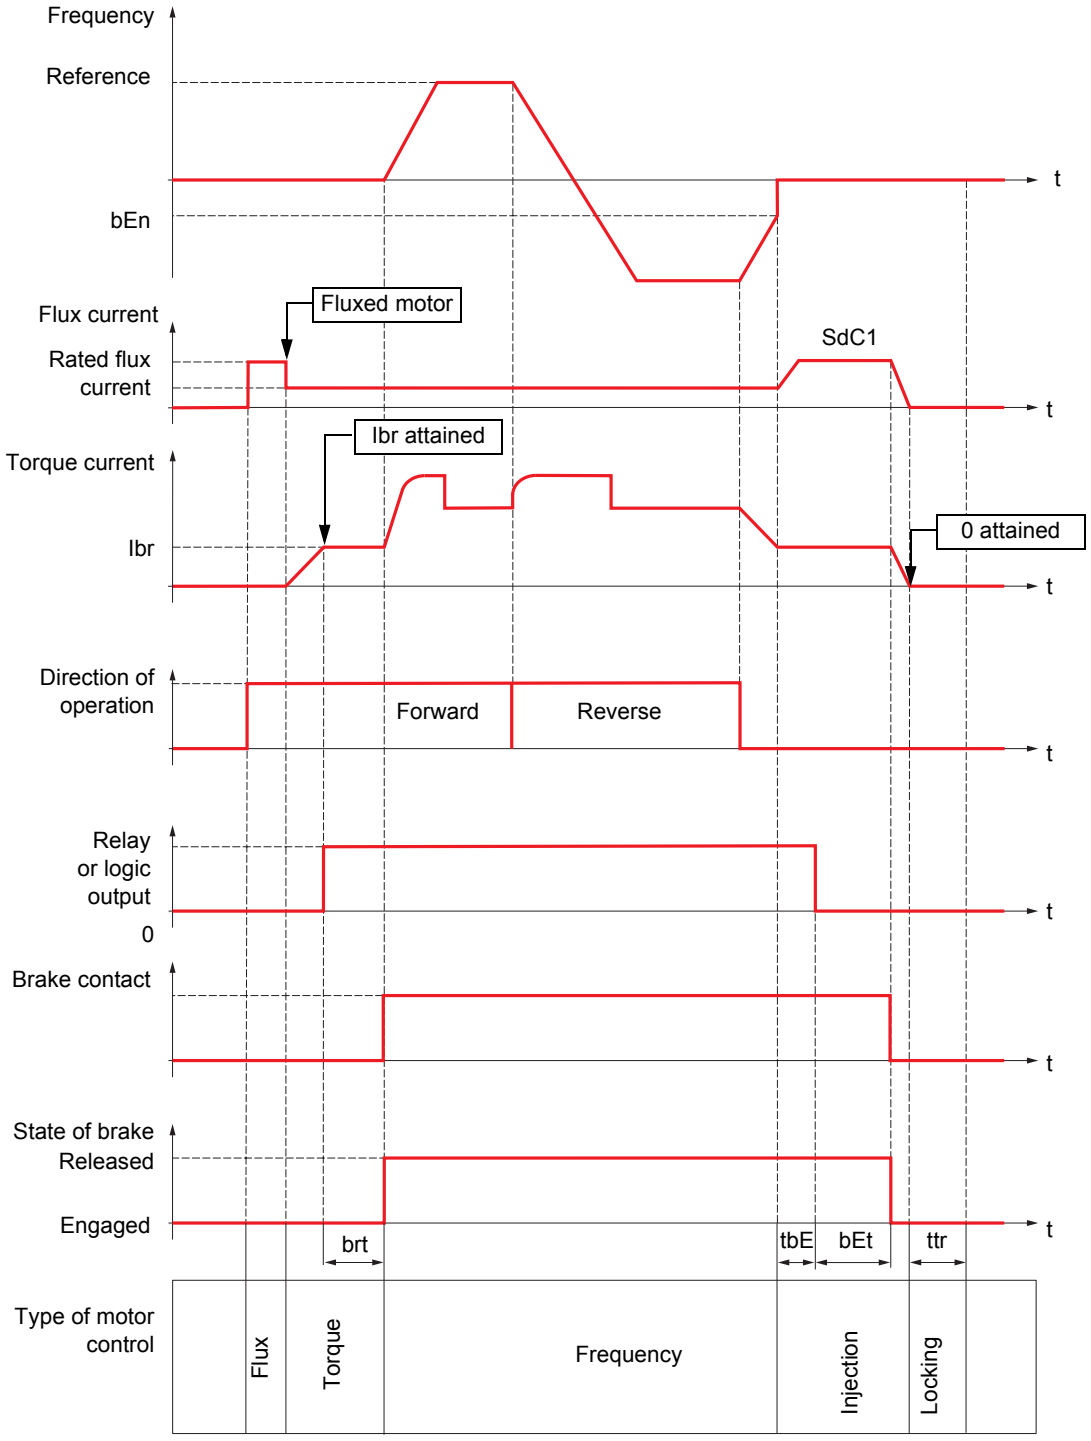


Key:
- (bEn): [Brake engage freq]
- (bEt): [Brake engage time]
- (brt): [Brake Release time]
- (Ibr): [Brake release I FW]
- (SdC1): [Auto DC inj. level 1]
- (tbE): [Brake engage delay]
- (ttr): [Time to restart]

Brake logic control, vertical movement in open-loop mode

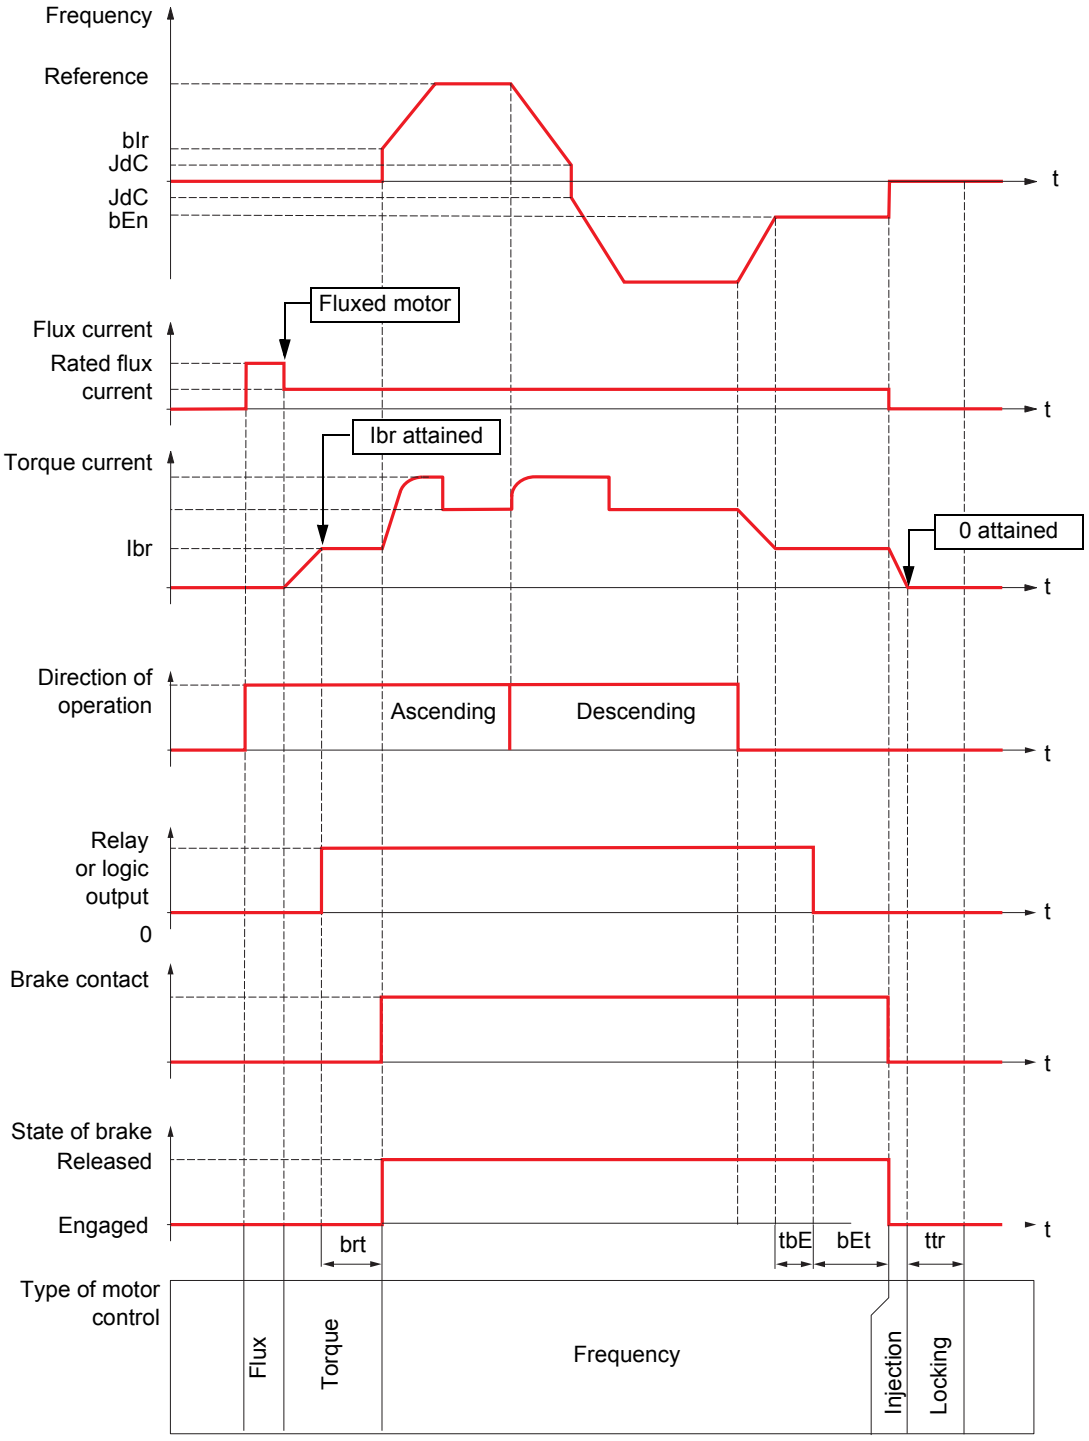

Key:
- (bEn): [Brake engage freq]
- (bEt): [Brake engage time]
- (bIr): [Brake release freq]
- (brt): [Brake Release time]
- (Ibr): [Brake release I FW]
- (JdC): [Jump at reversal]
- (tbE): [Brake engage delay]
- (ttr): [Time to restart]

Brake logic control, vertical or horizontal movement in closed-loop mode

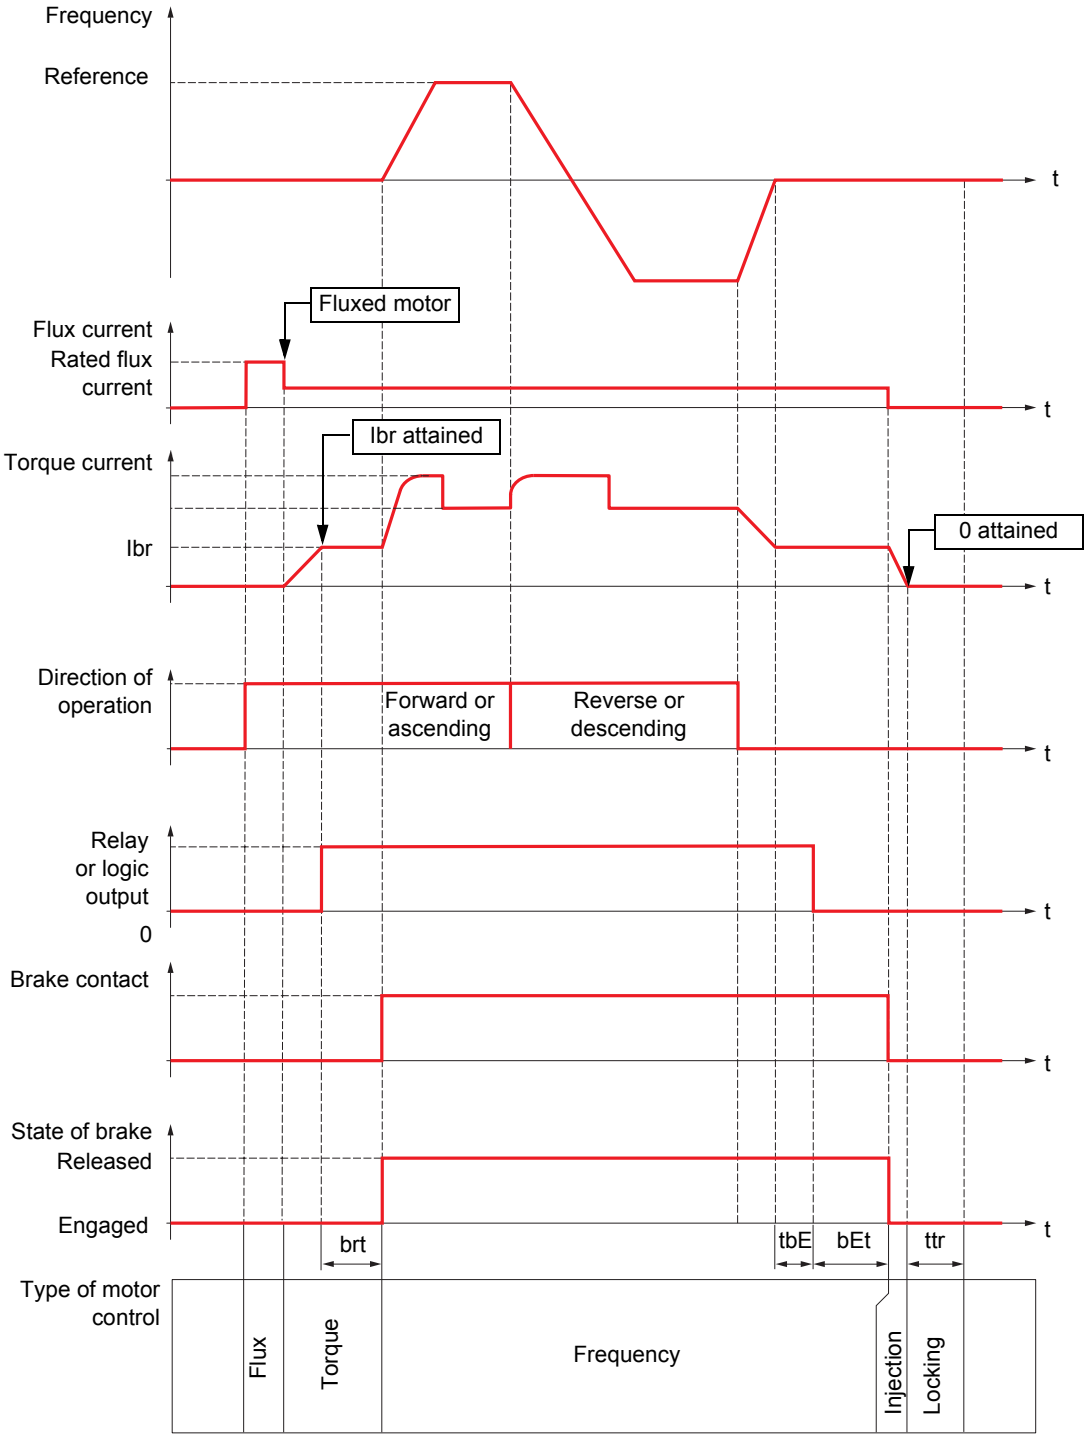

Key:
- (bEt): [Brake engage time]
- (brt): [Brake Release time]
- (Ibr): [Brake release I FW]
- (tbE): [Brake engage delay]
- (ttr): [Time to restart]

Code	Name/Description	Adjustment range	Factory setting
bLC-	**[BRAKE LOGIC CONTROL]** **Note:** This function cannot be used with certain other functions. Follow the instructions on page 133.		
bLC	**[Brake assignment]** **Note: If the brake is assigned, only a ramp stop is possible.** Check the [Type of stop] (Stt) page 144. Brake logic control can only be assigned if [Motor control type] (Ctt) page 73 = [SVC V] (UUC), [SVC I] (CUC) or [FVC] (FUC), or if [Motor control type] (Ctt) = [V/F 2pts] (UF2) or [V/F 5pts] (UF5) for ATV71●●●N4 from 90 kW and for ATV71●●●M3X from 55 kW. Logic output or control relay ☐ **[No]** (nO): Function not assigned (in this case, none of the function parameters can be accessed). ☐ **[R2]** (r2) to **[R4]** (r4): Relay (selection extended to R3 or R4 if one or two I/O cards have been inserted). **[LO1]** (LO1) to **[LO4]** (LO4): Logic output (if one or two I/O cards have been inserted, LO1 to LO2 or LO4 can be selected). ☐ **[dO1]** (dO1): Analog output AO1 functioning as a logic output. Selection can be made if [AO1 assignment] (AO1) page 114 = [No] (nO).		[No] (nO)
bSt	**[Movement type]** ☐ **[Traveling]** (HOr): Resistive-load movement (translational motion of overhead crane, for example). **Note:** If [Motor control type] (Ctt) = [V/F 2pts] (UF2) or [V/F 5pts] (UF5) for ATV71●●●N4 from 90 kW and for ATV71●●●M3X from 55 kW, [Movement type] (bSt) is forced to [Traveling] (HOr). ☐ **[Hoisting]** (UEr): Driving-load movement (hoisting winch, for example). If [Weight sensor ass.] (PES) page 171 is not [No] (nO) [Movement type] (bSt) is forced to [Hoisting] (UEr).		[Hoisting] (UEr)
bCI	**[Brake contact]** If the brake has a monitoring contact (closed for released brake). ☐ **[No]** (nO): Function inactive ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127.		[No] (nO)
FbCI	**[Brake logic filter T]** Filter on brake contact logic input. The parameter can be accessed if [Brake contact] (bCI) is not set to [No] (nO)	0 to 1000 ms	0 ms
biP ↻	**[Brake impulse]** The parameter can be accessed if [Weight sensor ass.] (PES) = [No] (nO) (see page 171) and if [Movement type] (bSt) = [Hoisting] (UEr). ☐ **[No]** (nO): The motor torque is given in the required operating direction, at current Ibr. ☐ **[Yes]** (YES): The motor torque is always Forward (check that this direction corresponds to ascending), at current Ibr. ☐ **[2 IBR]** (2Ibr): The torque is in the required direction, at current Ibr for Forward and Ird for Reverse, for certain specific applications.		[No] (nO)

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.
(2) In corresponds to the rated drive current indicated in the Installation Manual and on the drive nameplate.

↻ Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting
	[BRAKE LOGIC CONTROL] (continued)		
ibr	**[Brake release I FW]** (1) Brake release current threshold for ascending or forward movement The parameter can be accessed if [Weight sensor ass.] (PES) = [No] (nO) (see page 171).	0 to 1.32 In (2)	0
ird	**[Brake release I Rev]** (1) Brake release current threshold for descending or reverse movement The parameter can be accessed if [Brake impulse] (bIP) = [2 IBR] (2Ibr).	0 to 1.32 In (2)	0
brt	**[Brake Release time]** (1) Brake release time delay	0 to 5.00 s	0
bir	**[Brake release freq]** (1) Brake release frequency threshold (initialization of acceleration ramp). The parameter can be accessed if [Motor control type] (Ctt) page 73 is not [FVC] (FUC) and if [Movement type] (bSt) page 164 is [Hoisting] (UEr). Auto ☐ **[Auto]** (AUtO): The drive takes a value equal to the rated slip of the motor, calculated using the drive parameters. - ☐ **0 to 10 Hz**: Manual control		[Auto] (AUtO)
bEn	**[Brake engage freq]** (1) Brake engage frequency threshold The parameter can be accessed if [Motor control type] (Ctt) page 73 is not [FVC] (FUC). Auto ☐ **[Auto]** (AUtO): The drive takes a value equal to the rated slip of the motor, calculated using the drive parameters. - ☐ **0 to 10 Hz**: Manual control		[Auto] (AUtO)
bECd	**[Brake engage at 0]** Brake engages at regulated zero speed. The parameter can be accessed if [Motor control type] (Ctt) page 73 = [FVC] (FUC). Can be used to engage the brake at zero speed in closed-loop mode with speed regulation. This parameter can be used to adjust the brake engage delay once zero speed has been reached. If a speed other than zero is then required, the command to release the brake is sent following torque application. no ☐ **[No]** (nO): Brake does not engage at regulated zero speed. - ☐ **0.0 to 30.0 s**: Brake engage delay once zero speed is reached.		[No] (nO)
tbE	**[Brake engage delay]** (1) Time delay before request to engage brake. To delay brake engagement, if you wish the brake to be engaged when the drive comes to a complete stop.	0 to 5.00 s	0
bEt	**[Brake engage time]** (1) Brake engage time (brake response time)	0 to 5.00 s	0

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-) menu.
(2) In corresponds to the rated drive current indicated in the Installation Manual and on the drive nameplate.

Parameter that can be modified during operation or when stopped.

Code	Name/Description		Adjustment range	Factory setting
	[BRAKE LOGIC CONTROL] (continued)			
SdC1	**[Auto DC inj. level 1]**	(1)	0 to 1.2 In (2)	0.7 In (2)
	Level of standstill DC injection current. **Note:** The parameter can be accessed if [Motor control type] (Ctt) page 73 is not [FVC] (FUC) and if [Movement type] (bSt) page 164 is [Traveling] (HOr). **CAUTION** Check that the motor will withstand this current without overheating. **Failure to follow this instruction can result in equipment damage.**			
bEd	**[Engage at reversal]**			[No] (nO)
nO YES	☐ **[No]** (nO): The brake does not engage. ☐ **[Yes]** (YES): The brake engages. Can be used to select whether or not the brake engages on transition to zero speed when the operating direction is reversed.			
JdC	**[Jump at reversal]**	(1)	0 to 10.0 Hz	[Auto] (AUtO)
AUtO -	The parameter can be accessed if [Motor control type] (Ctt) page 73 is not [FVC] (FUC) and if [Movement type] (bSt) page 164 is [Hoisting] (UEr). ☐ **[Auto]** (AUtO): The drive takes a value equal to the rated slip of the motor, calculated using the drive parameters. ☐ **0 to 10 Hz**: Manual control When the reference direction is reversed, this parameter can be used to avoid loss of torque (and consequential release of load) on transition to zero speed. Parameter is not applicable if [Engage at reversal] (bEd) = [Yes] (YES).			
tbr	**[Time to restart]**	(1)	0.00 to 15.00 s	0.00
	Time between the end of a brake engage sequence and the start of a brake release sequence			

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.
(2) In corresponds to the rated drive current indicated in the Installation Manual and on the drive nameplate.

Parameter that can be modified during operation or when stopped.


Brake control logic expert parameters

Code	Name/Description	Adjustment range	Factory setting
brH0	❏ [BRH b0]		0
0	☐ [0] (0): The engage/release sequence is executed in full.		
1	☐ [1] (1): The brake is released immediately.		

Selection of the brake restart sequence if a run command is repeated while the brake is engaging.

Use in open-loop and closed-loop mode.

- A run command may be requested during the brake engagement phase. Whether or not the brake release sequence is executed depends on the value selected for [BRH b0] (brH0).

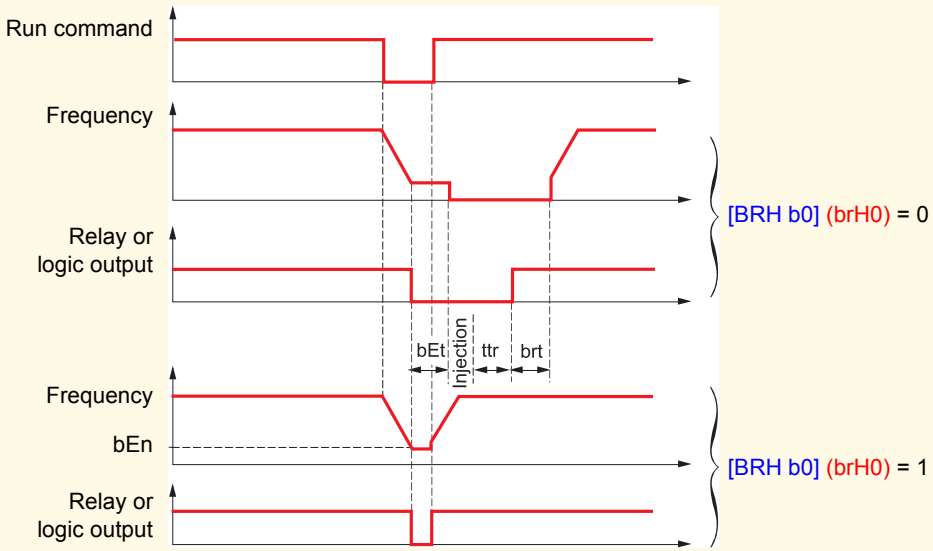


Note:

- If a run command is requested during the "ttr" phase, the complete brake control sequence is initialized.
- If a run command is requested with [Engage at reversal] (bEd) active,the complete brake control sequence is initialized.

brH1	❏ [BRH b1]		0
0	☐ [0] (0): The brake contact in steady state fault is active (fault if the contact is open during operation). The brF brake contact fault is monitored in all operating phases.		
1	☐ [1] (1): The brake contact in steady state fault is inactive. The brF brake contact fault is only monitored during the brake release and engage phases.		

Deactivation of the brake contact in steady state fault.

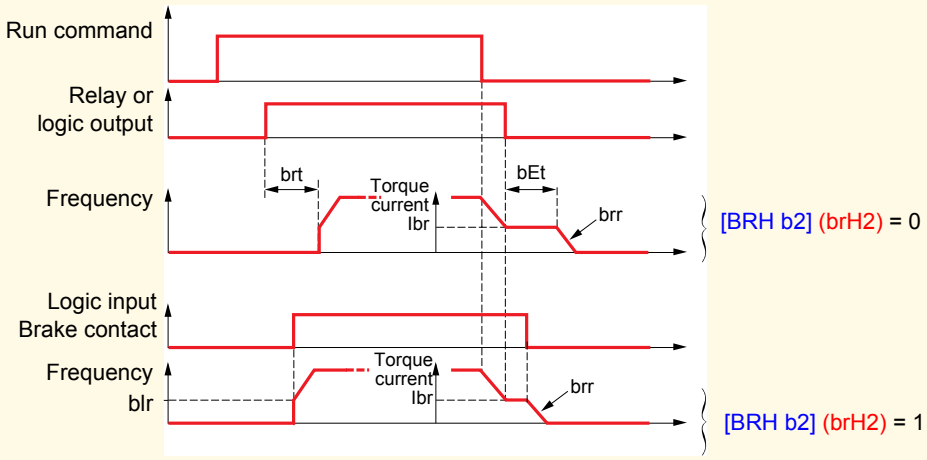Code	Name/Description	Adjustment range	Factory setting
brH2 0 1	❏ [BRH b2] Taking the brake contact into account for the brake control sequence. ☐ [0] (0): The brake contact is not taken into account. ☐ [1] (1): The brake contact is taken into account. Use in open-loop and closed-loop mode. • If a logic input is assigned to the brake contact. [BRH b2] (brH2) = 0: During the brake release sequence, the reference is enabled at the end of the time [Brake Release time] (brt). During the brake engage sequence, the current changes to 0 according to the ramp [Current ramp time] (brr) at the end of the [Brake engage time] (bEt). [BRH b2] (brH2) = 1: When the brake is released, the reference is enabled when the logic input changes to 1. When the brake is engaged, the current changes to 0 according to the ramp [Current ramp time] (brr) when the logic input changes to 0.  		0
brH3 0 1	❏ [BRH b3] In closed-loop mode only. Management of the absence of brake contact response, if it is assigned. ☐ [0] (0): During the brake engage sequence, the brake contact must be open before the end of [Brake engage time] (bEt), otherwise the drive locks in a brF brake contact fault. ☐ [1] (1): During the brake engage sequence, the brake contact must be open before the end of [Brake engage time] (bEt), otherwise a bCA brake contact alarm is triggered and zero speed is maintained.		0

Code	Name/Description	Adjustment range	Factory setting
brH4	❑ [BRH_b4]		0

0
1

⚠ WARNING

LOSS OF CONTROL

If [BRH_b4] (brH4) is set to [1] (1) bSA alarm must be managed
If bSA alarm is triggered:
1) place the load on a safe position
2) power off the drive
3) verify and correct the brake installation (electrical and mechanical devices)
Failure to follow these instructions can result in death, serious injury or equipment damage.

In closed-loop mode only. Activation of the speed loop at zero if a movement for which no command has been given occurs (measurement of a speed greater than a fixed min. threshold).
- ☐ **[0]** (0): No action in the event of a movement for which no command has been given.
- ☐ **[1]** (1): If a movement occurs for which no command has been given, the drive switches to zero speed regulation, with no brake release command, and a bSA alarm is triggered.

Note: When the product is controlled under Cia402 profile, [BRH_b4] (brH4) function is activated only if the operating state is "Operation Enable" (Run, halt...)

brr	❑ [Current ramp time]	0 to 5.00 s	0 s
( )	Torque current ramp time (increase and decrease) for a current variation equal to [Brake release I FW] (Ibr).		
bFtd	❑ [BRH_b4_freq]	0.1 to 10 Hz	0.2 Hz
( )	Parameter can only be modified in [ACCESS LEVEL] = [Expert] mode. If [BRH_b4] (brH4), [BRH_b4_freq] (bFtd) represent the threshold level for [BRH_b4] (brH4). [BRH_b4_freq] (bFtd) value depends from the installation mechanical response. If [BRH_b4_freq] (bFtd) is too low the drive may rise [Load mvt al] (bSA) when not needed. If [BRH_b4_freq] (bFtd) is too high a slip of the load may occur without [Load mvt al] (bSA) alarm.		

⚠ WARNING

LOSS OF CONTROL

If the setting is too low, the [BRH_b4] (brH4) function might be activated untimely.
If the setting is too high, the [BRH_b4] (brH4) function might notbe activated when required.
- Check and control that the setting is convenient for the application

Failure to follow these instructions can result in death, serious injury or equipment damage.

( ) Parameter that can be modified during operation or when stopped.


Load measurement

This function uses the information supplied by a weight sensor to adapt the current [Brake release I FW] (Ibr) of the [BRAKE LOGIC CONTROL] (bLC-) function. The signal from the weight sensor can be assigned to an analog input (usually a 4 - 20 mA signal), to the pulse-in input or to the encoder input, according to the type of weight sensor.

Examples:

- Measurement of the total weight of a hoisting winch and its load
- Measurement of the total weight of an elevator winch, the cabin and counterweight

The current [Brake release I FW] (Ibr) is adapted in accordance with the curve below.

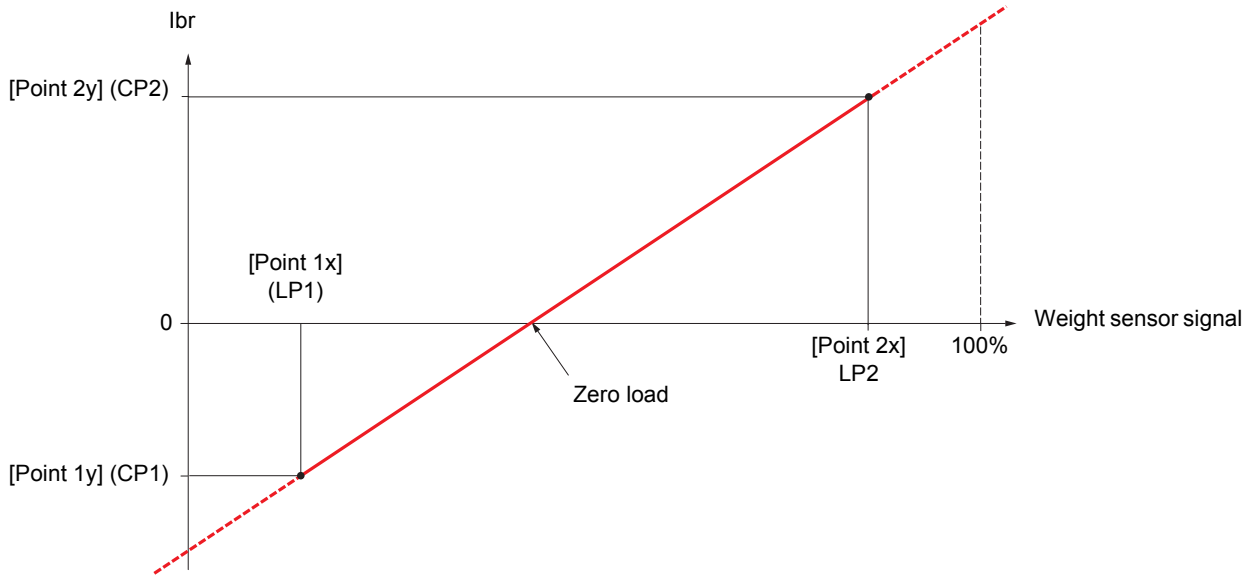

This curve can represent a weight sensor on an elevator winch, where zero load on the motor occurs when the load in the cabin is not zero.

Code	Name/Description	Adjustment range	Factory setting
ELM-	**[EXTERNAL WEIGHT MEAS.]**		
PES	**[Weight sensor ass.]**		[No] (nO)

Function can be accessed if brake logic control is assigned (see page 164).
If [Weight sensor ass.] (PES) is not [No] (nO), [Movement type] (bSt) page 164 is forced to [Hoisting] (UEr).

- nO **[No]** (nO): Function inactive
- AI1 **[AI1]** (AI1): Analog input
- AI2 **[AI2]** (AI2): Analog input
- AI3 **[AI3]** (AI3): Analog input, if VW3A3202 extension card has been inserted
- AI4 **[AI4]** (AI4): Analog input, if VW3A3202 extension card has been inserted
- PI **[RP]** (PI): Frequency input, if VW3A3202 extension card has been inserted
- PG **[Encoder]** (PG): Encoder input, if encoder card has been inserted
- AIU1 **[Network AI]** (AIU1): Virtual input via communication bus, to be configured via [AI net. channel] (AIC1) page 101.

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION

If the equipment switches to forced local mode (see page 248), the virtual input remains fixed at the last value transmitted.
Do not use the virtual input and forced local mode in the same configuration.
Failure to follow these instructions can result in death or serious injury.

LP1	**[Point 1 X]**	0 to 99.99%	0

0 to 99.99% of signal on assigned input.
[Point 1x] (LP1) must be less than [Point 2x] (LP2).
The parameter can be accessed if [Weight sensor ass.] (PES) is assigned.

CP1	**[Point 1Y]**	-1.36 to +1.36 In (1)	- In

Current corresponding to load [Point 1 X] (LP1), in A.
The parameter can be accessed if [Weight sensor ass.] (PES) is assigned.

LP2	**[Point 2X]**	0.01 to 100%	50%

0.01 to 100% of signal on assigned input.
[Point 2x] (LP2) must be greater than [Point 1x] (LP1).
The parameter can be accessed if [Weight sensor ass.] (PES) is assigned.

CP2	**[Point 2Y]**	-1.36 to +1.36 In (1)	0

Current corresponding to load [Point 2x] (LP2), in A.
The parameter can be accessed if [Weight sensor ass.] (PES) is assigned.

IbrA ↻	**[Ibr 4-20 mA loss]**	0 to 1.36 In (1)	0

Brake release current in the event of the loss of the weight sensor information.
This parameter can be accessed if the weight sensor is assigned to an analog current input and the 4-20 mA loss fault is deactivated.
Recommended settings:
- 0 for elevators
- Rated motor current for a hoisting application

(1) In corresponds to the rated drive current indicated in the Installation Manual and on the drive nameplate.


↻ Parameter that can be modified during operation or when stopped.

High-speed hoisting

This function can be used to optimize the cycle times for hoisting movements for zero or lightweight loads. It authorizes operation at "constant power" in order to reach a speed greater than the rated speed without exceeding the rated motor current.
The speed remains limited by the [High speed] (HSP) parameter, page 44.

The function acts on the speed reference pedestal and not on the reference itself.


Principle:

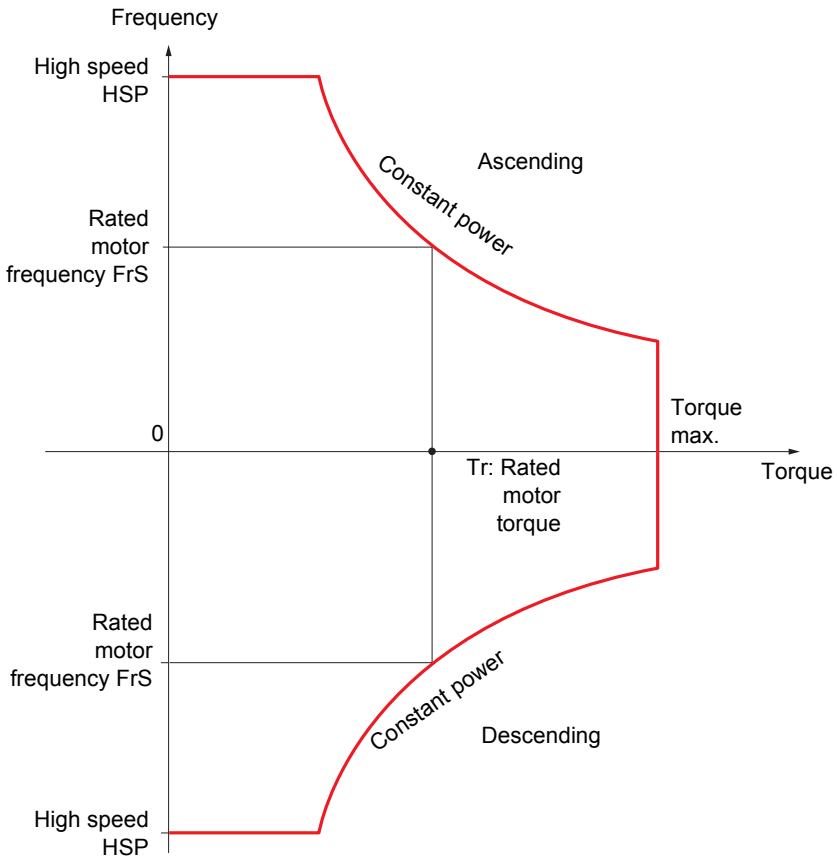

There are 2 possible operating modes:

- "Speed reference" mode: The maximum permissible speed is calculated by the drive during a speed step that is set so that the drive can measure the load.
- "Current limitation" mode: The maximum permissible speed is the speed that supports current limitation in motor mode, in the "Ascending" direction only. For the "Descending" direction, operation is always in "Speed reference" mode.


Speed reference mode

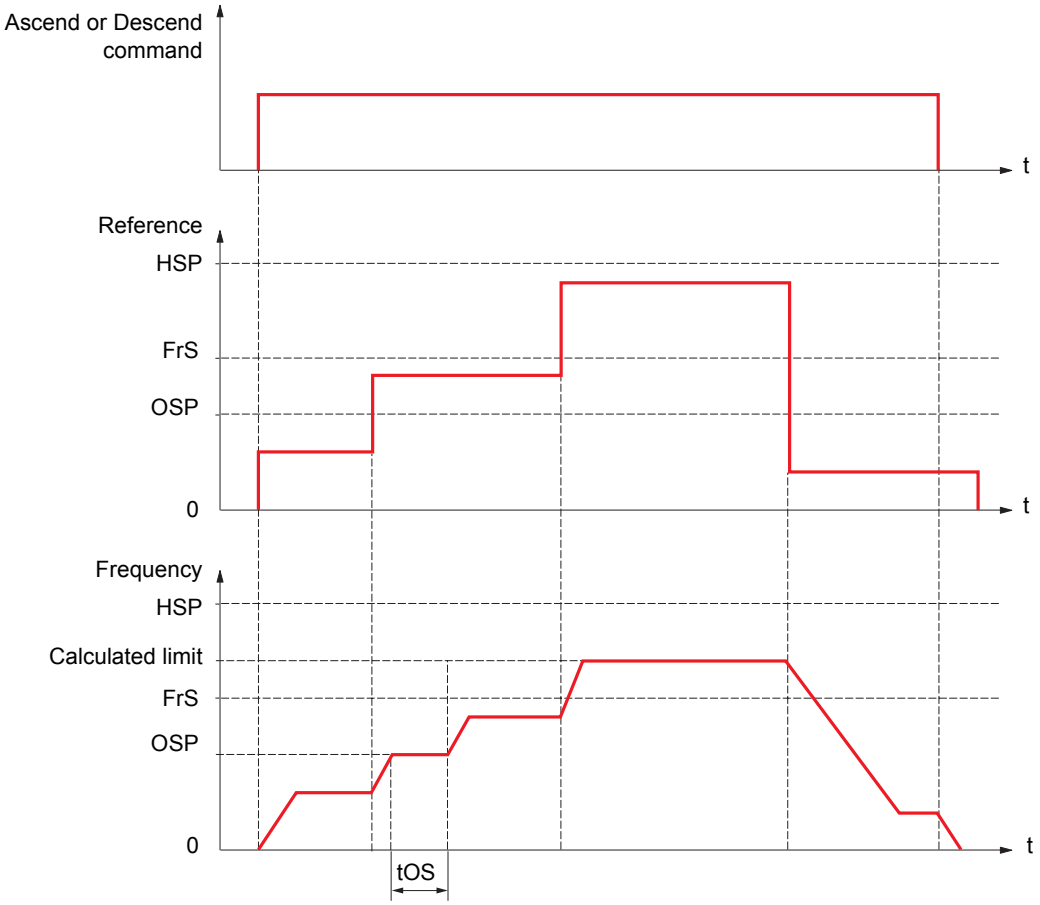

OSP: Adjustable speed step for load measurement
tOS: Load measuring time

Two parameters are used to reduce the speed calculated by the drive, for ascending and descending.

Current limiting mode

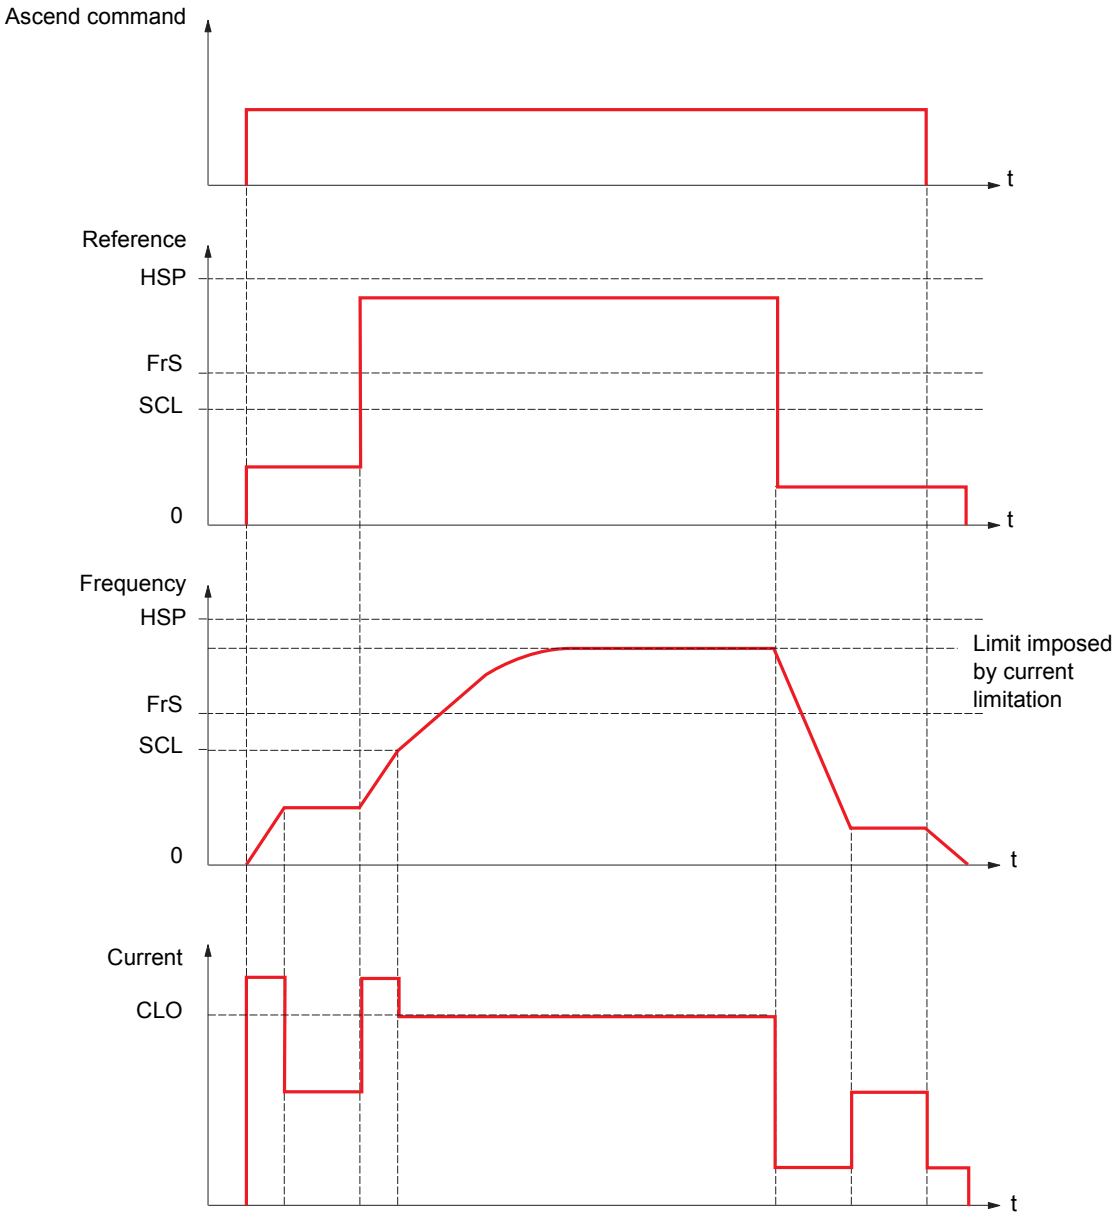



SCL: Adjustable speed threshold, above which current limitation is active
CLO: Current limitation for high-speed function

☞ **Note:** The speed reached for a specific current will be lower in case of network undervoltage in comparison with nominal network voltage.

Rope slack

The "rope slack" function can be used to prevent starting up at high speed when a load has been set down ready for lifting but the rope is still slack (as illustrated below).

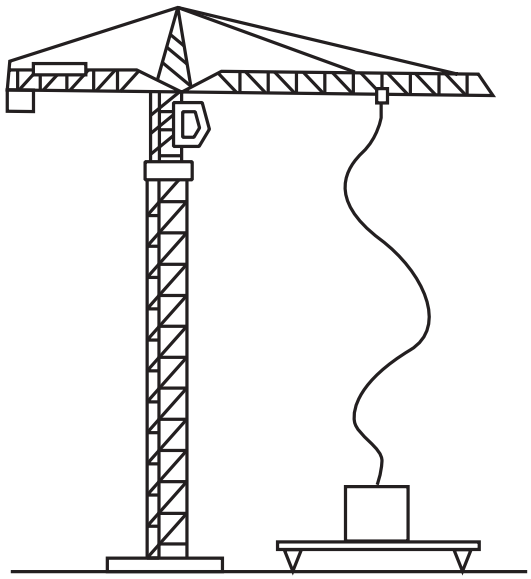

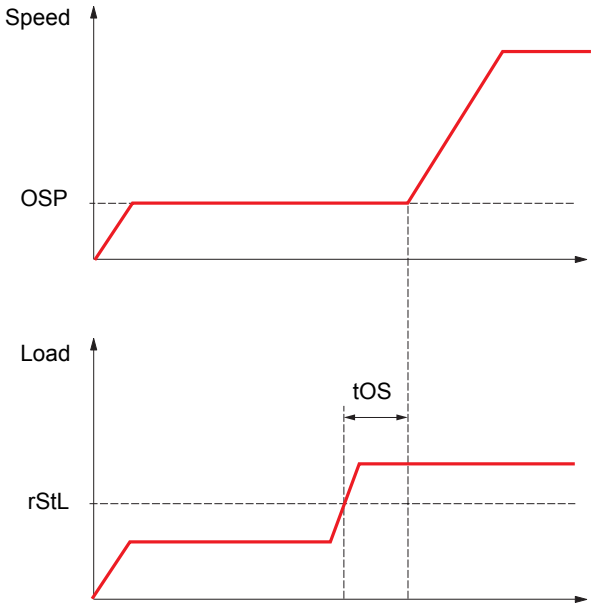

The speed step (OSP parameters) described on page 173 is used to measure the load. The effective measurement cycle will not be triggered until the load reaches the adjustable threshold rStL, which corresponds to the weight of the hook.

A logic output or a relay can be assigned to the indication of the "rope slack" state in the [1.5 INPUTS / OUTPUTS CFG] (I-O-) menu.

[1.7 APPLICATION FUNCT.] (FUn-)

Code	Name/Description	Adjustment range	Factory setting
HSH-	**[HIGH SPEED HOISTING]** **Note:** This function cannot be used with certain other functions. Follow the instructions on page 133.		
HSo nO SSo CSo	**[High speed hoisting]** ☐ **[No]** (nO): Function inactive ☐ **[Speed ref]** (SSO): "Speed reference" mode ☐ **[I Limit]** (CSO): "Current limitation" mode		[No] (nO)
CoF ()	**[Motor speed coeff.]** Speed reduction coefficient calculated by the drive for Ascending direction. The parameter can be accessed if [High speed hoisting] (HSO) = [Speed ref] (SSO).	0 to 100%	100%
Cor ()	**[Gen. speed coeff]** Speed reduction coefficient calculated by the drive for Descending direction. The parameter can be accessed if [High speed hoisting] (HSO) is not [No] (nO).	0 to 100%	50%
toS ()	**[Load measuring tm.]** Duration of speed step for measurement. The parameter can be accessed if [High speed hoisting] (HSO) is not [No] (nO).	0.1 s to 65 s	0.5 s
oSP ()	**[Measurement spd]** Speed stabilized for measurement. The parameter can be accessed if [High speed hoisting] (HSO) is not [No] (nO).	0 to [Rated motor freq.] (FrS)	40 Hz
CLo ()	**[High speed I Limit]** Current limitation at high speed. The parameter can be accessed if [High speed hoisting] (HSO) = [I Limit] (CSO). The adjustment range is limited to 1.36 In if [Switching freq.](SFr) page 61 is less than 2 kHz. **Note:** If the setting is less than 0.25 In, the drive may lock in [Output Phase Loss] (OPF) fault mode if this has been enabled (see page 228).	0 to 1.65 In (1)	In
SCL ()	**[I Limit. frequency]** Frequency threshold, above which the high-speed limitation current is active. The parameter can be accessed if [High speed hoisting] (HSO) = [I Limit] (CSO)	0 to 500 or 599 Hz according to rating	40 Hz
rSd nO dri PES	**[Rope slack config.]** Rope slack function. The parameter can be accessed if [High speed hoisting] (HSO) is not [No] (nO). ☐ **[No]** (nO): Function inactive ☐ **[Drive estim.]** (drl): Measurement of the load by estimating the torque generated by the drive. ☐ **[Ext. sensor]** (PES): Measurement of the load using a weight sensor, can only be assigned if [Weight sensor ass.] (PES) page 171 is not [No] (nO).		[No] (nO)
rStL	**[Rope slack trq level]** Adjustment threshold corresponding to a load weighing slightly less than the hook when off-load, as a % of the rated load. The parameter can be accessed if [Rope slack trq level] (rSd) has been assigned.	0 to 100%	0%


(1) In corresponds to the rated drive current indicated in the Installation Manual and on the drive nameplate.

() Parameter that can be modified during operation or when stopped.

PID regulator

Block diagram

The function is activated by assigning an analog input to the PID feedback (measurement).

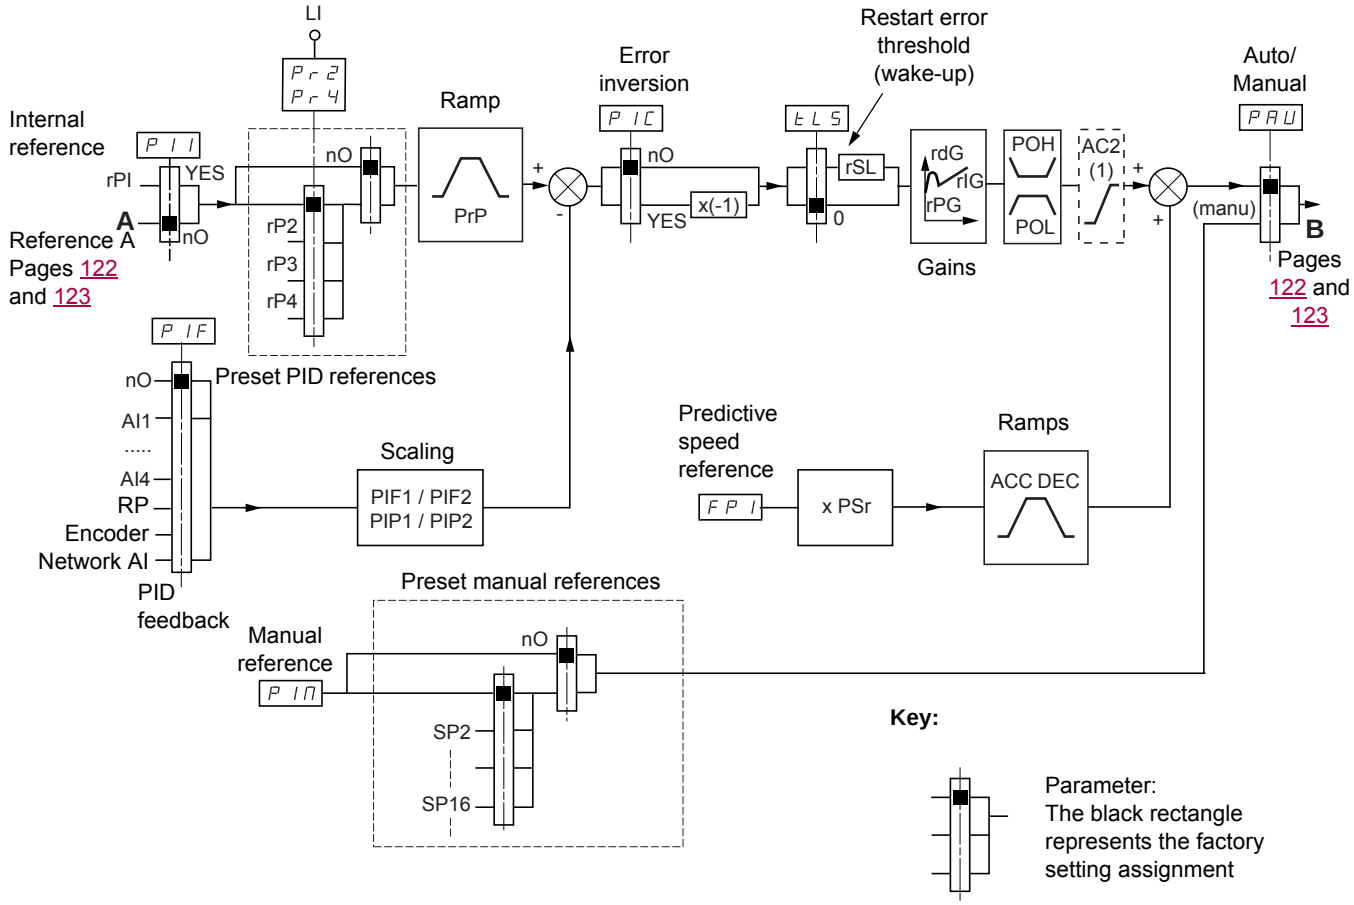

(1) Ramp AC2 is only active when the PID function starts up and during PID "wake-ups".

PID feedback:
The PID feedback must be assigned to one of the analog inputs AI1 to AI4, to the frequency input or the encoder, according to whether any extension cards have been inserted.

PID reference:
The PID reference must be assigned to the following parameters:

- Preset references via logic inputs (rP2, rP3, rP4)
- In accordance with the configuration of [Act. internal PID ref.] (PII) pages 181:
  - Internal reference (rPI) or
  - Reference A (Fr1 or Fr1b, see page 122)

Combination table for preset PID references

LI (Pr4)	LI (Pr2)	Pr2 = nO	Reference
			rPI or A
0	0		rPI or A
0	1		rP2
1	0		rP3
1	1		rP4

A predictive speed reference can be used to initialize the speed on restarting the process.

[1.7 APPLICATION FUNCT.] (FUn-)

Scaling of feedback and references:


- PIF1, PIF2 parameters
  Can be used to scale the PID feedback (sensor range).
  This scale MUST be maintained for all other parameters.

- PIP1, PIP2 parameters
  Can be used to scale the adjustment range, i.e., the reference. **The adjustment range MUST lie within the sensor range.**

  The maximum value of the scaling parameters is 32767. To facilitate installation, we recommend using values as close as possible to this maximum level, while retaining powers of 10 in relation to the actual values.

  Example (see graph below): Adjustment of the volume in a tank, between 6 m^3 and 15 m^3.
  - Sensor used 4-20 mA, 4.5 m^3 for 4 mA, 20 m^3 for 20 mA, with the result that PIF1 = 4500 and PIF2 = 20000.
  - Adjustment range 6 to 15 m^3, with the result that PIP1 = 6000 (min. reference) and PIP2 = 15000 (max. reference).
  - Example references:
    - rP1 (internal reference) = 9500
    - rp2 (preset reference) = 6500
    - rP3 (preset reference) = 8000
    - rP4 (preset reference) = 11200

  The [DISPLAY CONFIG.] menu can be used to customize the name of the unit displayed and its format.

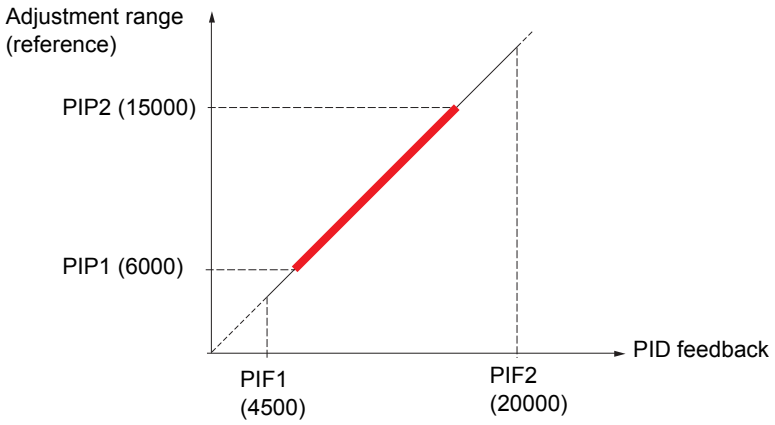

Other parameters:

- rSL parameter:
  Can be used to set the PID error threshold, above which the PID regulator will be reactivated (wake-up) after a stop due to the max. time threshold being exceeded at low speed (tLS).

- Reversal of the direction of correction (PIC): If PIC = nO, the speed of the motor will increase when the error is positive, for example: pressure control with a compressor. If PIC = YES, the speed of the motor will decrease when the error is positive, for example: temperature control using a cooling fan.

- The integral gain may be short-circuited by a logic input.

- An alarm on the PID feedback may be configured and indicated by a logic output.

- An alarm on the PID error may be configured and indicated by a logic output.

"Manual - Automatic" operation with PID

This function combines the PID regulator, the preset speeds and a manual reference. Depending on the state of the logic input, the speed reference is given by the preset speeds or by a manual reference input via the PID function.

Manual reference (PIM)

- Analog inputs AI1 to AI4
- Frequency input
- Encoder

Predictive speed reference (FPI)

- [AI1] (AI1): Analog input
- [AI2] (AI2): Analog input
- [AI3] (AI3): Analog input, if VW3A3202 extension card has been inserted
- [AI4] (AI4): Analog input, if VW3A3202 extension card has been inserted
- [RP] (PI): Frequency input, if VW3A3202 extension card has been inserted
- [Encoder] (PG): Encoder input, if encoder card has been inserted
- [HMI] (LCC): Graphic display terminal
- [Modbus] (Mdb): Integrated Modbus
- [CANopen] (CAn): Integrated CANopen
- [Com. card] (nEt): Communication card (if inserted)
- [C.Insid. card] (APP): Controller Inside card (if inserted)

Setting up the PID regulator

1. **Configuration in PID mode**
   See the diagram on page 177.


2. **Perform a test in factory settings mode (in most cases, this will be sufficient).**
   To optimize the drive, adjust rPG or rIG gradually and independently and observe the effect on the PID feedback in relation to the reference.

3. **If the factory settings are unstable or the reference is incorrect**

   - Perform a test with a speed reference in Manual mode (without PID regulator) and with the drive on load for the speed range of the system:
     - In steady state, the speed must be stable and comply with the reference and the PID feedback signal must be stable.
     - In transient state, the speed must follow the ramp and stabilize quickly, and the PID feedback must follow the speed.
     If this is not the case, see the settings for the drive and/or sensor signal and wiring.

   - Switch to PID mode.
   - Set brA to no (no auto-adaptation of the ramp).
   - Set the PID ramp (PrP) to the minimum permitted by the mechanism without triggering an ObF fault.
   - Set the integral gain (rIG) to minimum.
   - Leave the derivative gain (rdG) at 0.
   - Observe the PID feedback and the reference.
   - Switch the drive ON/OFF a number of times or vary the load or reference rapidly a number of times.
   - Set the proportional gain (rPG) in order to ascertain the best compromise between response time and stability in transient phases (slight overshoot and 1 to 2 oscillations before stabilizing).
   - If the reference varies from the preset value in steady state, gradually increase the integral gain (rIG), reduce the proportional gain (rPG) in the event of instability (pump applications), find a compromise between response time and static precision (see diagram).
   - Lastly, the derivative gain may permit the overshoot to be reduced and the response time to be improved, although this will make it more difficult to obtain a compromise in terms of stability, as it depends on 3 gains.
   - Perform in-production tests over the whole reference range.

[1.7 APPLICATION FUNCT.] (FUn-)

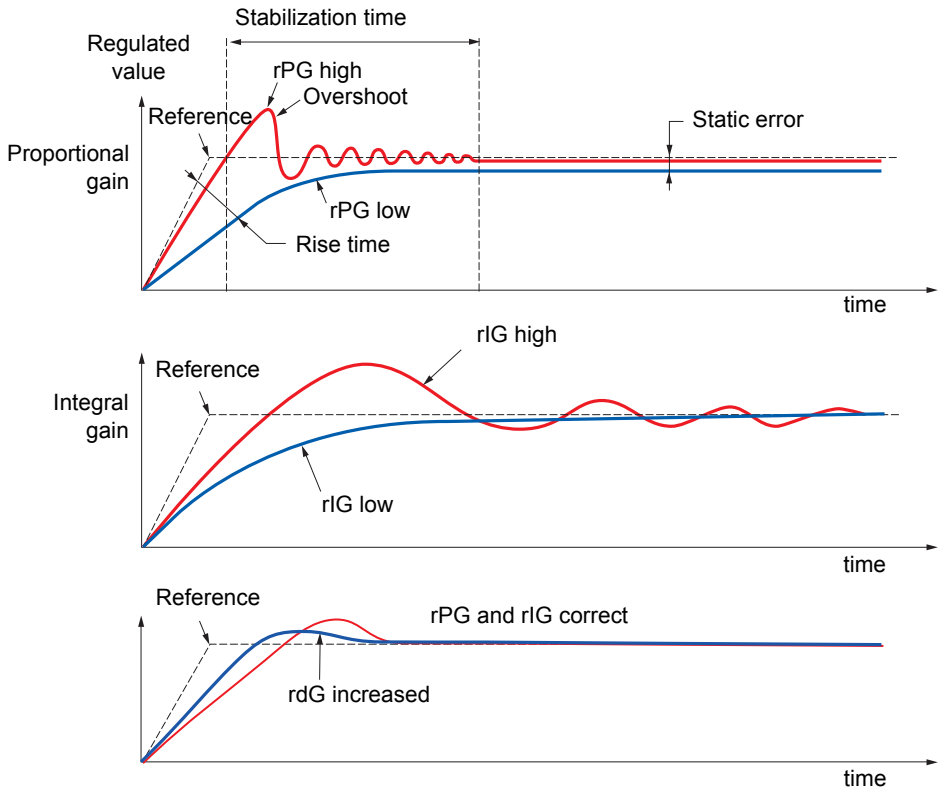

The oscillation frequency depends on the system kinematics.

Parameter	Rise time	Overshoot	Stabilization time	Static error
rPG ↗	↘↘	↗	=	↘
rIG ↗	↘	↗↗	↗	↘↘
rdG ↗	=	↘	↘	=

Code	Name/Description	Adjustment range	Factory setting
PId-	**[PID REGULATOR]** **Note:** This function cannot be used with certain other functions. Follow the instructions on page 133.		
PIF	**[PID feedback ass.]** ☐ **[No]** (nO): Not assigned (function inactive) In this case, none of the function parameters can be accessed. ☐ **[AI1]** (AI1): Analog input ☐ **[AI2]** (AI2): Analog input ☐ **[AI3]** (AI3): Analog input, if VW3A3202 extension card has been inserted ☐ **[AI4]** (AI4): Analog input, if VW3A3202 extension card has been inserted ☐ **[RP]** (PI): Frequency input, if VW3A3202 extension card has been inserted ☐ **[Encoder]** (PG): Encoder input, if encoder card has been inserted ☐ **[Network AI]** (AIU1): Virtual input via communication bus **Note:** If the equipment switches to forced local mode (see page 248), the virtual input remains fixed at the last value transmitted.		[No] (nO)
AICI	**[AI net. channel]** The parameter can be accessed if [PID feedback ass.] (PIF) = [Network AI] (AIU1). This parameter can also be accessed in the [1.5 INPUTS / OUTPUTS CFG] (I-O-) menu. ☐ **[No]** (nO): **Not assigned** ☐ **[Modbus]** (Mdb): Integrated Modbus ☐ **[CANopen]** (CAn): Integrated CANopen ☐ **[Com. card]** (nEt): Communication card (if inserted) ☐ **[C.Insid. card]** (APP): Controller Inside card (if inserted)		[No] (nO)
PIF1	**[Min PID feedback]** (1) Value for minimum feedback. Adjustment range from 0 to [Max PID feedback] (PIF2) (2).		100
PIF2	**[Max PID feedback]** (1) Value for maximum feedback Adjustment range from [Min PID feedback] (PIF1) to 32767 (2).		1000
PIP1	**[Min PID reference]** (1) Minimum process value. Adjustment range from [Min PID feedback] (PIF1) to [Max PID reference] (PIP2) (2).		150
PIP2	**[Max PID reference]** (1) Maximum process value Adjustment range from [Min PID reference] (PIP1) to [Max PID feedback] (PIF2) (2).		900
PII	**[Act. internal PID ref.]** Internal PID regulator reference ☐ **[No]** (nO): The PID regulator reference is given by Fr1 or Fr1b with summing/subtraction/multiplication functions (see the diagram on page 121). ☐ **[Yes]** (YES): The PID regulator reference is internal via parameter rPI.		[No] (nO)
rPI	**[Internal PID ref.]** Internal PID regulator reference This parameter can also be accessed in the [1.2 MONITORING] (SUP-) menu. Adjustment range from [Min PID reference] (PIP1) to [Max PID reference] (PIP2) (2).		150
rPG	**[PID prop. gain]** Proportional gain	0.01 to 100	1

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.
(2) If a graphic display terminal is not in use, values greater than 9999 will be displayed on the 4-digit display with a period mark after the thousand digit, e.g., 15.65 for 15650.

Parameter that can be modified during operation or when stopped.

[1.7 APPLICATION FUNCT.] (FUn-)

Code	Name/Description	Adjustment range	Factory setting
	[PID REGULATOR] (continued)		
rIG	**[PID integral gain]** Integral gain	0.01 to 100	1
rdG	**[PID derivative gain]** Derivative gain	0.00 to 100	0
PrP	**[PID ramp]** (1) PID acceleration/deceleration ramp, defined to go from [Min PID reference] (PIP1) to [Max PID reference] (PIP2) and vice versa.	0 to 99.9 s	0 s
PIC nO YES	**[PID correct. reverse]** ☐ **[No]** (nO) ☐ **[Yes]** (YES) Reversal of the direction of correction (PIC): If PIC = nO, the speed of the motor will increase when the error is positive. Example: pressure control with a compressor. If PIC = YES, the speed of the motor will decrease when the error is positive. Example: temperature control using a cooling fan.		[No] (nO)
PoL	**[Min PID output]** (1) Minimum value of regulator output in Hz	- 500 to 500 or -599 to 599 according to rating	0 Hz
PoH	**[Max PID output]** (1) Maximum value of regulator output in Hz	0 to 500 or 599 according to rating	60 Hz
PAL	**[Min fbk alarm]** (1) Minimum monitoring threshold for regulator feedback Adjustment range from [Min PID feedback] (PIF1) to [Max PID feedback] (PIF2) (2).		100
PAH	**[Max fbk alarm]** (1) Maximum monitoring threshold for regulator feedback Adjustment range from [Min PID feedback] (PIF1) to [Max PID feedback] (PIF2) (2).		1000
PEr	**[PID error Alarm]** (1) Regulator error monitoring threshold	0 to 65535 (2)	100
PIS nO LI1 - - -	**[PID integral reset]** ☐ **[No]** (nO): Function inactive ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. If the assigned input or bit is at 0, the function is inactive (the PID integral is enabled). If the assigned input or bit is at 1, the function is active (the PID integral is disabled).		[No] (nO)

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.
(2) If a graphic display terminal is not in use, values greater than 9999 will be displayed on the 4-digit display with a period mark after the thousand digit,
e.g., 15.65 for 15650.

Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting
	[PID REGULATOR] (continued)		
FPI	**[Speed ref. assign.]**		[No] (nO)
	PID regulator predictive speed input ☐ **[No]** (nO): Not assigned (function inactive) ☐ **[AI1]** (AI1): Analog input ☐ **[AI2]** (AI2): Analog input ☐ **[AI3]** (AI3): Analog input, if VW3A3202 extension card has been inserted ☐ **[AI4]** (AI4): Analog input, if VW3A3202 extension card has been inserted ☐ **[HMI]** (LCC): Graphic display terminal ☐ **[Modbus]** (Mdb): Integrated Modbus ☐ **[CANopen]** (CAn): Integrated CANopen ☐ **[Com. card]** (nEt): Communication card (if inserted) ☐ **[C.Insid. card]** (APP): Controller Inside card (if inserted) ☐ **[RP]** (PI): Frequency input, if VW3A3202 extension card has been inserted ☐ **[Encoder]** (PG): Encoder input, if encoder card has been inserted		
PSr	**[Speed input %]** (1)	1 to 100%	100%
	Multiplying coefficient for predictive speed input. The parameter cannot be accessed if [Speed ref. assign.] (FPI) = [No] (nO).		
PAU	**[Auto/Manual assign.]**		[No] (nO)
	☐ **[No]** (nO): The PID is always active. ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. If the assigned input or bit is at 0, the PID is active. If the assigned input or bit is at 1, manual operation is active.		
AC2	**[Acceleration 2]** (1)	0.01 to 6000 s (3)	5.0 s
	Time to accelerate from 0 to the [Rated motor freq.] (FrS). Make sure that this value is compatible with the inertia being driven. Ramp AC2 is only active when the PID function starts up and during PID "wake-ups".		
PIM	**[Manual reference]**		[No] (nO)
	Manual speed input. The parameter can be accessed if [Auto/Manual assign.] (PAU) is not [No] (nO). ☐ **[No]** (nO): Not assigned (function inactive) ☐ **[AI1]** (AI1): Analog input ☐ **[AI2]** (AI2): Analog input ☐ **[AI3]** (AI3): Analog input, if VW3A3202 extension card has been inserted ☐ **[AI4]** (AI4): Analog input, if VW3A3202 extension card has been inserted ☐ **[RP]** (PI): Frequency input, if VW3A3202 extension card has been inserted ☐ **[Encoder]** (PG): Encoder input, if encoder card has been inserted The preset speeds are active on the manual reference if they have been configured.		

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.
(2) If a graphic display terminal is not in use, values greater than 9999 will be displayed on the 4-digit display with a period mark after the thousand digit,
e.g., 15.65 for 15650.
(3) Range 0.01 to 99.99 s or 0.1 to 999.9 s or 1 to 6000 s according to [Ramp increment] (Inr) page 140.

Parameter that can be modified during operation or when stopped.

[1.7 APPLICATION FUNCT.] (FUn-)

Code	Name/Description	Adjustment range	Factory setting
	[PID REGULATOR] (continued)		
tLS	**[Low speed time out]** (1) Maximum operating time at [Low speed] (LSP) (see page 44) Following operation at LSP for a defined period, a motor stop is requested automatically. The motor restarts if the reference is greater than LSP and if a run command is still present. Caution: Value 0 corresponds to an unlimited period. **Note:** If [Low speed time out] (tLS) is not 0, [Type of stop] (Stt) page 144 is forced to [Ramp stop] (rMP) (only if a ramp stop can be configured).	0 to 999.9 s	0 s
rSL	**[PID wake up thresh.]** If the "PID" and "Low speed operating time" tLS functions are configured at the same time, the PID regulator may attempt to set a speed lower than LSP. This results in unsatisfactory operation, which consists of starting, operating at low speed then stopping, and so on… Parameter rSL (restart error threshold) can be used to set a minimum PID error threshold for restarting after a stop at prolonged LSP. The function is inactive if tLS = 0 or if rSL = 0. **WARNING** **UNINTENDED EQUIPMENT OPERATION** Check that unintended restarts will not present any danger. **Failure to follow these instructions can result in death or serious injury.**	0.0 to 100.0	0

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.


Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting
Pr1-	**[PID PRESET REFERENCES]** Function can be accessed if [PID feedback ass.] (PIF) is assigned.		
Pr2 nO LI1 - - -	**[2 preset PID ref.]** ☐ **[No]** (nO): Function inactive ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. If the assigned input or bit is at 0, the function is inactive. If the assigned input or bit is at 1, the function is active.		[No] (nO)
Pr4 nO LI1 - - -	**[4 preset PID ref.]** Make sure that [2 preset PID ref.] (Pr2) has been assigned before assigning this function. ☐ **[No]** (nO): Function inactive ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. If the assigned input or bit is at 0, the function is inactive. If the assigned input or bit is at 1, the function is active.		[No] (nO)
rP2 ( )	**[2 preset PID ref.]** (1) The parameter can be accessed if [Preset ref. PID 2] (Pr2) is assigned. Adjustment range from [Min PID reference] (PIP1) to [Max PID reference] (PIP2) (2).		300
rP3 ( )	**[3 preset PID ref.]** (1) The parameter can be accessed if [Preset ref. PID 4] (Pr4) is assigned. Adjustment range from [Min PID reference] (PIP1) to [Max PID reference] (PIP2) (2).		600
rP4 ( )	**[4 preset PID ref.]** (1) The parameter can be accessed if [Preset ref. PID 4] (Pr4) is assigned. Adjustment range from [Min PID reference] (PIP1) to [Max PID reference] (PIP2) (2).		900

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.
(2) If a graphic display terminal is not in use, values greater than 9999 will be displayed on the 4-digit display with a period mark after the thousand digit, e.g., 15.65 for 15650.

( ) Parameter that can be modified during operation or when stopped.

Torque regulation

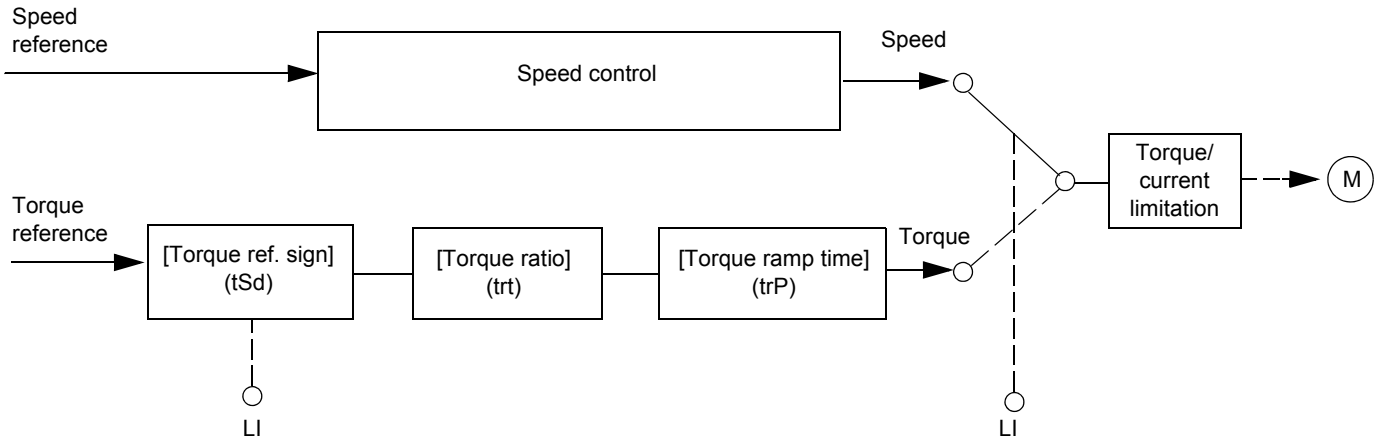


The function can be used to switch between operation in speed regulation mode and operation in torque control mode.
In torque control mode, the speed may vary within a configurable "deadband". When it reaches a lower or upper limit, the drive automatically reverts to speed regulation mode (fallback) and remains at this limit speed. The regulated torque is therefore no longer maintained and two scenarios may occur.

- If the torque returns to the required value, the drive will return to torque control mode.
- If the torque does not return to the required value at the end of a configurable period of time, the drive will switch to fault or alarm mode.

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION

Check that the changes in the behavior of the motor do not present any danger.
Failure to follow these instructions can result in death or serious injury.

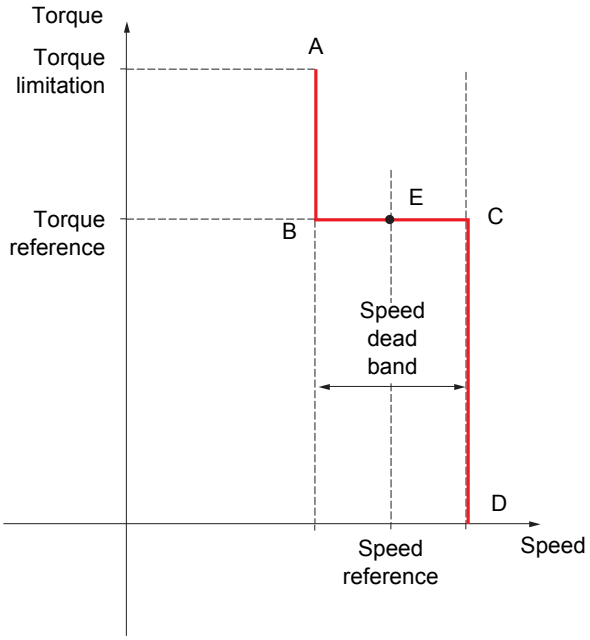

- AB and CD: "Fallback" to speed regulation
- BC: Torque control zone
- E: Ideal operating point

The torque sign and value can be transmitted via a logic output and an analog output.

Code	Name/Description	Adjustment range	Factory setting
tor-	**[TORQUE CONTROL]** This function can only be accessed for [Motor control type] (Ctt) = [SVC I] (CUC) or [FVC] (FUC). **Note 1:** This function cannot be used with certain other functions. Follow the instructions on page 133. **Note 2:** This function is not compatible with the fault management of [Load slipping] (AnF).		
tSS no YES LI1 - - -	**[Trq/spd switching]** ☐ **[No]** (nO): Function inactive, thereby preventing access to other parameters. ☐ **[Yes]** (YES): Permanent torque control ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. If the assigned input or bit is at 1: Torque control If the assigned input or bit is at 0: Speed regulation		[No] (nO)
trI no AI1 AI2 AI3 AI4 LCC Mdb CAn nEt APP PI PG	**[Torque ref. channel]** ☐ **[No]** (nO): Not assigned (zero torque reference). ☐ **[AI1]** (AI1): Analog input ☐ **[AI2]** (AI2): Analog input ☐ **[AI3]** (AI3): Analog input, if VW3A3202 I/O card has been inserted ☐ **[AI4]** (AI4): Analog input, if VW3A3202 I/O card has been inserted ☐ **[HMI]** (LCC): Graphic display terminal ☐ **[Modbus]** (Mdb): Integrated Modbus ☐ **[CANopen]** (CAn): Integrated CANopen ☐ **[Com. card]** (nEt): Communication card (if inserted) ☐ **[C.Insid. card]** (APP): Controller Inside card (if inserted) ☐ **[RP]** (PI): Frequency input, if VW3A3202 I/O card has been inserted ☐ **[Encoder]** (PG): Encoder input, if encoder card has been inserted 100% of the reference corresponds to 300% of the rated torque.		[No] (nO)
tSd no LI1 - - -	**[Torque ref. sign]** ☐ **[No]** (nO): Function inactive ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. If the assigned input or bit is at 0, the torque sign is the same as the reference. If the assigned input or bit is at 1, the torque sign is the opposite of the reference.		[No] (nO)
trt ( )	**[Torque ratio]** Coefficient applied to [Torque reference] (tr1).	0 to 1000%	100%
trP ( )	**[Torque ramp time]** Rise and fall time for a variation of 100% of the rated torque.	0 to 99.99 s	3 s
tSt SPd YES SPn	**[Torque control stop]** ☐ **[Speed]** (SPd): Speed regulation stop, in accordance with the type of stop configuration (see page 144) ☐ **[Freewheel]** (YES): Freewheel stop ☐ **[Spin]** (SPn): Zero torque stop, but maintaining the flux in the motor. This type of operation is only possible if [Motor control type] (Ctt) = [FVC] (FUC).		[Speed] (SPd)
SPt ( )	**[Spin time]** The parameter can be accessed if [Torque control stop] (tSt) = [Spin] (SPn) Spin time following stop, in order to remain ready to restart quickly.	0 to 3600 s	1

( ) Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting
	[TORQUE CONTROL] (continued)		
dbP	**[Positive deadband]** Positive deadband. Value added algebraically to the speed reference. Example for dbP = 10: • If reference = +50 Hz: + 50 + 10 = 60 • If reference = - 50 Hz: - 50 + 10 = - 40	0 to 2 x [Max frequency] (tFr)	10 Hz
dbn	**[Negative deadband]** Negative deadband. Value subtracted algebraically from the speed reference. Example for dbn = 10: • If reference = +50 Hz: + 50 - 10 = 40 • If reference = - 50 Hz: - 50 - 10 = - 60	0 to 2 x [Max frequency] (tFr)	10 Hz
rto	**[Torque ctrl time out]** Time following automatic exit of torque control mode in the event of a fault or alarm.	0 to 999.9 s	60
tob	**[Torq. ctrl fault mgt]** Response of drive once time [Torque ctrl time out] (rtO) has elapsed.		[Alarm] (ALrM)
ALrM	☐ **[Alarm]** (ALrM)		
FLt	☐ **[Fault]** (FLt) : Fault with freewheel stop.		

Note: If the motor is equipped with an encoder assigned to speed feedback, the "torque control" function will trigger a [Load slipping] (AnF) fault. One of the following solutions should be applied:
• Set [Load slip detection] (Sdd) page 237 = [No] (nO).
• Set both [Positive deadband] (dbP) and [Negative deadband] (dbn) to a value less than 10% of the rated motor frequency.


Parameter that can be modified during operation or when stopped.

Torque limitation

There are two types of torque limitation:

- With a value that is fixed by a parameter
- With a value that is set by an analog input (AI, pulse or encoder)

If both types are enabled, the lowest value is taken into account. The two types of limitation can be configured or switched remotely using a logic input or via the communication bus.

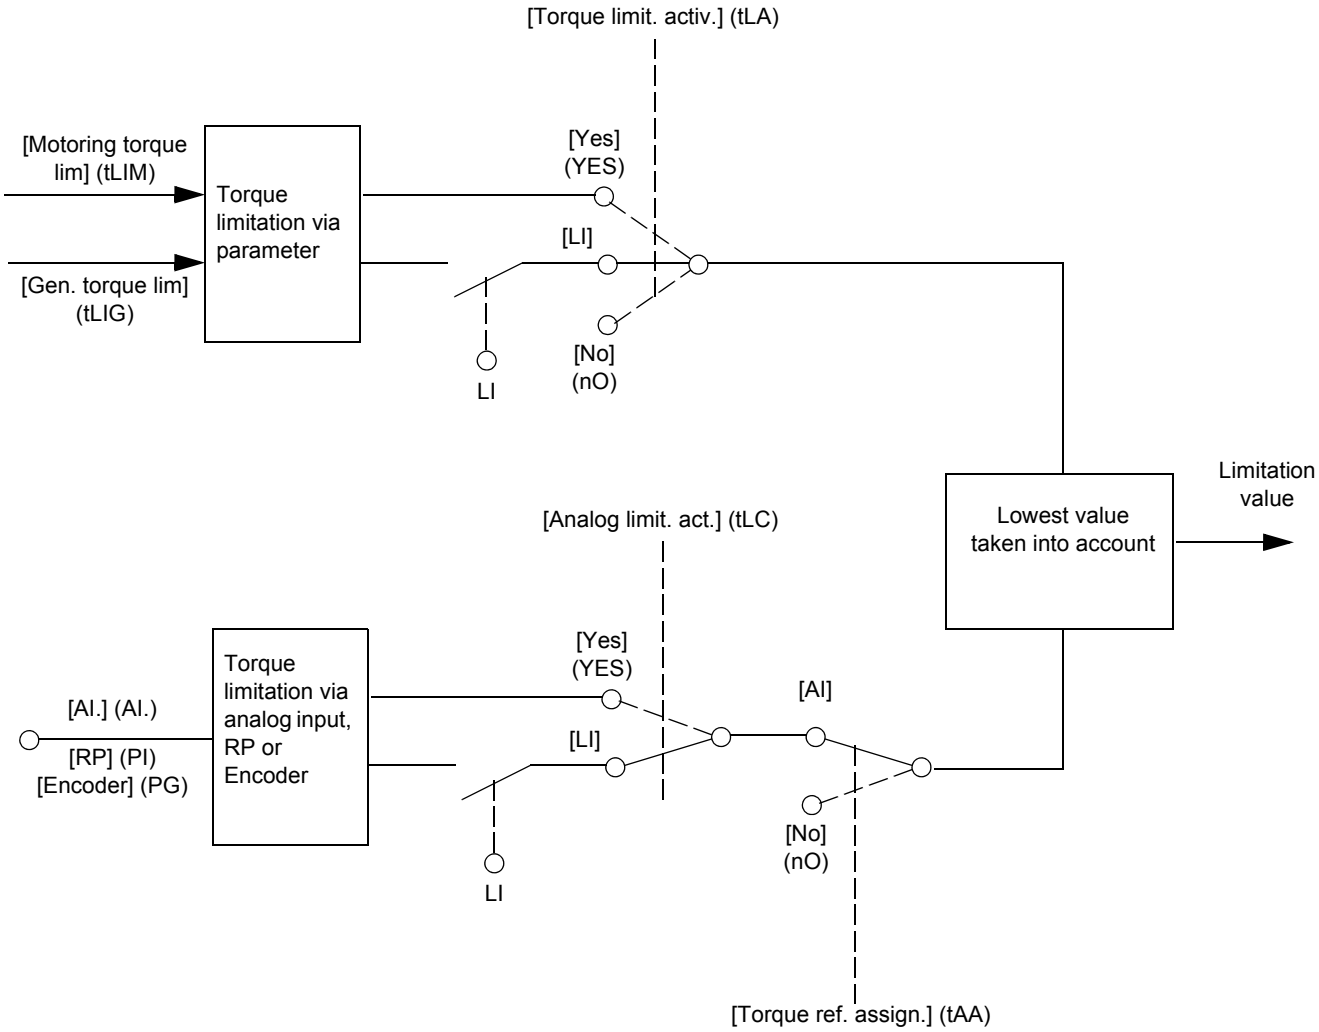

Code	Name/Description	Adjustment range	Factory setting
tOL-	**[TORQUE LIMITATION]** This function cannot be accessed in V/F profile mode.		
tLA	**[Torque limit. activ.]** ☐ **[No]** (nO): Function inactive ☐ **[Yes]** (YES): Function always active ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. If the assigned input or bit is at 0, the function is inactive. If the assigned input or bit is at 1, the function is active.		[No] (nO)
intP	**[Torque increment]** The parameter cannot be accessed if [Torque limit. activ.] (tLA) = [No] (nO) Selection of units for the [Motoring torque lim] (tLIM) and [Gen. torque lim] (tLIG) parameters. ☐ **[0,1%]** (0.1) : unit 0.1%. ☐ **[1%]** (1): unit 1%.		[1 %] (1)
tLIM	**[Motoring torque lim]** (1) The parameter cannot be accessed if [Torque limit. activ.] (tLA) = [No] (nO) Torque limitation in motor mode, as a % or in 0.1% increments of the rated torque in accordance with the [Torque increment] (IntP) parameter.	0 to 300%	100%
tLIG	**[Gen. torque lim]** (1) The parameter cannot be accessed if [Torque limit. activ.] (tLA) = [No] (nO) Torque limitation in generator mode, as a % or in 0.1% increments of the rated torque in accordance with the [Torque increment] (IntP) parameter.	0 to 300%	100%
tAA	**[Torque ref. assign.]** If the function is assigned, the limitation varies between 0% and 300% of the rated torque on the basis of the 0% to 100% signal applied to the assigned input. Examples: - 12 mA on a 4-20 mA input results in limitation to 150% of the rated torque. - 2.5 V on a 10 V input results in 75% of the rated torque. ☐ **[No]** (nO): Not assigned (function inactive) ☐ **[AI1]** (AI1) to **[AI4]** (AI4): Analog input, if VW3A3202 I/O card has been inserted ☐ **[RP]** (PI): Frequency input, if VW3A3202 I/O card has been inserted ☐ **[Encoder]** (PG): Encoder input, if encoder card has been inserted ☐ **[Network AI]** (AIU1): Virtual input via communication bus, to be configured via [AI net. channel] (AIC1) page 101.		[No] (nO)

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION

If the equipment switches to forced local mode (see page 248), the virtual input remains fixed at the last value transmitted.

Do not use the virtual input and forced local mode in the same configuration.

Failure to follow these instructions can result in death or serious injury.

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.

Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting
	[TORQUE LIMITATION] (continued)		
tLC YES LI1 - - -	**[Analog limit. act.]** The parameter can be accessed if [Torque ref. assign.] (tAA) is not [No] (nO). ☐ **[Yes]** (YES): The limitation depends on the input assigned by [Torque ref. assign.] (tAA). ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. If the assigned input or bit is at 0: • The limitation is specified by the [Motoring torque lim] (tLIM) and [Gen. torque lim.] parameters (tLIG) if [Torque limit. activ.] (tLA) is not [No] (nO). • No limitation if [Torque limit. activ.] (tLA) = [No] (nO). If the assigned input or bit is at 1: • The limitation depends on the input assigned by [Torque ref. assign.] (tAA). **Note:** If [Torque limitation] (tLA) and [Torque ref. assign.] (tAA) are enabled at the same time, the lowest value will be taken into account.		[Yes] (YES)
tPMM ( )	**[Pmax Motor]** Maximum power in motor mode The parameter cannot be accessed if [Torque limit. activ.] (tLA) = [No] (nO)	10 to 300%	300%
tPMG ( )	**[Pmax Generator]** Maximum power in generator mode The parameter cannot be accessed if [Torque limit. activ.] (tLA) = [No] (nO)	10 to 300%	300%

( ) Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting
CL1-	**[2nd CURRENT LIMIT.]**		
LC2	**[Current limit 2]**		[No] (nO)
	☐ **[No]** (nO): Function inactive. ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. If the assigned input or bit is at 0, the first current limitation is active. If the assigned input or bit is at 1, the second current limitation is active.		
CL2	**[I Limit. 2 value]** (1)	0 to 1.65 In (2)	1.5 In (2)
	Second current limitation The parameter can be accessed if [Current limit 2] (LC2) is not [No] (nO). The adjustment range is limited to 1.36 In if [Switching freq.] (SFr) page 61 is less than 2 kHz. **Note:** If the setting is less than 0.25 In, the drive may lock in [Output Phase Loss] (OPF) fault mode if this has been enabled (see page 228). If it is less than the no-load motor current, the limitation no longer has any effect. **CAUTION** Check that the motor will withstand this current, particularly in the case of permanent magnet synchronous motors, which are susceptible to demagnetization. **Failure to follow this instruction can result in equipment damage.**		
CL1	**[Current Limitation]** (1)	0 to 1.65 In (2)	1.5 In (2)
	First current limitation The adjustment range is limited to 1.36 In if [Switching freq.] (SFr) page 61 is less than 2 kHz. **Note:** If the setting is less than 0.25 In, the drive may lock in [Output Phase Loss] (OPF) fault mode if this has been enabled (see page 228). If it is less than the no-load motor current, the limitation no longer has any effect. **CAUTION** Check that the motor will withstand this current, particularly in the case of permanent magnet synchronous motors, which are susceptible to demagnetization. **Failure to follow this instruction can result in equipment damage.**		

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.
(2) In corresponds to the rated drive current indicated in the Installation Manual and on the drive nameplate.


Parameter that can be modified during operation or when stopped.

Line contactor command

The line contactor closes every time a run command (forward or reverse) is sent and opens after every stop, as soon as the drive is locked. For example, if the stop mode is stop on ramp, the contactor will open when the motor reaches zero speed.

Note: The drive control power supply must be provided via an external 24 V source.

Example circuit:

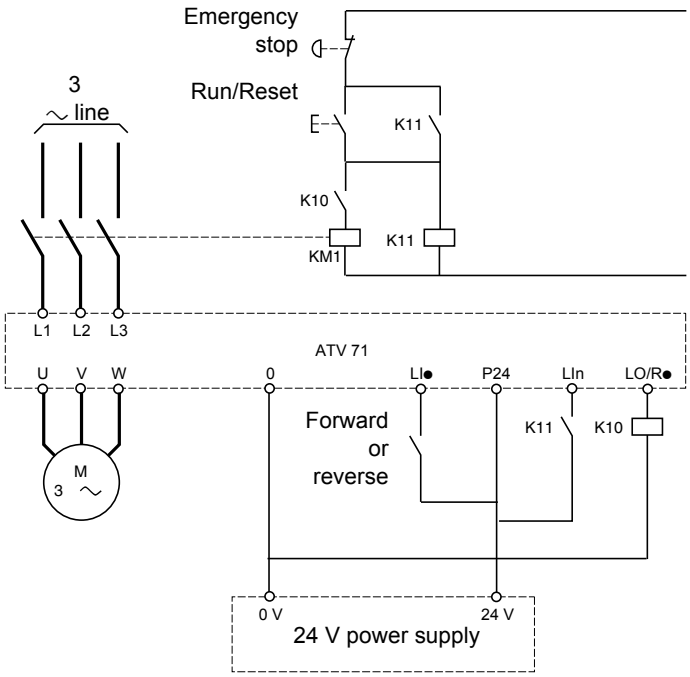

Note: The "Run/Reset" button must be pressed once the "Emergency stop" button has been released.

LI● = Run command [Forward] or [Reverse]
LO/R● ? [Line contactor ass.] (LLC)
LIn = [Drive lock] (LES)

CAUTION
This function can only be used for a small number of consecutive operations with a cycle time longer than 60 s (in order to avoid premature aging of the filter capacitor charging circuit). **Failure to follow this instruction can result in equipment damage.**

Code	Name/Description	Adjustment range	Factory setting
LLC-	**[LINE CONTACTOR COMMAND]**		
LLC	**[Line contactor ass.]**		[No] (nO)
	Logic output or control relay ☐ **[No]** (nO): Function not assigned (in this case, none of the function parameters can be accessed). ☐ **[LO1]** (LO1) to **[LO4]** (LO4): Logic output (if one or two I/O cards have been inserted, LO1 to LO2 or LO4 can be selected). **[R2]** (r2) to **[R4]** (r4): Relay (selection of R2 extended to R3 or R4 if one or two I/O cards have been inserted). ☐ **[dO1]** (dO1): Analog output AO1 functioning as a logic output. Selection can be made if [AO1 assignment] (AO1) page 114 = [No] (nO).		
LES	**[Drive lock]**		[No] (nO)
	☐ **[No]** (nO): Function inactive. ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. The drive locks when the assigned input or bit changes to 0.		
LCt	**[Mains V. time out]**	5 to 999 s	5 s
	Monitoring time for closing of line contactor. If, once this time has elapsed, there is no voltage on the drive power circuit, the drive will lock with a "Line contactor" fault (LCF).		

Output contactor command


This allows the drive to control a contactor located between the drive and the motor. The request for the contactor to close is made when a run command is sent. The request for the contactor to open is made when there is no longer any current in the motor.

CAUTION
If a DC injection braking function has been configured it should not be left operating too long in stop mode, as the contactor only opens at the end of braking. **Failure to follow this instruction can result in equipment damage.**

Output contactor feedback

The corresponding logic input should be at 1 when there is no run command and at 0 during operation.
In the event of an inconsistency, the drive trips on an FCF2 fault if the output contactor fails to close (LIx at 1) and on an FCF1 fault if it is stuck (LIx at 0).
The parameter [Delay to motor run] (dbS) can be used to delay tripping in fault mode when a run command is sent and the [Delay to open cont.] (dAS) parameter delays the fault when a stop command is set.

Note:
Fault FCF2 (contactor failing to close) can be reset by the run command changing state from 1 to 0 (0 --> 1 --> 0 in 3-wire control).

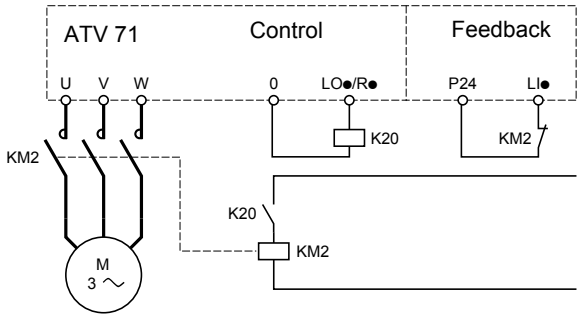

The [Out. contactor ass.] (OCC) and [Output contact. fdbk] (rCA) functions can be used individually or together.

Code	Name/Description	Adjustment range	Factory setting
oCC-	**[OUTPUT CONTACTOR CMD]**		
oCC	**[Out. contactor ass.]**		[No] (nO)
	Logic output or control relay ☐ **[No]** (nO): Function not assigned (in this case, none of the function parameters can be accessed). ☐ **[LO1]** (LO1) to **[LO4]** (LO4): Logic output (if one or two I/O cards have been inserted, LO1 to LO2 or LO4 can be selected). **[R2]** (r2) to **[R4]** (r4): Relay (selection of R2 extended to R3 or R4 if one or two I/O cards have been inserted). ☐ **[dO1]** (dO1): Analog output AO1 functioning as a logic output. Selection can be made if [AO1 assignment] (AO1) page 114 = [No] (nO).		
rCA	**[Output contact. fdbk]**		[No] (nO)
	☐ **[No]** (nO): Function inactive ☐ **[LI1]** (LI1) : : ☐ **[...]** (...) : See the assignment conditions on page 127. The motor starts up when the assigned input or bit changes to 0.		
dbS	**[Delay to motor run]**	0.05 to 60 s	0.15
	Time delay for: • Motor control following the sending of a run command • Output contactor fault monitoring, if the feedback is assigned. If the contactor fails to close at the end of the set time, the drive will lock in FCF2 fault mode. This parameter can be accessed if [Out. contactor ass.] (OCC) is assigned or if [Output contact. fdbk] (rCA) is assigned. The time delay must be greater than the closing time of the output contactor.		
dAS	**[Delay to open cont.]**	0 to 5.00 s	0.10
	Time delay for output contactor opening command following motor stop. This parameter can be accessed if [Output contact. fdbk] (rCA) is assigned. The time delay must be greater than the opening time of the output contactor. If it is set to 0, the fault will not be monitored. If the contactor fails to open at the end of the set time, the drive will lock in FCF1 fault mode.		


Parameter that can be modified during operation or when stopped.

Positioning by sensors or limit switches

This function is used for managing positioning using position sensors or limit switches linked to logic inputs or using control word bits:

- Slowing down
- Stopping

The action logic for the inputs and bits can be configured on a rising edge (change from 0 to 1) or a falling edge (change from 1 to 0). The example below has been configured on a rising edge:

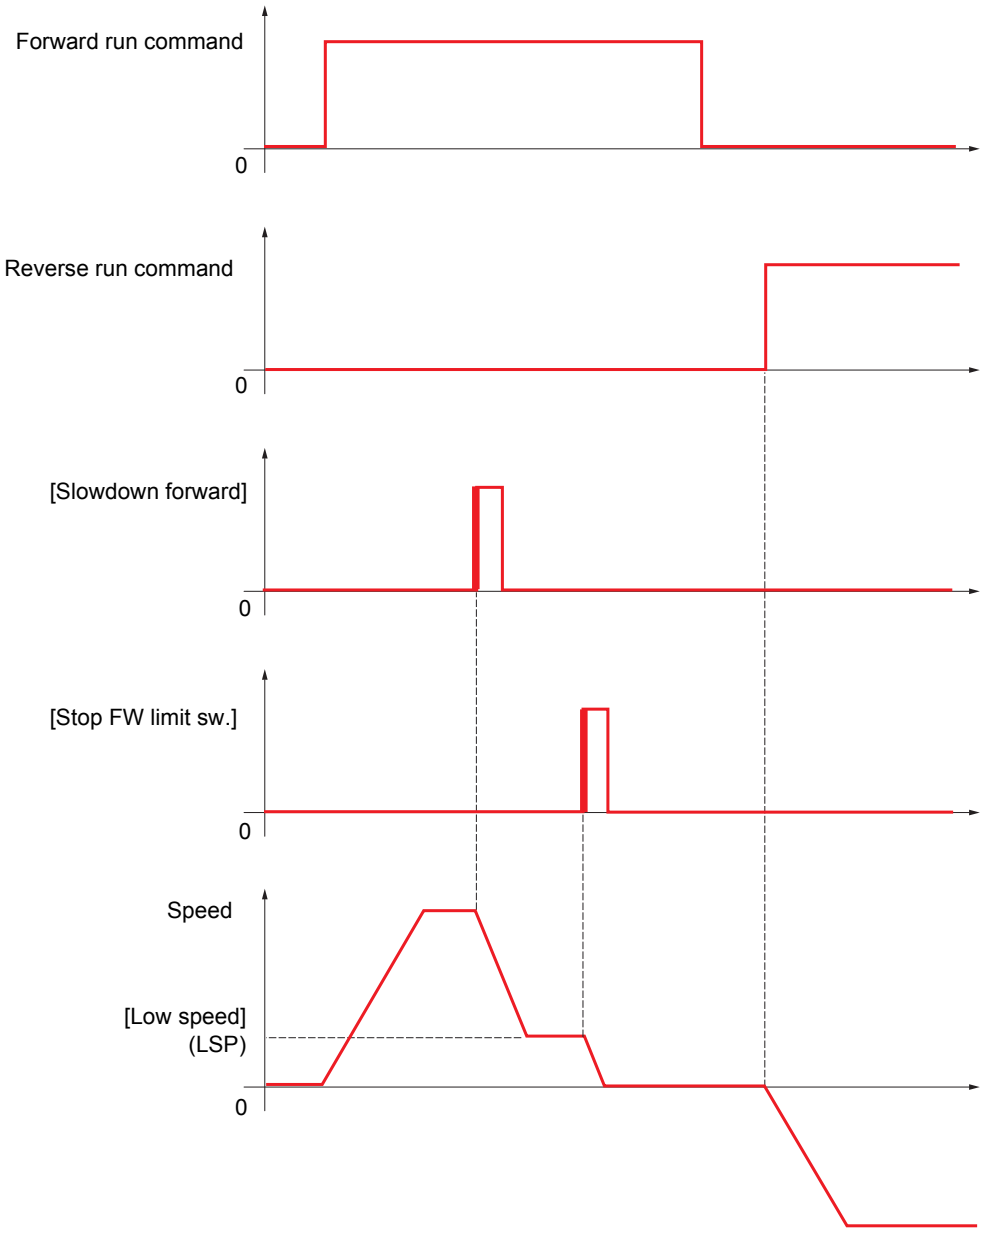


The slowdown mode and stop mode can be configured.
The operation is identical for both directions of operation. Slowdown and stopping operate according to the same logic, described below.

Example: Forward slowdown, on rising edge


- Forward slowdown takes place on a rising edge (change from 0 to 1) of the input or bit assigned to forward slowdown if this rising edge occurs in forward operation. The slowdown command is then memorized, even in the event of a power outage. Operation in the opposite direction is authorized at high speed. The slowdown command is deleted on a falling edge (change from 1 to 0) of the input or bit assigned to forward slowdown if this falling edge occurs in reverse operation.
- A bit or a logic input can be assigned to disable this function.
- Although forward slowdown is disabled while the disable input or bit is at 1, sensor changes continue to be monitored and saved.

Example: Positioning on a limit switch, on rising edge

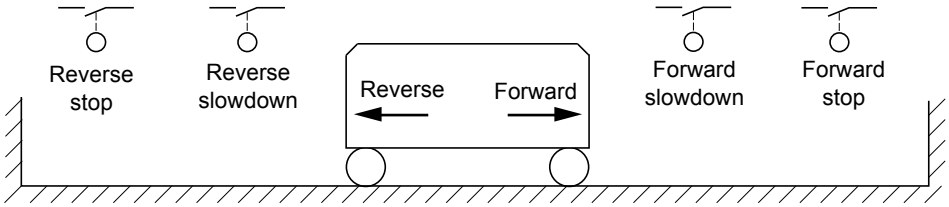


Operation with short cams:

In this instance, when operating for the first time or after restoring the factory settings, the drive must initially be started outside the slowdown and stop zones in order to initialize the function.

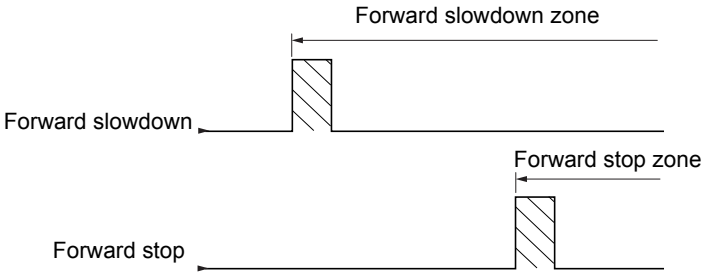

Operation with long cams:

In this instance, there is no restriction, which means that the function is initialized across the whole trajectory.

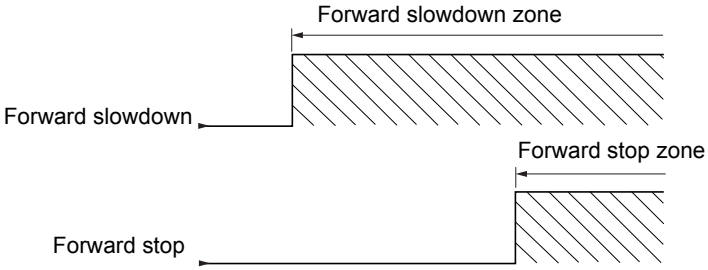


Stop at distance calculated after deceleration limit switch

This function can be used to control the stopping of the moving part automatically once a preset distance has been traveled after the slowdown limit switch.

On the basis of the rated linear speed and the speed estimated by the drive when the slowdown limit switch is tripped, the drive will induce the stop at the configured distance.
This function is useful in applications where one manual-reset overtravel limit switch is common to both directions. It will then only respond to ensure safety if the distance is exceeded. The stop limit switch retains priority in respect of the function.

The [Deceleration type] (dSF) parameter can be configured to obtain either of the functions described below:

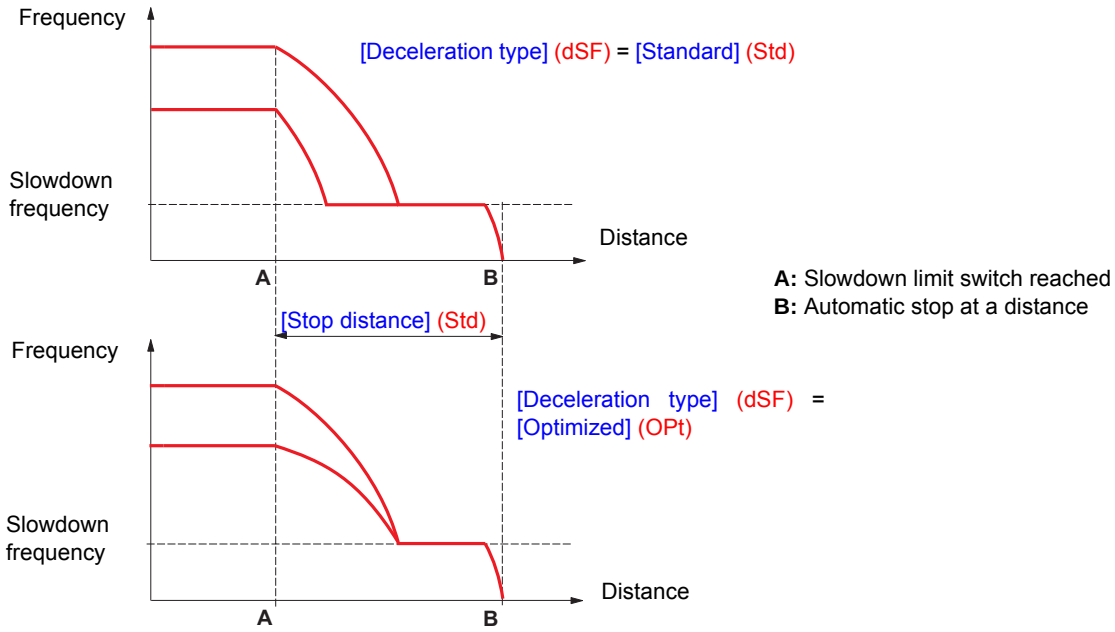

Note :

- If the deceleration ramp is modified while stopping at a distance is in progress, this distance will not be observed.
- If the direction is modified while stopping at a distance is in progress, this distance will not be observed.
- If the drive is shutdown while stopping at distance is in progress, this distance will not be observed on the next power-up.

.

⚠ DANGER

UNINTENDED EQUIPMENT OPERATION

- Check that the parameters configured are consistent (in particular, you should check that the required distance is possible).
- This function does not replace the stop limit switch, which remains necessary for safety reasons.

Failure to follow these instructions will result in death or serious injury.

Code	Name/Description	Adjustment range	Factory setting
LPo-	**[POSITIONING BY SENSORS]** **Note:** This function cannot be used with certain other functions. Follow the instructions on page 133.		
SAF	**[Stop FW limit sw.]** ☐ **[No]** (nO): Not assigned ☐ **[LI1]** (LI1) to **[LI6]** (LI6) ☐ **[LI7]** (LI7) to **[LI10]** (LI10): If VW3A3201 logic I/O card has been inserted ☐ **[LI11]** (LI11) to **[LI14]** (LI14): If VW3A3202 extended I/O card has been inserted ☐ **[C101]** (C101) to **[C115]** (C115): With integrated Modbus in [I/O profile] (IO) ☐ **[C201]** (C201) to **[C215]** (C215): With integrated CANopen in [I/O profile] (IO) ☐ **[C301]** (C301) to **[C315]** (C315): With a communication card in [I/O profile] (IO) ☐ **[C401]** (C401) to **[C415]** (C415): With a Controller Inside card in [I/O profile] (IO) ☐ **[CD00]** (Cd00) to **[CD13]** (Cd13): In [I/O profile] (IO) can be switched with possible logic inputs ☐ **[CD14]** (Cd14) to **[CD15]** (Cd15): In [I/O profile] (IO) can be switched without logic inputs		[No] (nO)
SAr	**[Stop RV limit sw.]** Same assignments possible as for [Stop FW limit sw.] (SAF) above.		[No] (nO)
SAL	**[Stop limit config.]** The parameter can be accessed if at least one limit switch or one stop sensor has been assigned. It defines the positive or negative logic of the bits or inputs assigned to the stop. ☐ **[Active low]** (LO): Stop controlled on a falling edge (change from 1 to 0) of the assigned bits or inputs. ☐ **[Active high]** (HIG): Stop controlled on a rising edge (change from 0 to 1) of the assigned bits or inputs.		[Active high] (HIG)
dAF	**[Slowdown forward]** Same assignments possible as for [Stop FW limit sw.] (SAF) above.		[No] (nO)
dAr	**[Slowdown reverse]** Same assignments possible as for [Stop FW limit sw.] (SAF) above.		[No] (nO)
dAL	**[Slowdown limit cfg.]** The parameter can be accessed if at least one limit switch or one slowdown sensor has been assigned. It defines the positive or negative logic of the bits or inputs assigned to the slowdown. ☐ **[Active low]** (LO): Slowdown controlled on a falling edge (change from 1 to 0) of the assigned bits or inputs. ☐ **[Active high]** (HIG): Slowdown controlled on a rising edge (change from 0 to 1) of the assigned bits or inputs.		[Active high] (HIG)

Code	Name/Description	Adjustment range	Factory setting
	[POSITIONING BY SENSORS] (continued)		
CLS	**[Disable limit sw.]**		[No] (nO)
	The parameter can be accessed if at least one limit switch or one sensor has been assigned. ☐ **[No]** (nO): Not assigned ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. The action of the limit switches is disabled when the assigned bit or input is at 1. If, at this time, the drive is stopped or being slowed down by limit switches, it will restart up to its speed reference.		
nO LI1 - - -			
PAS	**[Stop type]**		[Ramp stop] (rMP)
	The parameter can be accessed if at least one limit switch or one sensor has been assigned. ☐ **[Ramp stop]** (rMP): On ramp ☐ **[Fast stop]** (FSt): Fast stop (ramp time reduced by [Ramp divider] (dCF), see page 144) ☐ **[Freewheel]** (YES): Freewheel stop		
rMP FSt YES			
dSF	**[Deceleration type]**		[Standard] (Std)
	The parameter can be accessed if at least one limit switch or one sensor has been assigned. ☐ **[Standard]** (Std): Uses the [Deceleration] (dEC) or [Deceleration 2] (dE2) ramp (depending on which has been enabled). ☐ **[Optimized]** (OPt): The ramp time is calculated on the basis of the actual speed when the slowdown contact switches, in order to limit the operating time at low speed (optimization of the cycle time: the slowdown time is constant regardless of the initial speed).		
Std OPt			
Std	**[Stop distance]**		[No] (nO)
	The parameter can be accessed if at least one limit switch or one sensor has been assigned. Activation and adjustment of the "Stop at distance calculated after the slowdown limit switch" function. ☐ **[No]** (nO): Function inactive (the next two parameters will, therefore, be inaccessible). ☐ **0.01 yd to 10.94 yd**: Stop distance range in yards.		
nO -			
nLS	**[Rated linear speed]**	0.20 to 5.00 m/s	1.00 m/s
	The parameter can be accessed if at least one limit switch or one sensor has been assigned. Rated linear speed in meters/second.		
SFd	**[Stop corrector]**	50 to 200%	100%
	The parameter can be accessed if at least one limit switch or one sensor has been assigned. Scaling factor applied to the stop distance to compensate, for example, a non-linear ramp.		

Parameter set switching [PARAM. SET SWITCHING]

A set of 1 to 15 parameters from the [1.3 SETTINGS] (SEt-) menu on page 54 can be selected and 2 or 3 different values assigned. These 2 or 3 sets of values can then be switched using 1 or 2 logic inputs or control word bits. This switching can be performed during operation (motor running).
It can also be controlled on the basis of one or two frequency thresholds, whereby each threshold acts as a logic input (0 = threshold not reached, 1 = threshold reached).

	Values 1	Values 2	Values 3
Parameter 1 Parameter 2 Parameter 3 Parameter 4 Parameter 5 Parameter 6 Parameter 7 Parameter 8 Parameter 9 Parameter 10 Parameter 11 Parameter 12 Parameter 13 Parameter 14 Parameter 15	Parameter 1 Parameter 2 Parameter 3 Parameter 4 Parameter 5 Parameter 6 Parameter 7 Parameter 8 Parameter 9 Parameter 10 Parameter 11 Parameter 12 Parameter 13 Parameter 14 Parameter 15	Parameter 1 Parameter 2 Parameter 3 Parameter 4 Parameter 5 Parameter 6 Parameter 7 Parameter 8 Parameter 9 Parameter 10 Parameter 11 Parameter 12 Parameter 13 Parameter 14 Parameter 15	Parameter 1 Parameter 2 Parameter 3 Parameter 4 Parameter 5 Parameter 6 Parameter 7 Parameter 8 Parameter 9 Parameter 10 Parameter 11 Parameter 12 Parameter 13 Parameter 14 Parameter 15
Input LI or bit or frequency threshold 2 values	0	1	0 or 1
Input LI or bit or frequency threshold 3 values	0	0	1

Note: Do not modify the parameters in the [1.3 SETTINGS] (SEt-) menu, because any modifications made in this menu ([1.3 SETTINGS] (SEt-)) will be lost on the next power-up. The parameters can be adjusted during operation in the [PARAM. SET SWITCHING] (MLP-) menu, on the active configuration.

Note: Parameter set switching cannot be configured from the integrated display terminal.
Parameters can only be adjusted on the integrated display terminal if the function has been configured previously via the graphic display terminal, by PC-Software or via the bus or communication network. If the function has not been configured, the **MLP-** menu and the **PS1-**, **PS2-**, **PS3-** submenus will not appear.

Code	Name/Description	Adjustment range	Factory setting

nLP- [PARAM. SET SWITCHING]

CHA1 [2 parameter sets]

[No] (nO)

- ☐ **[No]** (nO): Function inactive.
- ☐ **[Freq. Th.att.]** (FtA): Switching via [Freq. threshold] (Ftd) page 68.
- ☐ **[Freq. Th. 2 attain.]** (F2A): Switching via [Freq. threshold 2] (Ftd) page 68.
- ☐ **[LI1]** (LI1)
  :
  :
- ☐ **[...]** (...): See the assignment conditions on page 127.

Switching 2 parameter sets

CHA2 [3 parameter sets]

[No] (nO)


- ☐ **[No]** (nO): Function inactive.
- ☐ **[Freq. Th.att.]** (FtA): Switching via [Freq. threshold] (Ftd) page 68.
- ☐ **[Freq. Th. 2 attain.]** (F2A): Switching via [Freq. threshold 2] (Ftd) page 68.
- ☐ **[LI1]** (LI1)
  :
  :
- ☐ **[...]** (...): See the assignment conditions on page 127.

Switching 3 parameter sets

Note: In order to obtain 3 parameter sets, [2 parameter sets] must also be configured.


[PARAMETER SELECTION]

The parameter can only be accessed on the graphic display terminal if [2 parameter sets] is not [No].
Making an entry in this parameter opens a window containing all the adjustment parameters that can be accessed.
Select 1 to 15 parameters using ENT (a tick then appears next to the parameter). Parameter(s) can also be deselected using ENT.
Example:

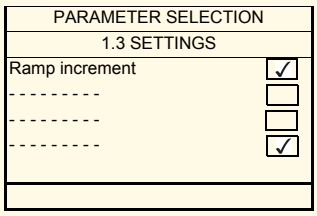

PS1- [SET 1]

The parameter can be accessed if at least 1 parameter has been selected in [PARAMETER SELECTION].
Making an entry in this parameter opens a settings window containing the selected parameters **in the order in which they were selected**.
With the graphic display terminal :

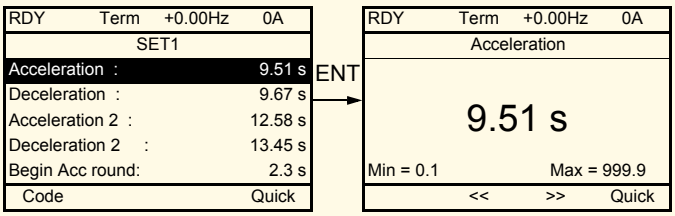

With the integrated display terminal:
Proceed as in the Settings menu using the parameters that appear.

Code	Name/Description	Adjustment range	Factory setting
	[PARAM. SET SWITCHING] (continued)		
PS2-	**[SET 2]** The parameter can be accessed if at least 1 parameter has been selected in [PARAMETER SELECTION]. Procedure identical to [SET 1] (PS1-).		
PS3-	**[SET 3]** The parameter can be accessed if [3 parameter sets] is not [No] and if at least 1 parameter has been selected in [PARAMETER SELECTION]. Procedure identical to [SET 1] (PS1-).		

Note: We recommend that a parameter set switching test is carried out while stopped and a check is made to ensure that it has been performed correctly.
Some parameters are interdependent and in this case may be restricted at the time of switching.

Interdependencies between parameters must be respected, even between different sets.

Example: The highest [Low speed] (LSP) must be below the lowest [High speed] (HSP).

Motor or configuration switching [MULTIMOTORS/CONFIG.]

The drive may contain up to 3 configurations, which can be saved using the [1.12 FACTORY SETTINGS] (FCS-) menu, page 252.
Each of these configurations can be activated remotely, enabling adaptation to:

- 2 or 3 different motors or mechanisms (multimotor mode)
- 2 or 3 different configurations for a single motor (multiconfiguration mode)

The two switching modes cannot be combined.

Note: The following conditions MUST be observed:

- Switching may only take place when stopped (drive locked). If a switching request is sent during operation, it will not be executed until the next stop.
- In the event of motor switching, the following additional conditions apply:
  - When the motors are switched, the power and control terminals concerned must also be switched as appropriate.
  - The maximum power of the drive must not be exceeded by any of the motors.
- All the configurations to be switched must be set and saved in advance in the same hardware configuration, this being the definitive configuration (option and communication cards). Failure to follow this instruction can cause the drive to lock on an [Incorrect config.] (CFF) fault.

Menu and parameters switched in multimotor mode

- [1.3 SETTINGS] (SEt-)
- [1.4 MOTOR CONTROL] (drC-)
- [1.5 INPUTS / OUTPUTS CFG] (I-O-)
- [1.6 COMMAND] (CtL-)
- [1.7 APPLICATION FUNCT.] (FUn-) with the exception of the [MULTIMOTORS/CONFIG.] function (to be configured once only)
- [1.8 FAULT MANAGEMENT] (FLt)
- [1.13 USER MENU]
- [USER CONFIG.]: The name of the configuration specified by the user in the [1.12 FACTORY SETTINGS] (FCS-) menu

Menu and parameters switched in multiconfiguration mode

As in multimotor mode, except for the motor parameters that are common to the three configurations:

- Rated current
- Thermal current
- Rated voltage
- Rated frequency
- Rated speed
- Rated power
- IR compensation
- Slip compensation
- Synchronous motor parameters
- Type of thermal protection
- Thermal state
- The auto-tuning parameters and motor parameters that can be accessed in expert mode
- Type of motor control


Note: No other menus or parameters can be switched.

Transfer of a drive configuration to another one, with graphic display terminal, when the drive uses [MULTIMOTORS/CONFIG.] function

Let A be the source drive and B the drive addressed. In this example, switching are controled by logic input.

1. Connect graphic display terminal to the drive A.
2. Put logic input LI ([2 Configurations] (CnF1)) and LI ([3 Configurations] (CnF2)) to 0.
3. Download configuration 0 in a file of graphic display terminal (example : file 1 of the graphic display terminal).
4. Put logic input LI ([2 Configurations] (CnF1)) to 1 and leave logic input LI ([3 Configurations] (CnF2)) to 0.
5. Download configuration 1 in a file of graphic display terminal (example : file 2 of the graphic display terminal).
6. Put logic input LI ([3 Configurations] (CnF2)) to 1 and leave logic input LI ([2 Configurations] (CnF1)) to 1.
7. Download configuration 2 in a file of graphic display terminal (example : file 3 of the graphic display terminal).
8. Connect graphic display terminal to the drive B.
9. Put logic input LI ([2 Configurations] (CnF1)) and LI ([3 Configurations] (CnF2)) to 0.
10. Make a factory setting of the drive B.
11. Download the configuration file 0 in the drive (file 1 of graphic display terminal in this example).
12. Put logic input LI ([2 Configurations] (CnF1)) to 1 and leave logic input LI ([3 Configurations] (CnF2)) to 0.
13. Download the configuration file 1 in the drive (file 2 of graphic display terminal in this example).
14. Put logic input LI ([3 Configurations] (CnF2)) to 1 and leave logic input LI ([2 Configurations] (CnF1)) to 1.
15. Download the configuration file 2 in the drive (file 3 of graphic display terminal in this example).

Nota: Steps 6, 7, 14 et 15 are necessary only if [MULTIMOTORS/CONFIG.] function is used with 3 configurations or 3 motors.

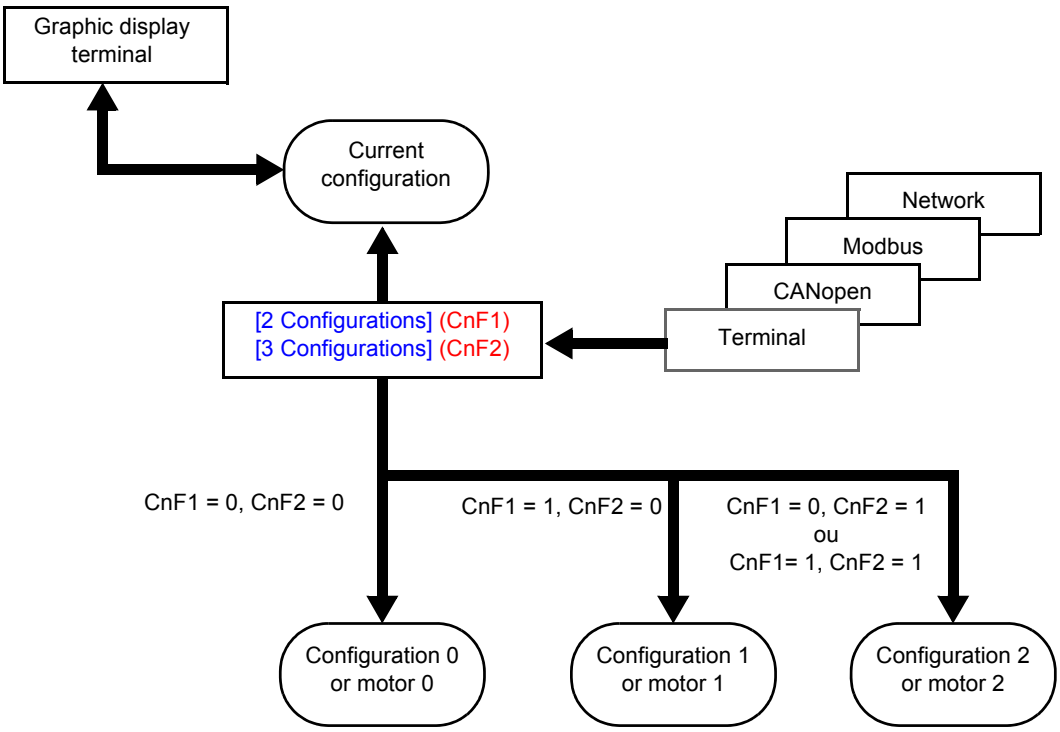


Switching command

Depending on the number of motors or selected configuration (2 or 3), the switching command is sent using one or two logic inputs. The table below lists the possible combinations.

LI 2 motors or configurations	LI 3 motors or configurations	Number of configuration or active motor
0	0	0
1	0	1
0	1	2
1	1	2

Schematic diagram for multimotor mode

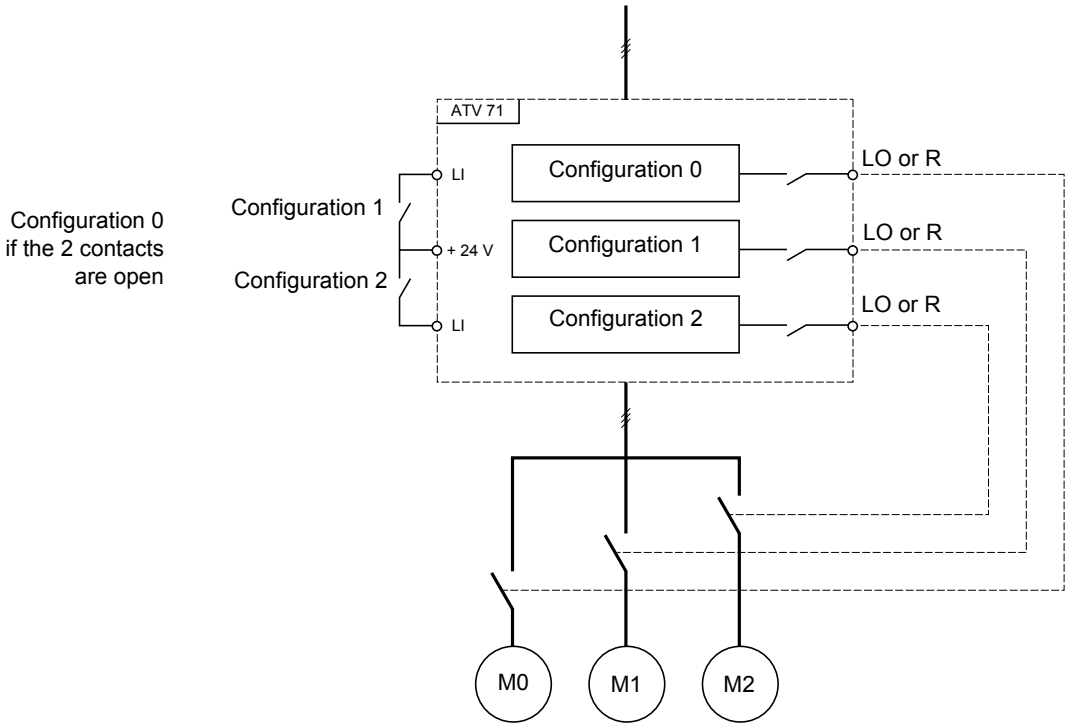

Auto-tuning in multimotor mode

This auto-tuning can be performed:

- Manually using a logic input when the motor changes
- Automatically each time the motor is activated for the 1st time after switching on the drive, if the [Automatic autotune] (AUt) parameter on page 71 = [Yes] (YES).

Motor thermal states in multimotor mode:

The drive protects the three motors individually. Each thermal state takes into account all stop times, including drive shutdowns.
It is, therefore, not necessary to perform auto-tuning every time the power is switched on. It is sufficient to auto-tune each motor at least once.

Configuration information output


In the [1.5 INPUTS / OUTPUTS CFG] (I-O-) menu, a logic output can be assigned to each configuration or motor (2 or 3) for remote information transmission.

Note: As the [1.5 INPUTS / OUTPUTS CFG] (I-O-) menu is switched, these outputs must be assigned in all configurations in which information is required.


Code	Name/Description	Adjustment range	Factory setting
nnC-	**[MULTIMOTORS/CONFIG.]**		
CHn no YES	**[Multimotors]** ☐ **[No]** (nO): Multiconfiguration possible ☐ **[Yes]** (YES): Multimotor possible		[No] (nO)
CnF1 no LI1 - - C111 - - -	**[2 Configurations]** ☐ **[No]** (nO): No switching ☐ **[LI1]** (LI1) to **[LI6]** (LI6) ☐ **[LI7]** (LI7) to **[LI10]** (LI10): If VW3A3201 logic I/O card has been inserted ☐ **[LI11]** (LI11) to **[LI14]** (LI14): If VW3A3202 extended I/O card has been inserted ☐ **[C111]** (C111) to **[C115]** (C115): With integrated Modbus ☐ **[C211]** (C211) to **[C215]** (C215): With integrated CANopen ☐ **[C311]** (C311) to **[C315]** (C315): With a communication card ☐ **[C411]** (C411) to **[C415]** (C415): With a Controller Inside card Switching of 2 motors or 2 configurations		[No] (nO)
CnF2 no LI1 - - C111 - - -	**[3 Configurations]** ☐ **[No]** (nO): No switching ☐ **[LI1]** (LI1) to **[LI6]** (LI6) ☐ **[LI7]** (LI7) to **[LI10]** (LI10): If VW3A3201 logic I/O card has been inserted ☐ **[LI11]** (LI11) to **[LI14]** (LI14): If VW3A3202 extended I/O card has been inserted ☐ **[C111]** (C111) to **[C115]** (C115): With integrated Modbus ☐ **[C211]** (C211) to **[C215]** (C215): With integrated CANopen ☐ **[C311]** (C311) to **[C315]** (C315): With a communication card ☐ **[C411]** (C411) to **[C415]** (C415): With a Controller Inside card Switching of 3 motors or 3 configurations **Note:** In order to obtain 3 motors or 3 configurations, [2 Configurations] (CnF1) must also be configured.		[No] (nO)
tnL-	**[AUTO TUNING BY LI]**		
tuL no LI1 - - -	**[Auto-tune assign.]** ☐ **[No]** (nO): Not assigned ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. Auto-tuning is performed when the assigned input or bit changes to 1. ☞ **Note:** Auto-tuning causes the motor to start up.		[No] (nO)

Traverse control

Function for winding reels of yarn (in textile applications)

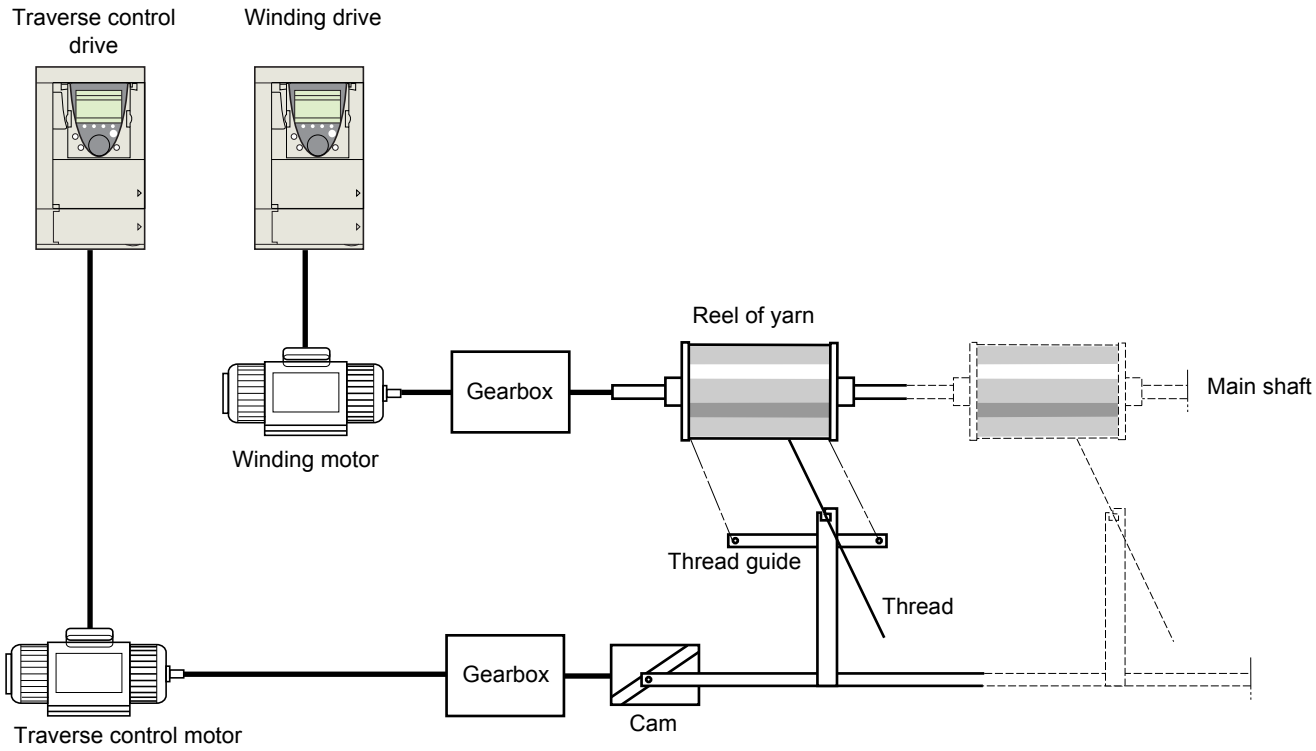


The speed of rotation of the cam must follow a precise profile to ensure that the reel is steady, compact and linear:

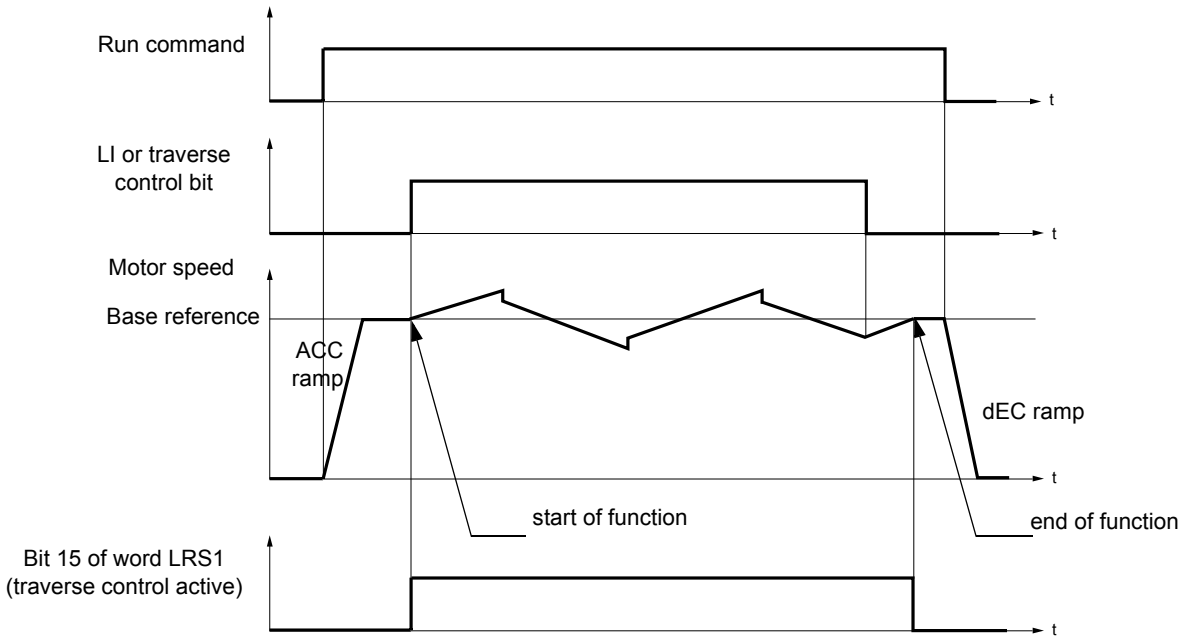

The function starts when the drive has reached its base reference and the traverse control command has been enabled.
When the traverse control command is disabled, the drive returns to its base reference, following the ramp determined by the traverse control function. The function then stops, as soon as it has returned to this reference.
Bit 15 of word LRS1 is at 1 while the function is active.

Function parameters:


These define the cycle of frequency variations around the base reference, as shown in the diagram below:

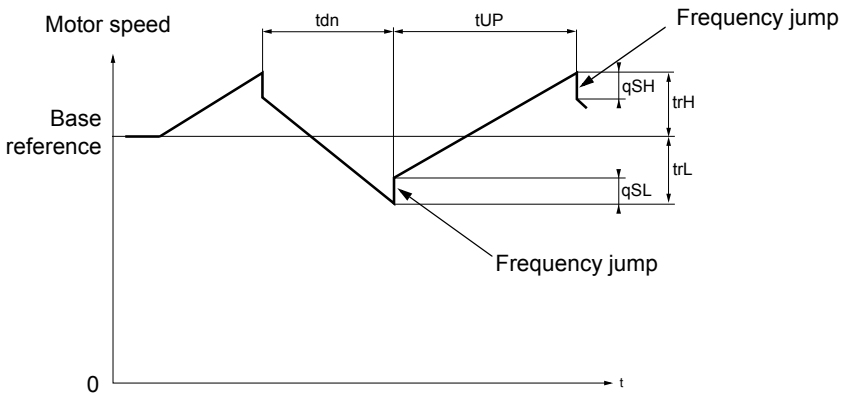


- trC: [Yarn control]: Assignment of the traverse control command to a logic input or to a communication bus control word bit
- tdn: [Traverse ctrl. decel] time, in seconds
- tUP: [Traverse ctrl. accel.] time, in seconds
- trH: [Traverse freq. high], in Hertz
- trL: [Traverse Freq. Low], in Hertz
- qSH: [Quick step High], in Hertz
- qSL: [Quick step Low], in Hertz


Reel parameters:

- tbO: [Reel time]: Time taken to make a reel, in minutes.
  This parameter is intended to signal the end of winding. When the traverse control operating time since command trC reaches the value of tbO, the logic output or one of the relays changes to state 1, if the corresponding function EbO has been assigned.
  The traverse control operating time EbOt can be monitored online by a communication bus and in the Monitoring menu.
- dtF: [Decrease ref. speed]: Decrease in the base reference.
  In certain cases, the base reference has to be reduced as the reel increases in size. The dtF value corresponds to time tbO. Once this time has elapsed, the reference continues to fall, following the same ramp. If low speed LSP is at 0, the speed reaches 0 Hz, the drive stops and must be reset by a new run command.
  If low speed LSP is not 0, the traverse control function continues to operate above LSP.

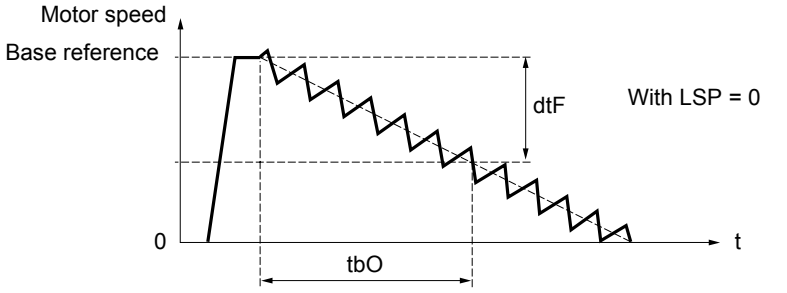


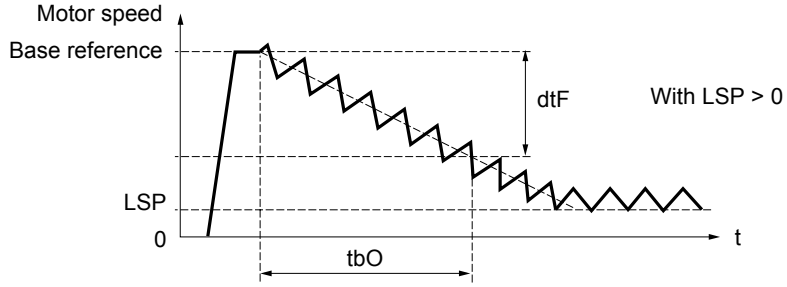

- rtr: [Init. traverse ctrl] Reinitialize traverse control.
  This command can be assigned to a logic input or to a communication bus control word bit. It resets the EbO alarm and the EbOt operating time to zero and reinitializes the reference to the base reference. As long as rtr remains at 1, the traverse control function is disabled and the speed remains the same as the base reference.
  This command is used primarily when changing reels.

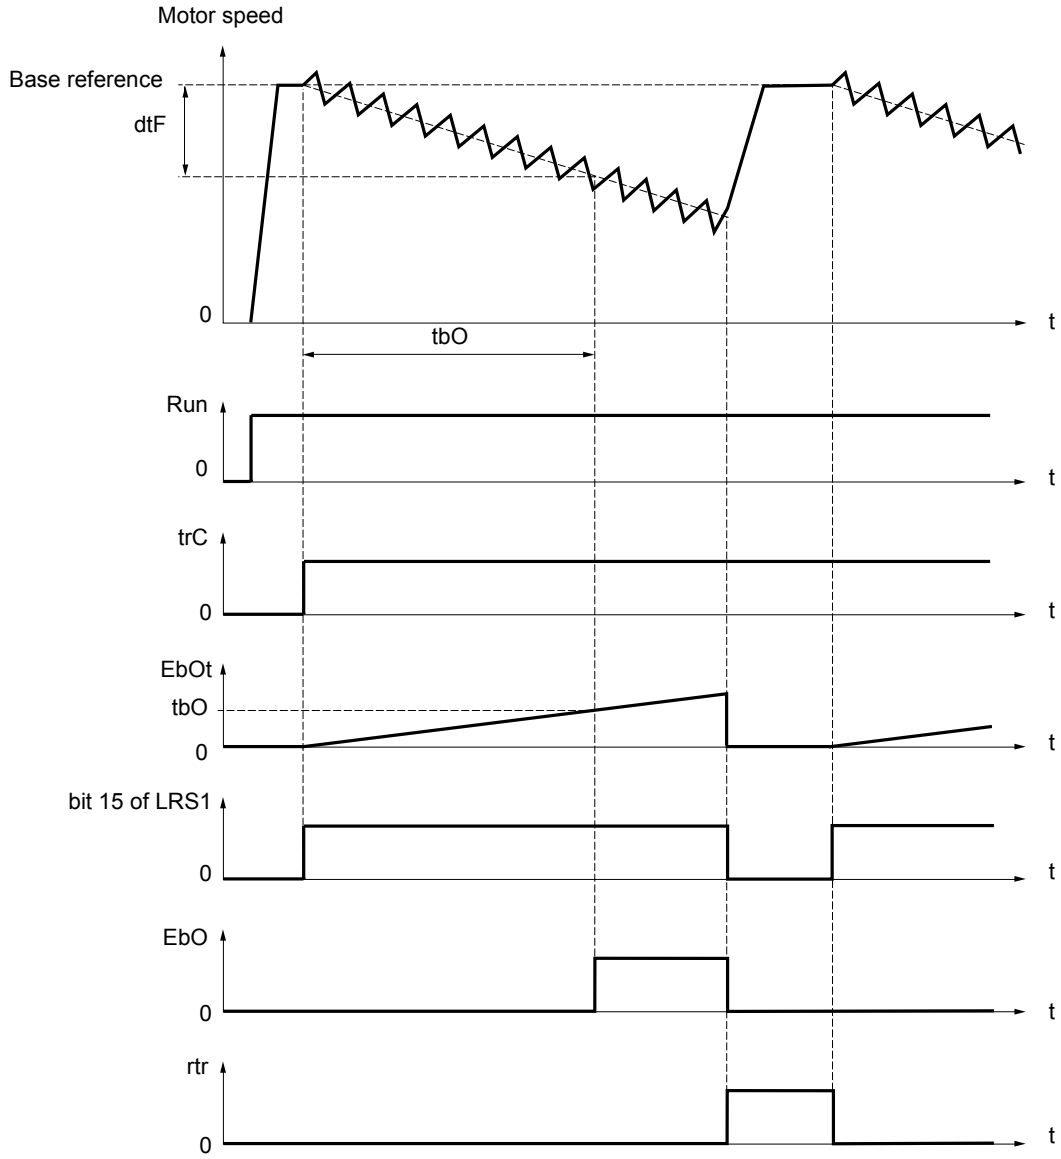


Counter wobble

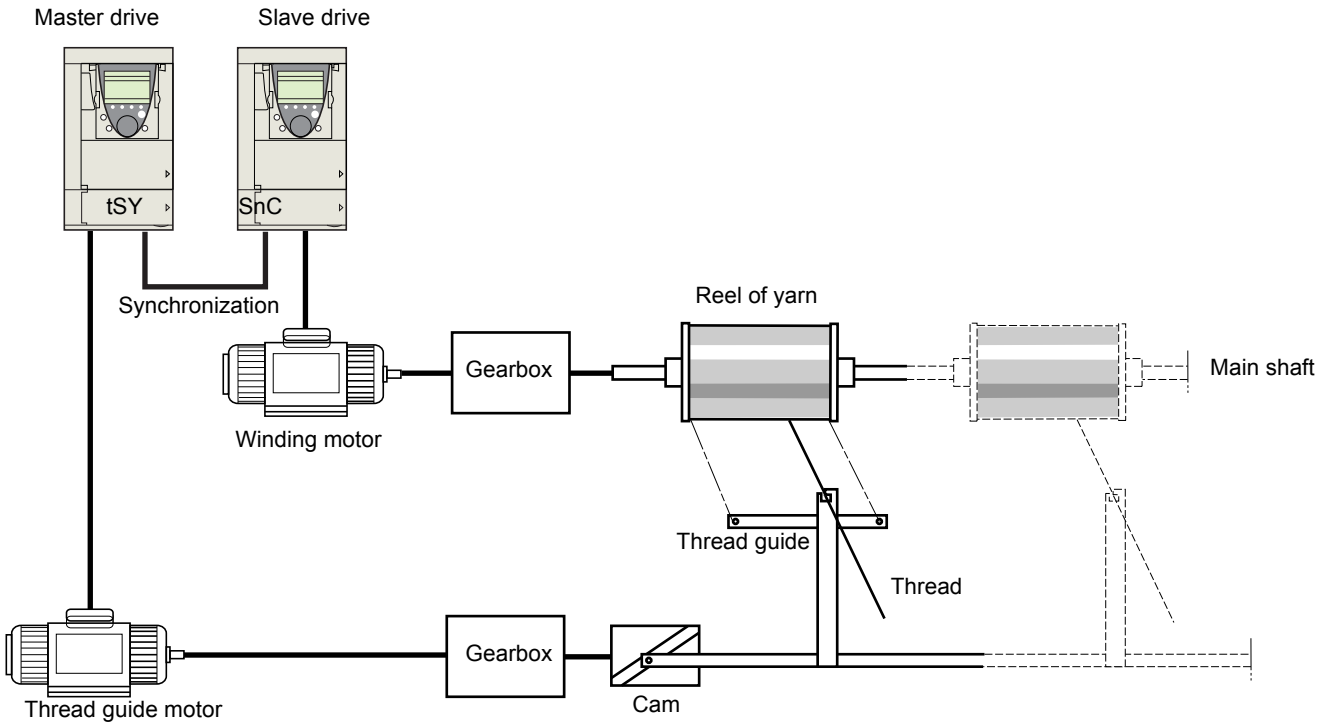


The "Counter wobble" function is used in certain applications to obtain a constant yarn tension when the "Traverse control" function is producing considerable variations in speed on the yarn guide motor (trH and trL, see page 214).

Two motors must be used (one master and one slave).

The master controls the speed of the yarn guide, the slave controls the winding speed. The function assigns the slave a speed profile, which is in antiphase to that of the master. This means that synchronization is required, using one of the master's logic outputs and one of the slave's logic inputs.

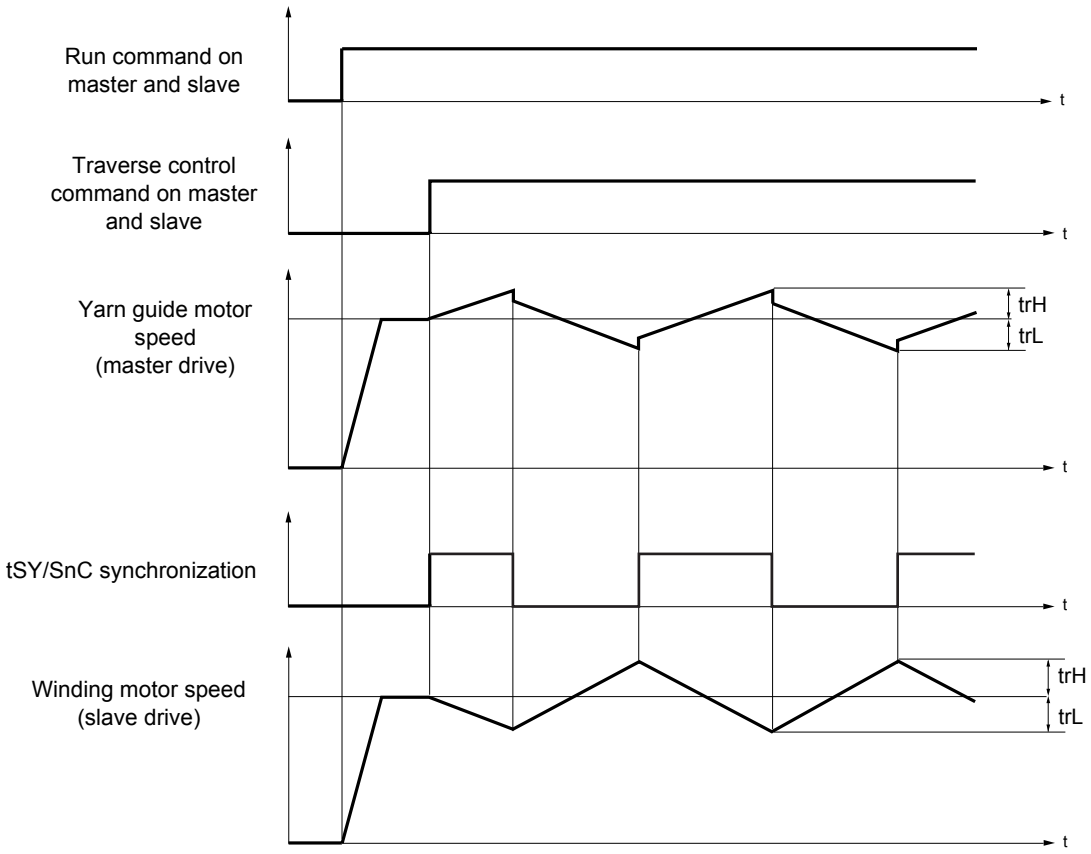

Connection of synchronization I/O

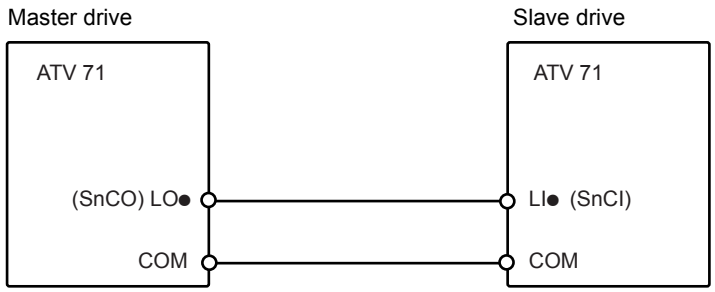

The starting conditions for the function are:

- Base speeds reached on both drives
- [Yarn control] (trC) input activated
- Synchronization signal present

Note: On the slave drive, the [Quick step High] (qSH) and [Quick step Low] (qSL) parameters should generally be left at zero.

[1.7 APPLICATION FUNCT.] (FUn-)

Code	Name/Description		Adjustment range	Factory setting
tro-	**[TRAVERSE CONTROL]** **Note:** This function cannot be used with certain other functions. Follow the instructions on page 133.			
trC no LI1 - - -	**[Yarn control]** ☐ **[No]** (nO): Function inactive, thereby preventing access to other parameters. ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. The "traverse control" cycle starts when the assigned input or bit changes to 1 and stops when it changes to 0.			[No] (nO)
trH ()	**[Traverse freq. high]**	(1)	0 to 10 Hz	4 Hz
trL ()	**[Traverse Freq. Low]**	(1)	0 to 10 Hz	4 Hz
qSH ()	**[Quick step High]**	(1)	0 to [Traverse freq. high] (trH)	0 Hz
qSL ()	**[Quick step Low]**	(1)	0 to [Traverse Freq. Low] (trL)	0 Hz
tuP ()	**[Traverse ctrl. accel.]**		0.1 to 999.9 s	4 s
tdn ()	**[Traverse ctrl. decel]**		0.1 to 999.9 s	4 s
tbo ()	**[Reel time]** Reel execution time		0 to 9999 minutes	0 minute
Ebo no LO1 - LO4 r2 - r4 dO1	**[End reel]** ☐ **[No]** (nO): Function not assigned. ☐ **[LO1]** (LO1) to **[LO4]** (LO4): Logic output (if one or two I/O cards have been inserted, LO1 to LO2 or LO4 can be selected). ☐ **[R2]** (r2) to **[R4]** (r4): Relay (selection of R2 extended to R3 or R4 if one or two I/O cards have been inserted). ☐ **[dO1]** (dO1): Analog output AO1 functioning as a logic output. Selection can be made if [AO1 assignment] (AO1) page 114 = [No] (nO). The assigned output or relay changes to state 1 when the traverse control operating time reaches the [Reel time] (tbO).			[No] (nO)

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.

() Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting
	[TRAVERSE CONTROL] (continued)		
SnC no LI1 - - -	**[Counter wobble]** ☐ **[No]** (nO): Function not assigned. ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. Synchronization input. To be configured on the winding drive (slave) only.		[No] (nO)
tSY no LO1 - LO4 r2 - r4 dO1	**[Sync. wobble]** ☐ **[No]** (nO): Function not assigned. ☐ **[LO1]** (LO1) to **[LO4]** (LO4): Logic output (if one or two I/O cards have been inserted, LO1 to LO2 or LO4 can be selected). ☐ **[R2]** (r2) to **[R4]** (r4): Relay (selection of R2 extended to R3 or R4 if one or two I/O cards have been inserted). ☐ **[dO1]** (dO1): Analog output AO1 functioning as a logic output. Selection can be made if [AO1 assignment] (AO1) page 114 = [No] (nO). Synchronization output. To be configured on the yarn guide drive (master) only.		[No] (nO)
dtF ( )	**[Decrease ref. speed]** Decrease in the base reference during the traverse control cycle.	0 to 599 Hz	0 Hz
rtr no LI1 - - -	**[Init. traverse ctrl]** ☐ **[No]** (nO): Function not assigned. ☐ **[LI1]** (LI1) : : ☐ **[...]** (...): See the assignment conditions on page 127. When the state of the assigned input or bit changes to 1, the traverse control operating time is reset to zero, along with [Decrease ref. speed] (dtF).		[No] (nO)

Evacuation function

The evacuation function is designed for "elevator" applications. It is only accessible for ATV71●●●N4 (380/480 V) drives up to ATV71●D75N4, and ATV71●●●Y (500/690 V) drives up to ATV71●D90Y.
When an elevator is stuck between 2 floors due to a power outage, it must be possible to evacuate its occupants within a reasonable period of time.
This function requires an emergency power supply to be connected to the drive.
This power supply is at a reduced voltage, and only allows a derated operating mode, at reduced speed, but with full torque.

The function requires:
- One logic input to control "evacuation" operation
- Reduction of the voltage monitoring threshold
- An appropriate low speed reference

Following a power outage, the drive can restart without having to clear the [Undervoltage] (USF) fault mode if the corresponding logic input is at 1 at the same time.

CAUTION

- This input must not be at 1 when the drive is powered from the line supply. To ensure this and also avoid any short-circuits, supply changeover contactors must be used.
- Set this input to 0 before connecting the emergency power supply to the line supply.

Failure to follow these instructions can result in equipment damage.


Code	Name/Description	Adjustment range	Factory setting
rFt-	**[EVACUATION]** Function only accessible for ATV71●●●N4 (380/480 V) drives up to ATV71●D75N4, and ATV71●●●Y (500/690 V) drives up to ATV71●D90Y.		
rFt nO LI1 - LI14	**[Evacuation assign.]** ☐ **[No]** (nO): Function not assigned. ☐ **[LI1]** (LI1) to **[LI6]** (LI6) ☐ **[LI7]** (LI7) to **[LI10]** (LI10): If VW3A3201 logic I/O card has been inserted ☐ **[LI11]** (LI11) to **[LI14]** (LI14): If VW3A3202 extended I/O card has been inserted. Evacuation is activated when the assigned input is at 1, if the drive is stationary. Evacuation is deactivated when the assigned input is at 0, as soon as the drive stops.		[No] (nO)
rSu	**[Evacuation Input V.]** Minimum permissible AC voltage value of the emergency power supply. The parameter can be accessed if [Evacuation assign.] (rFt) is not [No] (nO). • ATV71●●●N4: range from 220 to 320 V, factory setting 220 V. • ATV71●●●S6X and ATV71●●●Y: range from 380 to 415 V, factory setting 400 V.	According to voltage rating	According to voltage rating
rSP ↻	**[Evacuation freq.]** Value of the "evacuation" mode frequency reference. The parameter can be accessed if [Evacuation assign.] (rFt) is not [No] (nO). The adjustment range is determined by the [Low speed] (LSP) (page 56), [Rated motor freq.] (FrS) and [Rated motor volt.] (UnS) (page 70) parameters and by [Evacuation Input V.] (rSU) above. • If LSP < (Frs x rSU/UnS): rSP min. = LSP, rSP max. = (Frs x rSU/UnS) • If LSP ⩾ (Frs x rSU/UnS): rSP = (Frs x rSU/UnS).		5 Hz

↻ Parameter that can be modified during operation or when stopped.

Half floor

The "half floor" function is designed for "elevator" applications.
When an elevator sets off from floors and half floors, the cycle time for half floors can be too long, as the elevator does not have time to reach full speed before crossing the slowdown limit switch. As a result, the slowdown time is unnecessarily long.
The "half floor" function can be used to compensate this by not triggering slowdown until the speed reaches a preset threshold [Half-floor speed] (HLS) in order that the final part of the path will be the same as for a standard floor.

The graphs below illustrate the various operating scenarios with and without the function:

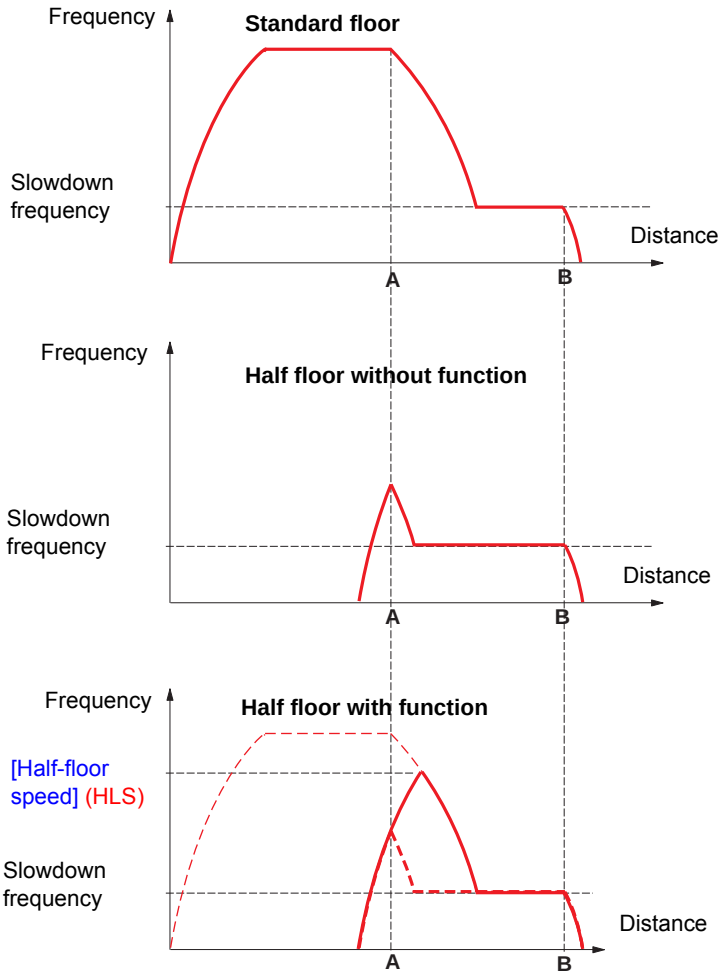

A: Slowdown limit switch reached
B: Stop limit switch reached

The function is only activated if, when the slowdown limit switch is tripped, the motor frequency is less than [Half-floor speed] (HLS). Acceleration is then maintained up to this value prior to slowing down.
The final part of the path is identical to that of the standard floor.

Code	Name/Description	Adjustment range	Factory setting
HFF-	**[HALF FLOOR]**		
HLS	**[Half-floor speed]**		[No] (nO)
	Activation and adjustment of the "half floor" function. This function has priority over all speed reference functions (preset speeds, for example) with the exception of those generated via fault monitoring (fallback speed, for example). ☐ **[No]** (nO): Function inactive ☐ **0.1 Hz to 500.0 Hz**: Activation of the function by adjusting the motor frequency to be reached prior to slowing down.		


Direct power supply via DC bus

This function is only accessible for ATV71●●●M3 ⩾ 18.5 kW, ATV71●●●N4 ⩾ 22 kW drives and all ratings of ATV71●●●Y drives.

Direct power supply via the DC bus requires a protected direct current source with adequate power and voltage as well as a suitably dimensioned resistor and capacitor precharging contactor. Consult Schneider Electric for information about specifying these components.

The "direct power supply via DC bus" function can be used to control the precharging contactor via a relay or a logic input on the drive.

Example circuit using R2 relay:

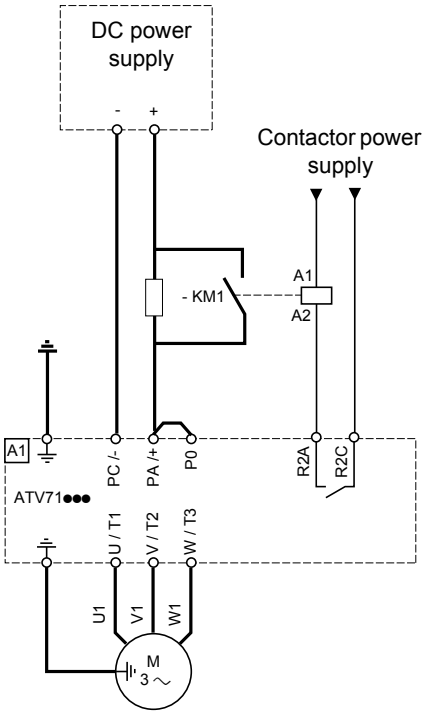


Code	Name/Description	Adjustment range	Factory setting
dCo-	**[DC BUS SUPPLY]** This function is only accessible for ATV71●●●M3 ⩾ 18.5 kW, ATV71●●●N4 ⩾ 22 kW drives and all ratings of ATV71●●●Y drives.		
dCo	**[Precharge cont. ass.]**		[No] (nO)
	Logic output or control relay ☐ **[No]** (nO): Function not assigned. ☐ **[LO1]** (LO1) to **[LO4]** (LO4): Logic output (if one or two I/O cards have been inserted, LO1 to LO2 or LO4 can be selected). **[R2]** (r2) to **[R4]** (r4): Relay (selection of R2 extended to R3 or R4 if one or two I/O cards have been inserted). ☐ **[dO1]** (dO1): Analog output AO1 functioning as a logic output. Selection can be made if [AO1 assignment] (AO1) page 114 = [No] (nO).		
nO			
LO1			
-			
LO4			
r2			
-			
r4			
dO1			

Active Front End connection

This function is not accessible for ATV71H●●●S6X ≥ and for ATV71H●●●Y ≥ 110 kW (150 HP). (HHP range)

Direct power supply via Active Front End (AFE) reduces the mains current harmonics to less than 4% and gives enables the drive to feedback the generative energy to the mains supply.

Example circuit using one AFE for one ATV71

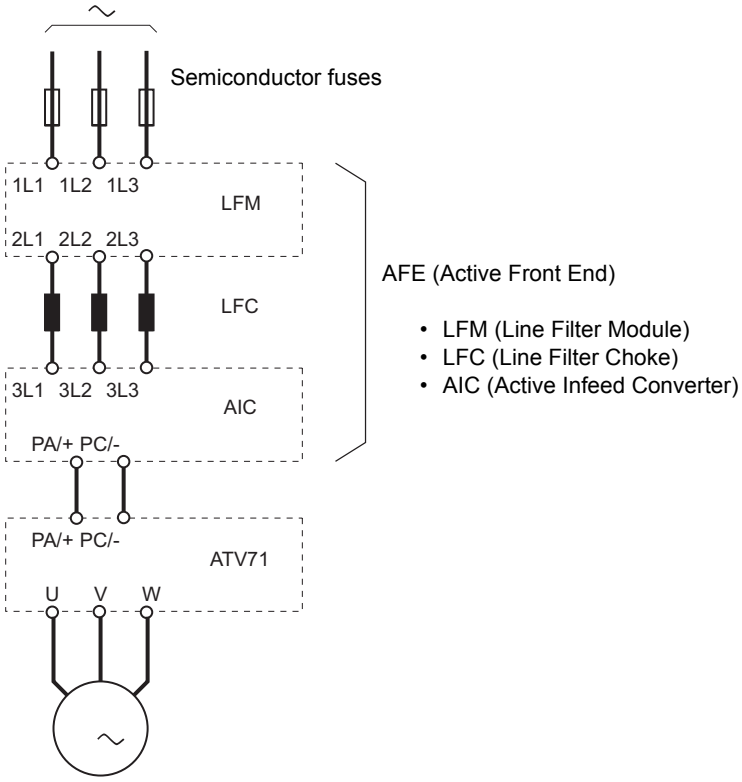

Code	Name/Description	Adjustment range	Factory setting
AFE-	**[REGEN CONNECTION]**		
air	**[Regen. Connection]**		[No] (nO)
	☐ **[No]** (nO): Not assigned		
	☐ **[Yes]** (YES): Function always active		
	☐ **[LI1]** (LI1) to **[LI6]** (LI6)		
	☐ **[LI7]** (LI7) to **[LI10]** (LI10): If VW3A3201 logic I/O card has been inserted		
	☐ **[LI11]** (LI11) to **[LI14]** (LI14): If VW3A3202 extended I/O card has been inserted		
	☐ **[C101]** (C101) to **[C115]** (C115): With integrated Modbus in [I/O profile] (IO)		
	☐ **[C201]** (C201) to **[C215]** (C215): With integrated CANopen in [I/O profile] (IO)		
	☐ **[C301]** (C301) to **[C315]** (C315): With a communication card in [I/O profile] (IO)		
	☐ **[C401]** (C401) to **[C415]** (C415): With a Controller Inside card in [I/O profile] (IO)		
	☐ **[CD00]** (Cd00) to **[CD13]** (Cd15): In [I/O profile] (IO) can be switched with possible logic inputs		
	☐ **[CD14]** (Cd14) to **[CD15]** (Cd15): In [I/O profile] (IO) can be switched without logic inputs		
	If [Profile] (CHCF) = [8 serie] (SE8), then only [Yes] (YES) and [LIx] (LIx) are available		

⚠ CAUTION

DAMAGED EQUIPMENT


It is absolutely necessary to carry out further parameter setting on all ATV71 drive connnected to Active Front End (AFE). Check the list of parameter on next page.

Failure to follow this instruction can result in equipment damage.

Active Front End connection


It is necessary to carry out the following settings for all frequency inverters connected to an active front end:

- Parameter [Mains voltage] (UrES) : Same setting as the active front end (Thereby the internal voltage levels of the frequency inverter are adapted).
- Parameter [Input phase loss] (IPL) has to be set to [Ignore] (nO).
- Parameter for operation with active front end [Regen. Connection] (OIr) has to be set to [Yes] (YES) (Thereby the undervoltage level of the frequency inverter is adapted to the operation with the active front end).
- Parameter [Dec ramp adapt.] (brA) is set to [nO] to inactivate this function.
- Parameter [Brake res. fault Mgt] (bUb) has to be set to [ignore] (nO) (for HHP range only).
- Parameter [Deceleration] (dEC) has to be increased for applications with high inertia to avoid overload of Active Front End. This can be prevented also by rounding the deceleration ramp with parameter [Begin Dec round] (tA3).
- Parameter [2 wire type] (tCt) has to be set on [Level] (LEL) to ensure an automatic restart after undervoltage detection of the Active Front End. An automatic restart is only possible on 2 wire control.
- The integrated RFI filter has to be always deactivated (position IT, non-grounded mains) for all ATV 71 inverter and also for the Active Infeed Converter (AIC) because there exists no direct mains connection.

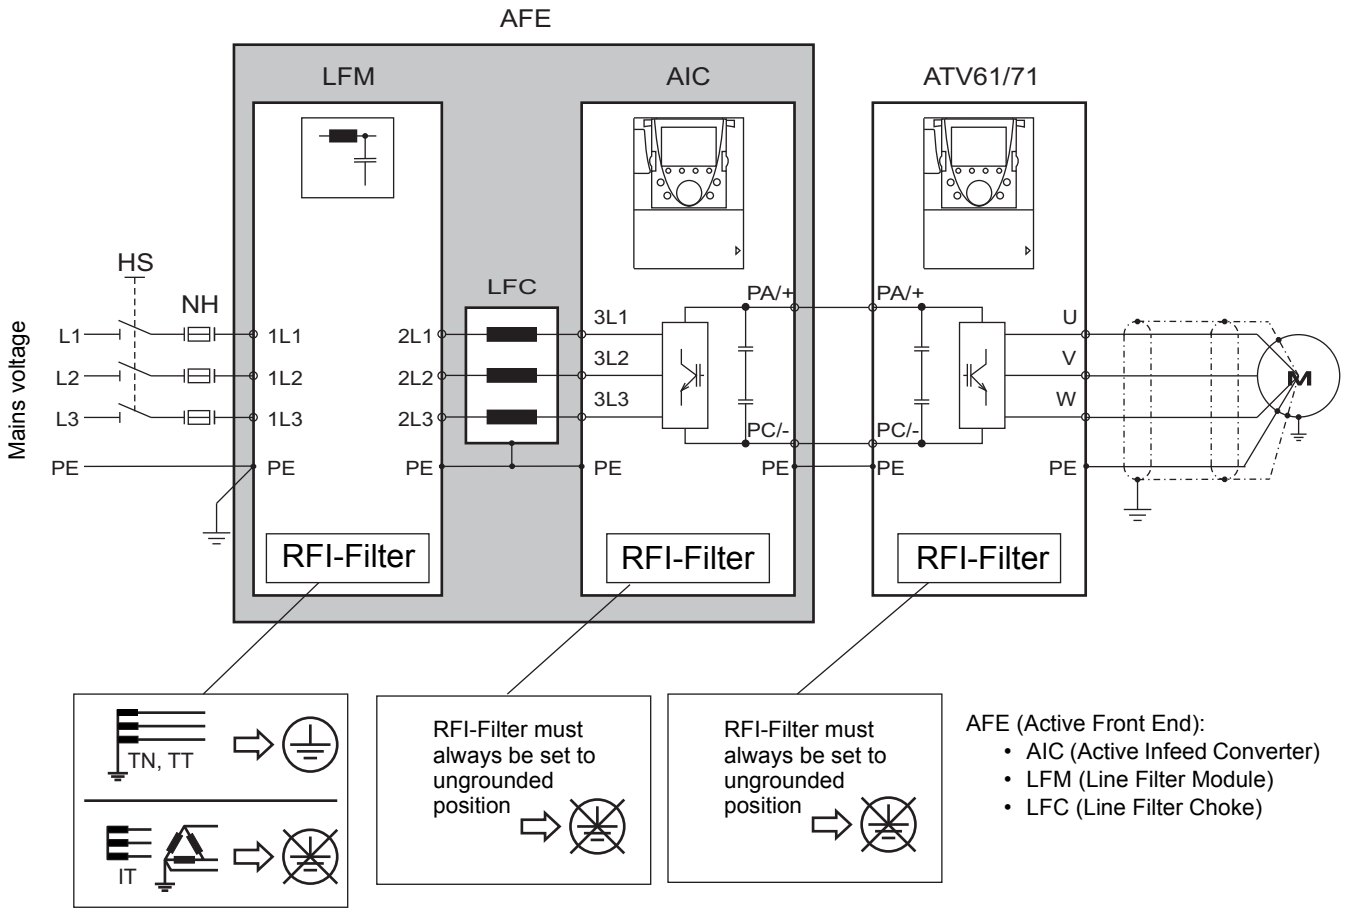


[1.8 FAULT MANAGEMENT] (FLt-)

With graphic display terminal:

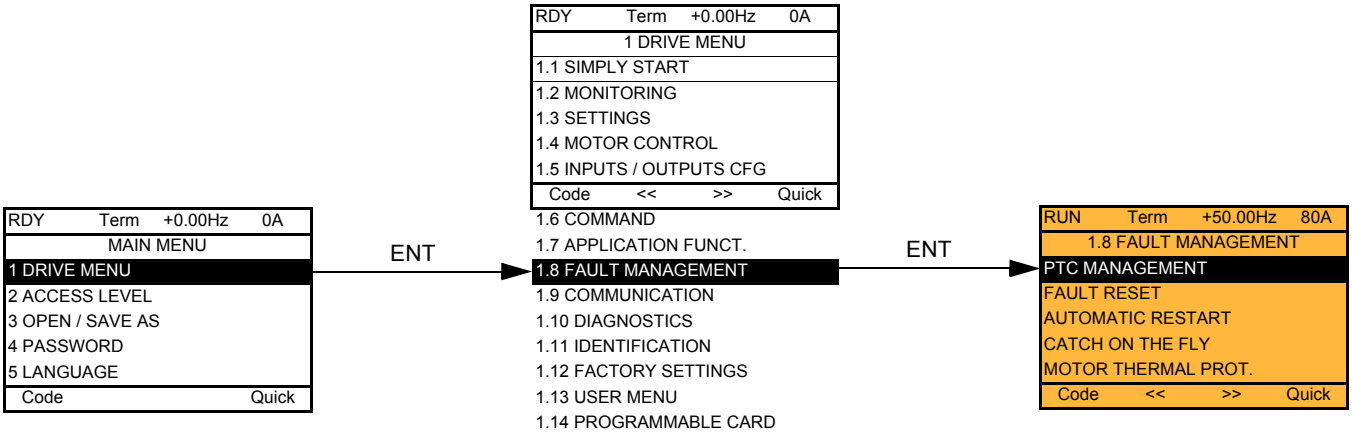

With integrated display terminal:

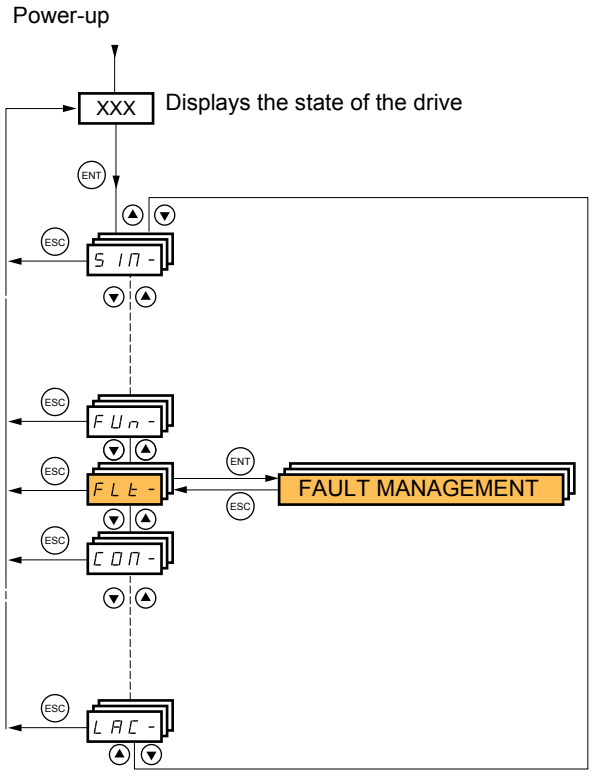

Summary of functions:

Code	Name	Page
PtC-	[PTC MANAGEMENT]	223
rSt-	[FAULT RESET]	224
Atr-	[AUTOMATIC RESTART]	225
FLr-	[CATCH ON THE FLY]	226
tHt-	[MOTOR THERMAL PROT.]	228
oPL-	[OUTPUT PHASE LOSS]	228
iPL-	[INPUT PHASE LOSS]	229
oHL-	[DRIVE OVERHEAT]	229
SAt-	[THERMAL ALARM STOP]	230
EtF-	[EXTERNAL FAULT]	231
uSb-	[UNDERVOLTAGE MGT]	232
t it-	[IGBT TESTS]	233
LFL-	[4-20mA LOSS]	234
inH-	[FAULT INHIBITION]	235
CLL-	[COM. FAULT MANAGEMENT]	236
Sdd-	[ENCODER FAULT]	237
t id-	[TORQUE OR I LIM. DETECT]	237
F9F-	[FREQUENCY METER]	239
dLd-	[DYNAMIC LOAD DETECT.]	241
brP-	[DB RES. PROTECTION]	242
buF-	[BU PROTECTION]	242
tnF-	[AUTO TUNING FAULT]	242
PPi-	[CARDS PAIRING]	243
LFF-	[FALLBACK SPEED]	244
FSt-	[RAMP DIVIDER]	244
dCi-	[DC INJECTION]	244

[1.8 FAULT MANAGEMENT] (FLt-)

The parameters in the [1.8 FAULT MANAGEMENT] (FLt-) menu can only be modified when the drive is stopped and there is no run command, except for parameters with a ↻ symbol in the code column, which can be modified with the drive running or stopped.

PTC probes

3 sets of PTC probes can be managed by the drive in order to protect the motors:

- 1 on logic input LI6 converted for this use by switch "**SW2**" on the control card.
- 1 on each of the 2 option cards VW3A3201 and VW3A3202.

Each of these sets of PTC probes is monitored for the following faults:

- Motor overheating
- Sensor break fault
- Sensor short-circuit fault

Protection via PTC probes does not disable protection via I^2t calculation performed by the drive (the two types of protection can be combined).

Code	Name/Description	Adjustment range	Factory setting
PtC-	**[PTC MANAGEMENT]**		
PtCL	**[LI6 = PTC probe]**		[No] (nO)
	Can be accessed if switch **SW2** on the control card is set to PTC.		
nO	☐ **[No]** (nO): Not used		
AS	☐ **[Always]** (AS): "PTC probe" faults are monitored permanently, even if the power supply is not connected (as long as the control remains connected to the power supply).		
rdS	☐ **[Power ON]** (rdS): "PTC probe" faults are monitored while the drive power supply is connected.		
rS	☐ **[Motor ON]** (rS): "PTC probe" faults are monitored while the motor power supply is connected.		
PtC1	**[PTC1 probe]**		[No] (nO)
	Can be accessed if a VW3A3201 option card has been inserted.		
nO	☐ **[No]** (nO): Not used		
AS	☐ **[Always]** (AS): "PTC probe" faults are monitored permanently, even if the power supply is not connected (as long as the control remains connected to the power supply).		
rdS	☐ **[Power ON]** (rdS): "PTC probe" faults are monitored while the drive power supply is connected.		
rS	☐ **[Motor ON]** (rS): "PTC probe" faults are monitored while the motor power supply is connected.		
PtC2	**[PTC2 probe]**		[No] (nO)
	Can be accessed if a VW3A3202 option card has been inserted.		
nO	☐ **[No]** (nO): Not used		
AS	☐ **[Always]** (AS): "PTC probe" faults are monitored permanently, even if the power supply is not connected (as long as the control remains connected to the power supply).		
rdS	☐ **[Power ON]** (rdS): "PTC probe" faults are monitored while the drive power supply is connected.		
rS	☐ **[Motor ON]** (rS): "PTC probe" faults are monitored while the motor power supply is connected.		

Code	Name/Description	Adjustment range	Factory setting
rSt-	**[FAULT RESET]**		
rSF	**[Fault reset]** Manual fault reset ☐ **[No]** (nO): Function inactive ☐ **[LI1]** (LI1) to **[LI6]** (LI6) ☐ **[LI7]** (LI7) to **[LI10]** (LI10): If VW3A3201 logic I/O card has been inserted ☐ **[LI11]** (LI11) to **[LI14]** (LI14): If VW3A3202 extended I/O card has been inserted ☐ **[C101]** (C101) to **[C115]** (C115): With integrated Modbus in [I/O profile] (IO) ☐ **[C201]** (C201) to **[C215]** (C215): With integrated CANopen in [I/O profile] (IO) ☐ **[C301]** (C301) to **[C315]** (C315): With a communication card in [I/O profile] (IO) ☐ **[C401]** (C401) to **[C415]** (C415): With a Controller Inside card in [I/O profile] (IO) ☐ **[CD00]** (Cd00) to **[CD13]** (Cd13): In [I/O profile] (IO) can be switched with possible logic inputs ☐ **[CD14]** (Cd14) to **[CD15]** (Cd15): In [I/O profile] (IO) can be switched without logic inputs Faults are reset when the assigned input or bit changes to 1, if the cause of the fault has disappeared. The STOP/RESET button on the graphic display terminal performs the same function. See pages 272 to 276 for a list of faults that can be reset manually.		[No] (nO)
rPA	**[Product reset assig.]** Parameter can only be modified in [ACCESS LEVEL] = [Expert] mode. Drive reinitialization via logic input. Can be used to reset all faults without having to disconnect the drive from the power supply. The drive is reinitialized on a rising edge (change from 0 to 1) of the assigned input. The drive can only be reinitialized when locked. ☐ **[No]** (nO): Function inactive ☐ **[LI1]** (LI1) to **[LI6]** (LI6) ☐ **[LI7]** (LI7) to **[LI10]** (LI10): If VW3A3201 logic I/O card has been inserted ☐ **[LI11]** (LI11) to **[LI14]** (LI14): If VW3A3202 extended I/O card has been inserted. To assign reinitialization, press and hold down the "ENT" key for 2 s. **CAUTION** Make sure that the cause of the fault that led to the drive locking has been removed before reinitializing. **Failure to follow this instruction can result in equipment damage.**		[No] (nO)
rP	**[Product reset]** Parameter can only be accessed in [ACCESS LEVEL] = [Expert] mode. Drive reinitialization. Can be used to reset all faults without having to disconnect the drive from the power supply. ☐ **[No]** (nO): Function inactive ☐ **[Yes]** (YES): Reinitialization. Press and hold down the "ENT" key for 2 s. The parameter changes back to [No] (nO) automatically as soon as the operation is complete. The drive can only be reinitialized when locked. **CAUTION** Make sure that the cause of the fault that led to the drive locking has been removed before reinitializing. **Failure to follow this instruction can result in equipment damage.**		[No] (nO)

Code	Name/Description	Adjustment range	Factory setting

[AUTOMATIC RESTART]

[Automatic restart]

[No] (nO)

- ☐ **[No]** (nO): Function inactive
- ☐ **[Yes]** (YES): Automatic restart, after locking on a fault, if the fault has disappeared and the other operating conditions permit the restart. The restart is performed by a series of automatic attempts separated by increasingly longer waiting periods: 1 s, 5 s, 10 s, then 1 minute for the following attempts.
  The drive fault relay remains activated if this function is active. The speed reference and the operating direction must be maintained.
  Use 2-wire control ([2/3 wire control] (tCC) = [2 wire] (2C) and [2 wire type] (tCt) = [Level] (LEL) see page 92).

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION

Check that an automatic restart will not endanger personnel or equipment in any way.

Failure to follow these instructions can result in death or serious injury.

If the restart has not taken place once the configurable time tAr has elapsed, the procedure is aborted and the drive remains locked until it is turned off and then on again.
The faults, which permit this function, are listed on page 275:

[Max. restart time]

[5 minutes] (5)

- ☐ **[5 min]** (5): 5 minutes
- ☐ **[10 minutes]** (10): 10 minutes
- ☐ **[30 minutes]** (30): 30 minutes
- ☐ **[1 hour]** (1h): 1 hour
- ☐ **[2 hours]** (2h): 2 hours
- ☐ **[3 hours]** (3h): 3 hours
- ☐ **[Unlimited]** (Ct): Unlimited

This parameter appears if [Automatic restart] (Atr) = [Yes] (YES). It can be used to limit the number of consecutive restarts on a recurrent fault.

Code	Name/Description	Adjustment range	Factory setting
FLr-	**[CATCH ON THE FLY]** **Note:** This function cannot be used with certain other functions. Follow the instructions on page 133.		
FLr	**[Catch on the fly]** Used to enable a smooth restart if the run command is maintained after the following events: • Loss of line supply or disconnection • Reset of current fault or automatic restart • Freewheel stop. The speed given by the drive resumes from the estimated speed of the motor at the time of the restart, then follows the ramp to the reference speed. Rotor speed, estimated during freewheel operation, in order to define the appropriate catch on fly settings is available by [Freq. catch on fly] (FCAO), it can be monitored with PC-Software. This function requires 2-wire level control. nO **[No]** (nO): Function inactive YES **[Yes]** (YES): Function active When the function is operational, it activates at each run command, resulting in a slight delay of the current (0.5 s max.). [Catch on the fly] (FLr) is forced to [No] (nO) if brake logic control [Brake assignment] (bLC) is assigned (page 164) or if [Motor control type] (Ctt) page 73 = [FVC] (FUC) or if, in open-loop control, [Auto DC injection] (AdC) page 146 = [Continuous] (Ct). **Note :** This function should not be used with motors in parallel because the speed estimation based on motor current measurement is not possible.		[No] (nO)
uCb	**[Sensitivity]** Parameter accessible at and above ATV71HD55M3X, ATV71HD90N4 and ATV71HC11Y. Adjusts the catch-on-the-fly sensitivity around the zero speed. Decrease the value if the drive is not able to perform the catch on the fly, and increase it if the drive locks on a fault as it performs the catch on the fly.	0.1 to 15%	0.6%

Parameter that can be modified during operation or when stopped.


Motor thermal protection

Function:

Thermal protection by calculating the I^2t.

Note: The memory of the motor thermal state is saved when the drive is switched off. The power-off time is used to recalculate the thermal state the next time the drive is switched on.

- Naturally-cooled motors:
  The tripping curves depend on the motor frequency.
- Force-cooled motors:
  Only the 50 Hz tripping curve needs to be considered, regardless of the motor frequency.

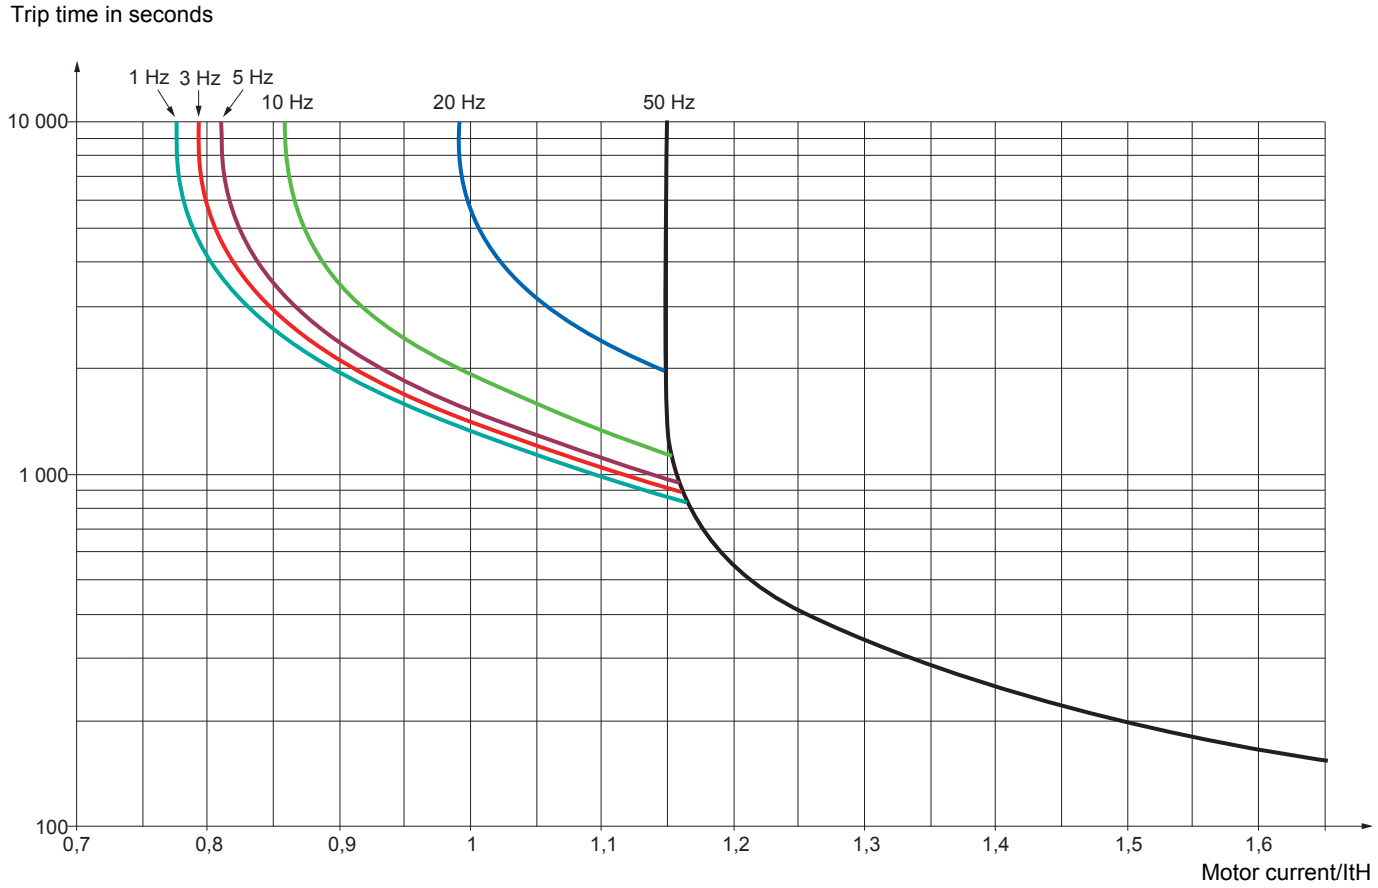

Code	Name/Description	Adjustment range	Factory setting
tHt-	**[MOTOR THERMAL PROT.]**		
tHt	**[Motor protect. type]** ☐ **[No]** (nO): No protection. ☐ **[Self cooled]** (ACL): For self-cooled motors ☐ **[Force-cool]** (FCL): For force-cooled motors **Note:** A fault trip will occur when the thermal state reaches 118% of the rated state and reactivation will occur when the state falls back below 100%.		[Self cooled] (ACL)
ttd	**[Motor therm. level]** (1) Trip threshold for motor thermal alarm (logic output or relay)	0 to 118%	100%
ttd2	**[Motor2 therm. level]** Trip threshold for motor 2 thermal alarm (logic output or relay)	0 to 118%	100%
ttd3	**[Motor3 therm. level]** Trip threshold for motor 3 thermal alarm (logic output or relay)	0 to 118%	100%
oLL	**[Overload fault mgt]** Type of stop in the event of a motor thermal fault. ☐ **[Ignore]** (nO): Fault ignored. ☐ **[Freewheel]** (YES): Freewheel stop. ☐ **[Per STT]** (Stt): Stop according to configuration of [Type of stop] (Stt) page 144, without fault tripping. In this case the fault relay does not open and the drive is ready to restart as soon as the fault disappears, according to the restart conditions of the active command channel (e.g., according to [2/3 wire control] (tCC) and [2 wire type] (tCt) page 92 if control is via the terminals). Configuring an alarm for this fault is recommended (assigned to a logic output, for example) in order to indicate the cause of the stop. ☐ **[fallback spd]** (LFF): Change to fallback speed, maintained as long as the fault persists and the run command has not been removed (2). ☐ **[Spd maint.]** (rLS): The drive maintains the speed being applied when the fault occurred, as long as the fault is present and the run command has not been removed (2). ☐ **[Ramp stop]** (rMP): Stop on ramp. ☐ **[Fast stop]** (FSt): Fast stop. ☐ **[DC injection]** (dCI): DC injection stop. This type of stop cannot be used with certain other functions. See table on page 133.		[Freewheel] (YES)
oPL-	**[OUTPUT PHASE LOSS]**		
oPL	**[Output Phase Loss]** ☐ **[No]** (nO): Function inactive ☐ **[Yes]** (YES): Tripping on OPF fault with freewheel stop. ☐ **[Output cut]** (OAC): No fault triggered, but management of the output voltage in order to avoid an overcurrent when the link with the motor is re-established and catch on the fly performed (even if this function has not been configured). This selection cannot be made if [Motor control type] (Ctt) page 73 = [Sync. mot.] (SYn) for the ATV71●●●M3X ≥ 45 kW (60 HP) and for the ATV71●●●N4 ≥ 75 kW (100 HP). **Note:** [Output phase loss] (OPL) is forced to [No] (nO) if [Motor control type] (Ctt) page 73 = [Sync. mot.] (SYn). For other [Motor control type] (Ctt) configurations, [Output phase loss] (OPL) is forced to [Yes] (YES) if brake logic control is configured (see page 164).		[Yes] (YES)
odt	**[OutPh time detect]** Time delay for taking the [Output Phase Loss] (OPL) fault into account.	0.5 to 10 s	0.5 s

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-)menu.
(2) Because, in this case, the fault does not trigger a stop, it is essential to assign a relay or logic output to its indication.

Parameter that can be modified during operation or when stopped.

iPL- [INPUT PHASE LOSS]

iPL [Input phase loss]

According to drive rating

- nO ☐ **[Ignore]** (nO): Fault ignored, to be used when the drive is supplied via a single phase supply or by the DC bus.
- YES ☐ **[Freewheel]** (YES): Fault with freewheel stop.
  If one phase disappears, the drive switches to fault mode [Input phase loss] (IPL) but if 2 or 3 phases disappear, the drive continues to operate until it trips on an undervoltage fault.

  Factory setting: [Ignore] (nO) for ATV71●037M3 to U30M3, [Freewheel] (YES) for all others.

oHL- [DRIVE OVERHEAT]

oHL [Overtemp fault mgt]

[Freewheel] (YES)

CAUTION

RISK OF EQUIPMENT DAMAGE

Inhibiting faults results in the drive not being protected. This invalidates the warranty.
Check that the possible consequences do not present any risk.
Failure to follow these instructions can result in equipment damage.

Behavior in the event of the drive overheating

- nO ☐ **[Ignore]** (nO): Fault ignored.
- YES ☐ **[Freewheel]** (YES): Freewheel stop.
- Stt ☐ **[Per STT]** (Stt): Stop according to configuration of [Type of stop] (Stt) page 144, without fault tripping. In this case the fault relay does not open and the drive is ready to restart as soon as the fault disappears, according to the restart conditions of the active command channel (e.g., according to [2/3 wire control] (tCC) and [2 wire type] (tCt) page 92 if control is via the terminals). Configuring an alarm for this fault is recommended (assigned to a logic output, for example) in order to indicate the cause of the stop.
- LFF ☐ **[fallback spd]** (LFF): Change to fallback speed, maintained as long as the fault persists and the run command has not been removed (1).
- rLS ☐ **[Spd maint.]** (rLS): The drive maintains the speed being applied when the fault occurred, as long as the fault is present and the run command has not been removed (1).
- rMP ☐ **[Ramp stop]** (rMP): Stop on ramp.
- FSt ☐ **[Fast stop]** (FSt): Fast stop.
- dCI ☐ **[DC injection]** (dCI): DC injection stop. This type of stop cannot be used with certain other functions. See table on page 133.

  Note: A fault trip will occur when the thermal state reaches 118% of the rated state and reactivation will occur when the state falls back below 90%.

tHA [Drv therm. state al]

0 to 118% | 100%

Trip threshold for drive thermal alarm (logic output or relay)

Parameter that can be modified during operation or when stopped.

(1) Because, in this case, the fault does not trigger a stop, it is essential to assign a relay or logic output to its indication.

Deferred stop on thermal alarm

This function is designed in particular for elevator applications. It prevents the elevator stopping between two floors if the drive or motor overheats, by authorizing operation until the next stop. At the next stop, the drive is locked until the thermal state falls back to a value, which undershoots the set threshold by 20%. Example: A trip threshold set at 80% enables reactivation at 60%.
One thermal state threshold must be defined for the drive, and one thermal state threshold for the motor(s), which will trip the deferred stop.

Code	Name/Description	Adjustment range	Factory setting
SAt -	**[THERMAL ALARM STOP]**		
SAt nO YES	**[Thermal alarm stop]** ☐ **[No]** (nO) : Function inactive (in this case, the following parameters cannot be accessed) ☐ **[Yes]** (YES) : Freewheel stop on drive or motor thermal alarm **CAUTION** The drive and motor are no longer protected in the event of thermal alarm stops. This invalidates the warranty. Check that the possible consequences do not present any risk. **Failure to follow this instruction can result in equipment damage.**		[No] (nO)
tHA ( )	**[Drv therm. state al]** Thermal state threshold of the drive tripping the deferred stop.	0 to 118%	100%
ttd ( )	**[Motor therm. level]** Thermal state threshold of the motor tripping the deferred stop.	0 to 118%	100%
ttd2 ( )	**[Motor2 therm. level]** Thermal state threshold of the motor 2 tripping the deferred stop.	0 to 118%	100%
ttd3 ( )	**[Motor3 therm. level]** Thermal state threshold of the motor 3 tripping the deferred stop.	0 to 118%	100%

( ) Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting
EtF-	**[EXTERNAL FAULT]**		
EtF	**[External fault ass.]**		[No] (nO)
	☐ **[No]** (nO): Function inactive ☐ **[LI1]** (LI1) : : ☐ **[...]** (...) : See the assignment conditions on page 127. If the assigned bit is at 0, there is no external fault. If the assigned bit is at 1, there is an external fault. Logic can be configured via [External fault config] (LEt) if a logic input has been assigned.		
LEt	**[External fault config]**		[Active high] (HIG)
	Parameter can be accessed if the external fault has been assigned to a logic input. It defines the positive or negative logic of the input assigned to the fault. ☐ **[Active low]** (LO): Fault on falling edge (change from 1 to 0) of the assigned input. ☐ **[Active high]** (HIG): Fault on rising edge (change from 0 to 1) of the assigned input.		
EPL	**[External fault mgt]**		[Freewheel] (YES)
	Type of stop in the event of an external fault ☐ **[Ignore]** (nO): Fault ignored. ☐ **[Freewheel]** (YES): Freewheel stop. ☐ **[Per STT]** (Stt): Stop according to configuration of [Type of stop] (Stt) page 144, without fault tripping. In this case the fault relay does not open and the drive is ready to restart as soon as the fault disappears, according to the restart conditions of the active command channel (e.g., according to [2/3 wire control] (tCC) and [2 wire type] (tCt) page 92 if control is via the terminals). Configuring an alarm for this fault is recommended (assigned to a logic output, for example) in order to indicate the cause of the stop. ☐ **[fallback spd]** (LFF): Change to fallback speed, maintained as long as the fault persists and the run command has not been removed (1). ☐ **[Spd maint.]** (rLS): The drive maintains the speed being applied when the fault occurred, as long as the fault is present and the run command has not been removed (1). ☐ **[Ramp stop]** (rMP): Stop on ramp. ☐ **[Fast stop]** (FSt): Fast stop. ☐ **[DC injection]** (dCI): DC injection stop. This type of stop cannot be used with certain other functions. See table on page 133.		

(1) Because, in this case, the fault does not trigger a stop, it is essential to assign a relay or logic output to its indication.

Code	Name/Description	Adjustment range	Factory setting
uSb-	**[UNDERVOLTAGE MGT]**		
uSb	**[UnderV. fault mgt]**		[Flt&R1open] (0)
	Behavior of the drive in the event of an undervoltage ☐ **[Flt&R1open]** (0): Fault and fault relay open. ☐ **[Flt&R1close]** (1): Fault and fault relay closed. ☐ **[Alarm]** (2): Alarm and fault relay remains closed. The alarm can be assigned to a logic output or a relay.		
urES	**[Mains voltage]**	According to drive voltage rating	According to drive voltage rating
	Rated voltage of the line supply in V. For ATV71ATV71●●●M3: ☐ **[200V ac]** (200): 200 Volts AC ☐ **[220V ac]** (220): 220 Volts AC ☐ **[240V ac]** (240): 240 Volts AC ☐ **[260V ac]** (260): 260 Volts AC (factory setting) For ATV71●●●N4: ☐ **[380V ac]** (380): 380 Volts AC ☐ **[400V ac]** (400): 400 Volts AC ☐ **[440V ac]** (440): 440 Volts AC ☐ **[460V ac]** (460): 460 Volts AC ☐ **[480V ac]** (480): 480 Volts AC (factory setting) For ATV71●●●S6X: ☐ **[500 Vac]** (500): 500 Volts AC ☐ **[600 Vac]** (600): 600 Volts AC (factory setting) For ATV71●●●Y: ☐ **[500 Vac]** (500): 500 Volts AC ☐ **[600 Vac]** (600): 600 Volts AC ☐ **[690 Vac]** (690): 690 Volts AC (factory setting)		
uSL	**[Undervoltage level]**		
	Undervoltage fault trip level setting in V. The adjustment range and factory setting are determined by the drive voltage rating and the [Mains voltage] (UrES) value.		
uSt	**[Undervolt. time out]**	0.2 s to 999.9 s	0.2 s
	Time delay for taking undervoltage fault into account		
StP	**[UnderV. prevention]**		[No] (nO)
	Behavior in the event of the undervoltage fault prevention level being reached ☐ **[No]** (nO): No action ☐ **[DC Maintain]** (MMS): This stop mode uses the inertia to maintain the DC bus voltage as long as possible. ☐ **[Ramp stop]** (rMP): Stop following an adjustable ramp [Max stop time] (StM). ☐ **[Lock-out]** (LnF): Lock (freewheel stop) without fault		

Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting
uSb-	**[UNDERVOLTAGE MGT]** (continued)		
tSn	**[UnderV. restart tm]**	1.0 s to 999.9 s	1.0 s
	Time delay before authorizing the restart after a complete stop for [UnderV. prevention] (StP) = [Ramp stop] (rMP), if the voltage has returned to normal.		
uPL	**[Prevention level]**		
	Undervoltage fault prevention level setting in V, which can be accessed if [UnderV. prevention] (StP) is not [No] (nO). The adjustment range and factory setting are determined by the drive voltage rating and the [Mains voltage] (UrES) value.		
StM	**[Max stop time]**	0.01 to 60.00 s	1.00 s
	Ramp time if [UnderV. prevention] (StP) = [Ramp stop] (rMP).		
tbS	**[DC bus maintain tm]**	1 to 9999 s	9999 s
	DC bus maintain time if [UnderV. prevention] (StP) = [DC Maintain] (MMS).		
tIt-	**[IGBT TESTS]**		
Strt	**[IGBT test]**		[Yes] (YES)
nO YES	☐ **[No]** (nO): No test ☐ **[Yes]** (YES): The IGBTs are tested on power up and every time a run command is sent. These tests cause a slight delay (a few ms). In the event of a fault, the drive will lock. The following faults can be detected: - Drive output short-circuit (terminals U-V-W): SCF display - IGBT faulty: xtF, where x indicates the number of the IGBT concerned - IGBT short-circuited: x2F, where x indicates the number of the IGBT concerned		

Parameter that can be modified during operation or when stopped.

Code	Name/Description	Adjustment range	Factory setting

[4-20mA LOSS]

LFL2 — [AI2 4-20mA loss]

[Ignore] (nO)

- nO — **[Ignore]** (nO): Fault ignored. This configuration is the only one possible if [AI2 min. value] (CrL2) page 98 is not greater than 3 mA or if [AI2 Type] (AI2t) page 98 = [Voltage] (10U).
- YES — **[Freewheel]** (YES): Freewheel stop.
- Stt — **[Per STT]** (Stt): Stop according to configuration of [Type of stop] (Stt) page 144, without fault tripping. In this case the fault relay does not open and the drive is ready to restart as soon as the fault disappears, according to the restart conditions of the active command channel (e.g., according to [2/3 wire control] (tCC) and [2 wire type] (tCt) page 92 if control is via the terminals). Configuring an alarm for this fault is recommended (assigned to a logic output, for example) in order to indicate the cause of the stop.
- LFF — **[fallback spd]** (LFF): Change to fallback speed, maintained as long as the fault persists and the run command has not been removed (1).
- rLS — **[Spd maint.]** (rLS): The drive maintains the speed being applied when the fault occurred, as long as the fault is present and the run command has not been removed (1).
- rMP — **[Ramp stop]** (rMP): Stop on ramp.
- FSt — **[Fast stop]** (FSt): Fast stop.
- dCI — **[DC injection]** (dCI): DC injection stop. This type of stop cannot be used with certain other functions. See table on page 133.

LFL3 — [AI3 4-20mA loss]

[Ignore] (nO)

- nO — **[Ignore]** (nO): Fault ignored. This configuration is the only one possible if [AI3 min. value] (CrL3) page 99 is not greater than 3 mA.
- YES — **[Freewheel]** (YES): Freewheel stop.
- Stt — **[Per STT]** (Stt): Stop according to configuration of [Type of stop] (Stt) page 144, without fault tripping. In this case the fault relay does not open and the drive is ready to restart as soon as the fault disappears, according to the restart conditions of the active command channel (e.g., according to [2/3 wire control] (tCC) and [2 wire type] (tCt) page 92 if control is via the terminals). Configuring an alarm for this fault is recommended (assigned to a logic output, for example) in order to indicate the cause of the stop.
- LFF — **[fallback spd]** (LFF): Change to fallback speed, maintained as long as the fault persists and the run command has not been removed (1).
- rLS — **[Spd maint.]** (rLS): The drive maintains the speed being applied when the fault occurred, as long as the fault is present and the run command has not been removed (1).
- rMP — **[Ramp stop]** (rMP): Stop on ramp.
- FSt — **[Fast stop]** (FSt): Fast stop.
- dCI — **[DC injection]** (dCI): DC injection stop. This type of stop cannot be used with certain other functions. See table on page 133.

LFL4 — [AI4 4-20mA loss]

[Ignore] (nO)

- nO — **[Ignore]** (nO): Fault ignored. This configuration is the only one possible if [AI4 min. value] (CrL4) page 100 is not greater than 3 mA or if [AI4 Type] (AI4t) page 100 = [Voltage] (10U).
- YES — **[Freewheel]** (YES): Freewheel stop.
- Stt — **[Per STT]** (Stt): Stop according to configuration of [Type of stop] (Stt) page 144, without fault tripping. In this case the fault relay does not open and the drive is ready to restart as soon as the fault disappears, according to the restart conditions of the active command channel (e.g., according to [2/3 wire control] (tCC) and [2 wire type] (tCt) page 92 if control is via the terminals). Configuring an alarm for this fault is recommended (assigned to a logic output, for example) in order to indicate the cause of the stop.
- LFF — **[fallback spd]** (LFF): Change to fallback speed, maintained as long as the fault persists and the run command has not been removed (1).
- rLS — **[Spd maint.]** (rLS): The drive maintains the speed being applied when the fault occurred, as long as the fault is present and the run command has not been removed (1).
- rMP — **[Ramp stop]** (rMP): Stop on ramp.
- FSt — **[Fast stop]** (FSt): Fast stop.
- dCI — **[DC injection]** (dCI): DC injection stop. This type of stop cannot be used with certain other functions. See table on page 133.

(1) Because, in this case, the fault does not trigger a stop, it is essential to assign a relay or logic output to its indication.

Parameter can be accessed in [Expert] mode.

Code	Name/Description	Adjustment range	Factory setting
inH-	**[FAULT INHIBITION]**		
inH	**❏ [Fault inhibit assign.]**		[No] (nO)

To assign fault inhibit, press and hold down the “ENT” key for 2 s.

CAUTION

RISK OF EQUIPMENT DAMAGE

Inhibiting faults results in the drive not being protected. This invalidates the warranty.
Check that the possible consequences do not present any risk.
Failure to follow these instructions can result in equipment damage.

nO
LI1
-
-
-

☐ **[No]** (nO): Function inactive
☐ **[LI1]** (LI1)
:
:
☐ **[...]** (...) : See the assignment conditions on page 127.
If the assigned input or bit is at 0, fault monitoring is active. If the assigned input or bit is at 1, fault monitoring is inactive. Active faults are reset on a rising edge (change from 0 to 1) of the assigned input or bit.

Note: The "Power Removal" function and any faults that prevent any form of operation are not affected by this function.
A list of faults affected by this function appears on pages 272 to 277.

Code	Name/Description	Adjustment range	Factory setting
CLL-	**[COM. FAULT MANAGEMENT]**		
CLL	**[Network fault mgt]**		[Freewheel] (YES)
	Behavior of the drive in the event of a communication fault with a communication card		
nO	☐ **[Ignore]** (nO): Fault ignored.		
YES	☐ **[Freewheel]** (YES): Freewheel stop.		
Stt	☐ **[Per STT]** (Stt): Stop according to configuration of [Type of stop] (Stt) page 144, without fault tripping. In this case the fault relay does not open and the drive is ready to restart as soon as the fault disappears, according to the restart conditions of the active command channel (e.g., according to [2/3 wire control] (tCC) and [2 wire type] (tCt) page 92 if control is via the terminals).		
LFF	☐ **[fallback spd]** (LFF): Change to fallback speed, maintained as long as the fault persists and the run command has not been removed (1).		
rLS	☐ **[Spd maint.]** (rLS): The drive maintains the speed being applied when the fault occurred, as long as the fault is present and the run command has not been removed (1).		
rMP	☐ **[Ramp stop]** (rMP): Stop on ramp.		
FSt	☐ **[Fast stop]** (FSt): Fast stop.		
dCI	☐ **[DC injection]** (dCI): DC injection stop. This type of stop cannot be used with certain other functions. See table on page 133.		
CoL	**[CANopen fault mgt]**		[Freewheel] (YES)
	Behavior of the drive in the event of a communication fault with integrated CANopen		
nO	☐ **[Ignore]** (nO): Fault ignored.		
YES	☐ **[Freewheel]** (YES): Freewheel stop.		
Stt	☐ **[Per STT]** (Stt): Stop according to configuration of [Type of stop] (Stt) page 144, without fault tripping. In this case the fault relay does not open and the drive is ready to restart as soon as the fault disappears, according to the restart conditions of the active command channel (e.g., according to [2/3 wire control] (tCC) and [2 wire type] (tCt) page 92 if control is via the terminals).		
LFF	☐ **[fallback spd]** (LFF): Change to fallback speed, maintained as long as the fault persists and the run command has not been removed (1).		
rLS	☐ **[Spd maint.]** (rLS): The drive maintains the speed being applied when the fault occurred, as long as the fault is present and the run command has not been removed (1).		
rMP	☐ **[Ramp stop]** (rMP): Stop on ramp.		
FSt	☐ **[Fast stop]** (FSt): Fast stop.		
dCI	☐ **[DC injection]** (dCI): DC injection stop. This type of stop cannot be used with certain other functions. See table on page 133.		
SLL	**[Modbus fault mgt]**		[Freewheel] (YES)
	Behavior of the drive in the event of a communication fault with integrated Modbus		
nO	☐ **[Ignore]** (nO): Fault ignored.		
YES	☐ **[Freewheel]** (YES): Freewheel stop.		
Stt	☐ **[Per STT]** (Stt): Stop according to configuration of [Type of stop] (Stt) page 144, without fault tripping. In this case the fault relay does not open and the drive is ready to restart as soon as the fault disappears, according to the restart conditions of the active command channel (e.g., according to [2/3 wire control] (tCC) and [2 wire type] (tCt) page 92 if control is via the terminals).		
LFF	☐ **[fallback spd]** (LFF): Change to fallback speed, maintained as long as the fault persists and the run command has not been removed (1).		
rLS	☐ **[Spd maint.]** (rLS): The drive maintains the speed being applied when the fault occurred, as long as the fault is present and the run command has not been removed (1).		
rMP	☐ **[Ramp stop]** (rMP): Stop on ramp.		
FSt	☐ **[Fast stop]** (FSt): Fast stop.		
dCI	☐ **[DC injection]** (dCI): DC injection stop. This type of stop cannot be used with certain other functions. See table on page 133.		

(1) Because, in this case, the fault does not trigger a stop, it is essential to assign a relay or logic output to its indication.

Code	Name/Description	Adjustment range	Factory setting
Sdd-	**[ENCODER FAULT]** Can be accessed if the encoder option card has been inserted and the encoder is used for speed feedback (see page 81).		
Sdd no YES	**[Load slip detection]** ☐ **[No]** (nO): Fault not monitored. Only the alarm may be assigned to a logic output or a relay. ☐ **[Yes]** (YES): Fault monitored. [Load slip detection] (Sdd) is forced to [Yes] (YES) if [Motor control type] (Ctt) page 73 = [FVC] (FUC). The fault is triggered by comparison with the ramp output and the speed feedback, and is only effective for speeds greater than 10% of the [Rated motor freq.] (FrS), see page 70. In the event of a fault, the drive will switch to a freewheel stop, and if the brake logic control function has been configured, the brake command will be set to 0.		[No] (nO)
ECC no YES	**[Encoder coupling]** ☐ **[No]** (nO): Fault not monitored. ☐ **[Yes]** (YES): Fault monitored. If the brake logic control function has been configured, the factory setting changes to [Yes] (YES). [Encoder coupling] (ECC) = [Yes] (YES) is only possible if [Load slip detection] (Sdd) = [Yes] (YES) and [Motor control type] (Ctt) page 73 = [FVC] (FUC) and [Brake assignment] (bLC) page 164 is not [No] (nO). The fault monitored is the break in the mechanical coupling of the encoder. In the event of a fault, the drive will switch to a freewheel stop, and if the brake logic control function has been configured, the brake command will be set to 0.		[No] (nO)
ECt	**[Encoder check time]** Encoder faults filtering time. The parameter can be accessed if [Encoder coupling] (ECC) = [Yes] (YES)	2 to 10 s	2 s
tid-	**[TORQUE OR I LIM. DETECT]**		
SSb no YES Stt LFF rLS rMP FSt dCi	**[Trq/I limit. stop]** Behavior in the event of switching to torque or current limitation ☐ **[Ignore]** (nO): Fault ignored. ☐ **[Freewheel]** (YES): Freewheel stop. ☐ **[Per STT]** (Stt): Stop according to configuration of [Type of stop] (Stt) page 144, without fault tripping. In this case the fault relay does not open and the drive is ready to restart as soon as the fault disappears, according to the restart conditions of the active command channel (e.g., according to [2/3 wire control] (tCC) and [2 wire type] (tCt) page 92 if control is via the terminals). Configuring an alarm for this fault is recommended (assigned to a logic output, for example) in order to indicate the cause of the stop. ☐ **[fallback spd]** (LFF): Change to fallback speed, maintained as long as the fault persists and the run command has not been removed (1). ☐ **[Spd maint.]** (rLS): The drive maintains the speed being applied when the fault occurred, as long as the fault is present and the run command has not been removed (1). ☐ **[Ramp stop]** (rMP): Stop on ramp. ☐ **[Fast stop]** (FSt): Fast stop. ☐ **[DC injection]** (dCI): DC injection stop. This type of stop cannot be used with certain other functions. See table on page 133.		[Ignore] (nO)
Sto ( )	**[Trq/I limit. time out]** (If fault has been configured) Time delay for taking SSF "Limitation" fault into account	0 to 9999 ms	1000 ms

( ) Parameter that can be modified during operation or when stopped.


(1) Because, in this case, the fault does not trigger a stop, it is essential to assign a relay or logic output to its indication.

Use of the "Pulse input" input to measure the speed of rotation of the motor.

This function uses the "Pulse input" input from the VW3A3202 extension card and can, therefore, only be used if this card has been inserted and if the "Pulse input" input is not being used for another function.

Example of use

An indexed disk driven by the motor and connected to a proximity sensor can be used to generate a frequency signal that is proportional to the speed of rotation of the motor.

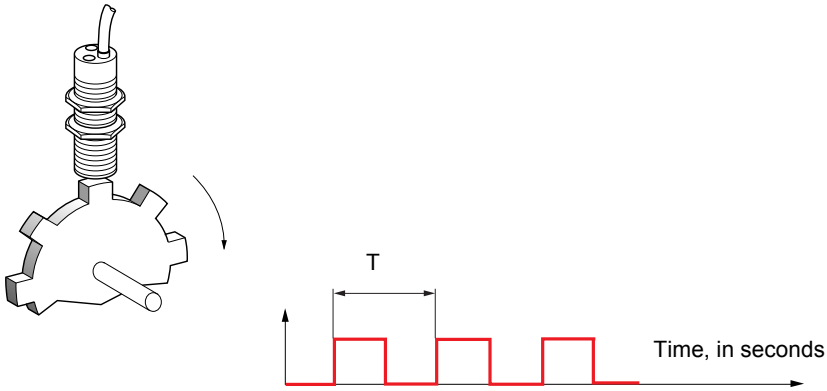

When applied to the "Pulse input" input, this signal supports:

- Measurement and display of the motor speed: signal frequency = 1/T. This frequency is displayed by means of the [Pulse in. work. freq.] (FqS) parameter, page 51 or 53.
- Overspeed detection (if the measured speed exceeds a preset threshold, the drive will trip on a fault).
- Brake failure detection, if brake logic control has been configured: If the speed does not drop sufficiently quickly following a command to engage the brake, the drive will trip on a fault. This function can be used to detect worn brake linings.
- Detection of a speed threshold that can be adjusted using [Pulse warning thd.] (FqL) page 68 and is assignable to a relay or logic output, see page 106.

Code	Name/Description	Adjustment range	Factory setting
FqF-	**[FREQUENCY METER]** Can be accessed if a VW3A3202 option card has been inserted		
FqF nO YES	**[Frequency meter]** Activation of the speed measurement function. ☐ **[No]** (nO): Function inactive, In this case, none of the function parameters can be accessed. ☐ **[Yes]** (YES): Function active, assignment only possible if no other functions have been assigned to the "Pulse input" input.		[No] (nO)
FqC	**[Pulse scal. divisor]** • Scaling factor for the "Pulse input" input (divisor). The frequency measured is displayed by means of the [Pulse in. work. freq.] (FqS) parameter, page 51 or 53.	1.0 to 100.0	1.0
FqA nO -	**[Overspd. pulse thd.]** Activation and adjustment of overspeed monitoring: [Overspeed] (SOF) fault. ☐ **[No]** (nO): No overspeed monitoring. ☐ **1 Hz to 30.00 Hz**: Adjustment of the frequency tripping threshold on the "Pulse input" input divided by [Pulse scal. divisor] (FqC).		[No] (nO)
tdS	**[Pulse overspd delay]** Time delay for taking overspeed fault into account	0.0 s to 10.0 s	0.0 s
Fdt nO -	**[Level fr. pulse ctrl]** Activation and adjustment of monitoring for the input Pulse input (speed feedback): [Speed fdback loss] (SPF) fault. ☐ **[No]** (nO): No monitoring of speed feedback. ☐ **0.1 Hz to 500.0 Hz**: Adjustment of the motor frequency threshold for tripping a speed feedback fault (difference between the estimated frequency and the measured speed).		[No] (nO)
FqE nO -	**[Pulse thd. wo Run]** Activation and adjustment of brake failure monitoring: [Brake feedback] (brF). If brake logic control [Brake assignment] (bLC) page 164 is not configured, this parameter is forced to [No] (nO). ☐ **[No]** (nO): No brake monitoring. ☐ **1 Hz to 599 Hz**: Adjustment of the motor frequency threshold for tripping a brake failure fault (detection of speeds other than zero).		[No] (nO)
tqb	**[Pulse thd. wo Run]** Time delay for taking brake failure fault into account.	0.0 s to 10.0 s	0.0 s

Load variation detection

This detection is only possible with the "high-speed hoisting" function. It can be used to detect if an obstacle has been reached, triggering a sudden (upward) increase or (downward) decrease in the load.
Load variation detection triggers a [Dynamic load fault] fault (dLF). The [Dyn. load Mgt.] (dLb) parameter can be used to configure the response of the drive in the event of this fault.
Load variation detection can also be assigned to a relay or a logic output.

There are two possible detection modes, depending on the configuration of high-speed hoisting:

"Speed reference" mode

[High speed hoisting] (HSO) page 176 = [Speed ref] (SSO).
Torque variation detection.

During high-speed operation, the load is compared to that measured during the speed step. The permissible load variation and its duration can be configured. If exceeded, the drive switches to fault mode.

"Current limitation" mode

[High speed hoisting] (HSO) page 176 = [Current Limit] (CSO).

On ascend, during high-speed operation, an increase in load will result in a drop in speed. Even if high-speed operation has been activated, if the motor frequency drops below the [I Limit Frequency] (SCL) threshold page 176 the drive will switch to fault mode. The detection is realised only for a positive variations of the load and only in the high speed area (area upper to [I Limit. frequency] (SCL)).

On descend, operation takes the form of "speed reference" mode.

Code	Name/Description	Adjustment range	Factory setting
dLd-	**[DYNAMIC LOAD DETECT.]** Load variation detection. This can be accessed if [High speed hoisting] (HSO) page 176 is not [No] (nO).		
tLd	**[Dynamic load time]**		[No] (nO)
	Activation of load variation detection and adjustment of time delay for taking load variation fault[Dynamic load fault] (dLF) into account. nO - **[No]** (nO): No load variation detection. ☐ **0.00 s to 10.00 s** : Adjustment of the time delay for taking fault into account.		
dLd	**[Dynamic load time]**	1 to 100 %	100 %
	Adjustment of the trip threshold for load variation detection, as a % of the load measured during the speed step.		
dLb	**[Dyn. load Mgt.]**		[Freewheel] (YES)
	Behavior of the drive in the event of a load variation fault. nO ☐ **[Ignore]** (nO): Fault ignored. YES ☐ **[Freewheel]** (YES): Freewheel stop. Stt ☐ **[Per STT]** (Stt): Stop according to configuration of[Type of stop] (Stt) page 144, without tripping fault. In this case the fault relay does not open and the drive is ready to restart as soon as the fault disappears, according to the restart conditions of the active command channel, (e.g. according to [2/3 wire control] (tCC) and [2 wire type] (tCt) page 92 if control is via the terminals). Configuring an alarm for this fault is recommended (assigned to a logic output, for example) in order to indicate the cause of the stop. LFF ☐ **[Fallback spd.]** (LFF): Change to fallback speed, maintained as long as the fault persists and the run command has not been removed (1). rLS ☐ **[Spd maint.]** (rLS): The drive maintains the speed at the time the fault occurred, as long as the fault persists and the run command has not been removed (1). rMP ☐ **[Ramp stop]** (rMP): Stop on ramp. FSt ☐ **[Fast stop]** (FSt): Fast stop.		

(1) Because, in this case, the fault does not trigger a stop, it is essential to assign a relay or logic output to its indication.

Code	Name/Description	Adjustment range	Factory setting
brP-	**[DB RES. PROTECTION]**		
bro no YES FLt	**[DB res. protection]** ☐ **[No]** (nO): No braking resistor protection (thereby preventing access to the other function parameters). ☐ **[Alarm]** (YES): Alarm. The alarm may be assigned to a logic output or a relay (see page 106) ☐ **[Fault]** (FLt): Switch to fault (bOF) with locking of drive (freewheel stop). ☞ **Note:** The thermal state of the resistor can be displayed on the graphic display terminal. It is calculated for as long as the drive control remains connected to the power supply.		[No] (nO)
brP ( )	**[DB Resistor Power]** This parameter can be accessed if[DB res. protection] (brO) is not [No] (nO). Rated power of the resistor used.	0.1 kW (0.13 HP) to 1000 kW (1333 HP)	0.1 kW (0.13 HP)
bru ( )	**[DB Resistor value]** This parameter can be accessed if[DB res. protection] (brO) is not [No] (nO). Rated value of the braking resistor in ohms.	0.1 to 200 ohms	0.1 ohms
buF-	**[BU PROTECTION]** Parameter accessible at and above ATV71HD55M3X, ATV71HD90N4 and ATV71HC11Y.		
bub no YES	**[Brake res. fault Mgt]** Management of short-circuit [DB unit sh. circuit] (bUF) and overheating [Internal- th. sensor] (InFb) faults in the braking unit. ☐ **[Ignore]** (nO): Fault ignored. **Configuration to be used if there is no resistor or braking unit connected to the drive.** ☐ **[Freewheel]** (YES): freewheel stop.		[Freewheel] (YES)
tnF-	**[AUTO TUNING FAULT]**		
tnL no YES	**[Autotune fault mgt]** ☐ **[Ignore]** (nO): Fault ignored. ☐ **[Freewheel]** (YES): Freewheel stop.		[Freewheel] (YES)

( ) Parameter that can be modified during operation or when stopped.

Card pairing

Function can only be accessed in [Expert] mode.

This function is used to detect whenever a card has been replaced or the software has been modified in any way.
When a pairing password is entered, the parameters of the cards currently inserted are stored. On every subsequent power-up these parameters are verified and, in the event of a discrepancy, the drive locks in HCF fault mode. Before the drive can be restarted you must revert to the original situation or re-enter the pairing password.

The following parameters are verified:

- The type of card for: all cards.
- The software version for: the two control cards, the VW3A3202 extension card, the Controller Inside card and the communication cards.
- The serial number for: the two control cards.

Code	Name/Description	Adjustment range	Factory setting
PP1-	■ [CARDS PAIRING]		
PP1	❑ [Pairing password] The [OFF] (OFF) value signifies that the card pairing function is inactive. The [ON] (On) value signifies that card pairing is active and that an access code must be entered in order to start the drive in the event of a card pairing fault. As soon as the code has been entered the drive is unlocked and the code changes to [ON] (On). - The PPI code is an unlock code known only to Schneider Electric Product Support.	OFF to 9999	[OFF] (OFF)


Code	Name/Description		Adjustment range	Factory setting
LFF-	**[FALLBACK SPEED]**			
LFF	**[Fallback speed]** Selection of the fallback speed		0 to 599 Hz	0 Hz
FSt-	**[RAMP DIVIDER]**			
dCF	**[Ramp divider]** The ramp that is enabled (dEC or dE2) is then divided by this coefficient when stop requests are sent. Value 0 corresponds to a minimum ramp time.	(1)	0 to 10	4
dC I-	**[DC INJECTION]**			
IdC	**[DC inject. level 1]** Level of DC injection braking current activated via logic input or selected as stop mode. **CAUTION** Check that the motor will withstand this current without overheating. **Failure to follow this instruction can result in equipment damage.**	(1) (3)	0.1 to 1.41 In (2)	0.64 In (2)
tdI	**[DC injection time 1]** Maximum current injection time [DC inject. level 1] (IdC). After this time the injection current becomes [DC inject. level 2] (IdC2).	(1) (3)	0.1 to 30 s	0.5 s
IdC2	**[DC inject. level 2]** Injection current activated by logic input or selected as stop mode, once period of time [DC injection time 1] (tdI) has elapsed. **CAUTION** Check that the motor will withstand this current without overheating. **Failure to follow this instruction can result in equipment damage.**	(1) (3)	0.1 In (2) to [DC inject. level 1] (IdC)	0.5 In (2)
tdC	**[DC injection time 2]** Maximum injection time [DC inject. level 2] (IdC2) for injection, selected as stop mode only. (Can be accessed if [Type of stop] (Stt) = [DC injection] (dCI)).	(1) (3)	0.1 to 30 s	0.5 s

(1) The parameter can also be accessed in the [1.3 SETTINGS] (SEt-) and [1.7 APPLICATION FUNCT.] (FUn-) menus.
(2) In corresponds to the rated drive current indicated in the Installation Manual and on the drive nameplate.
(3) Warning: These settings are independent of the [AUTO DC INJECTION] (AdC-) function.


Parameter that can be modified during operation or when stopped.

[1.9 COMMUNICATION] (COM-)

With graphic display terminal:

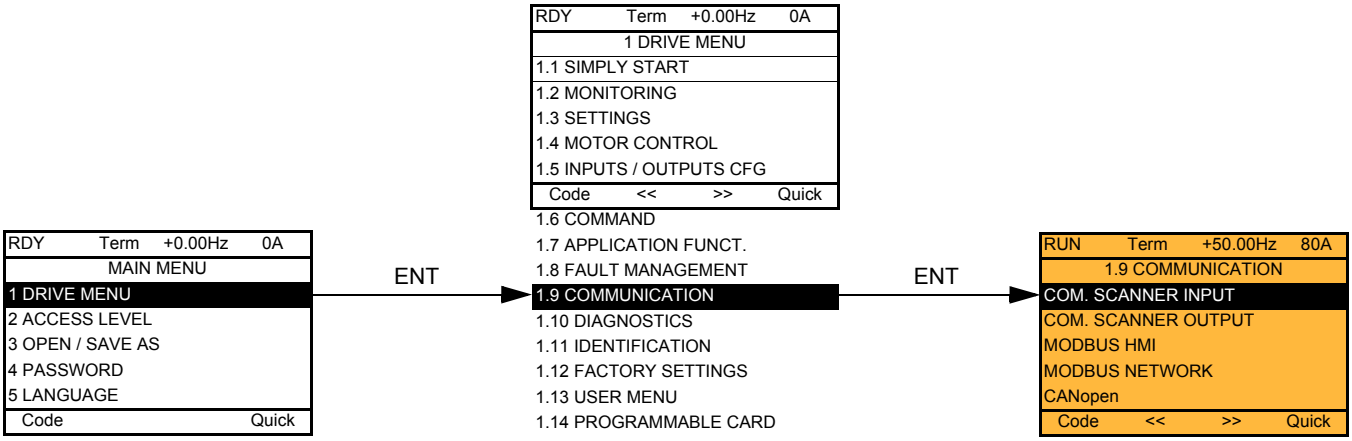

With integrated display terminal:

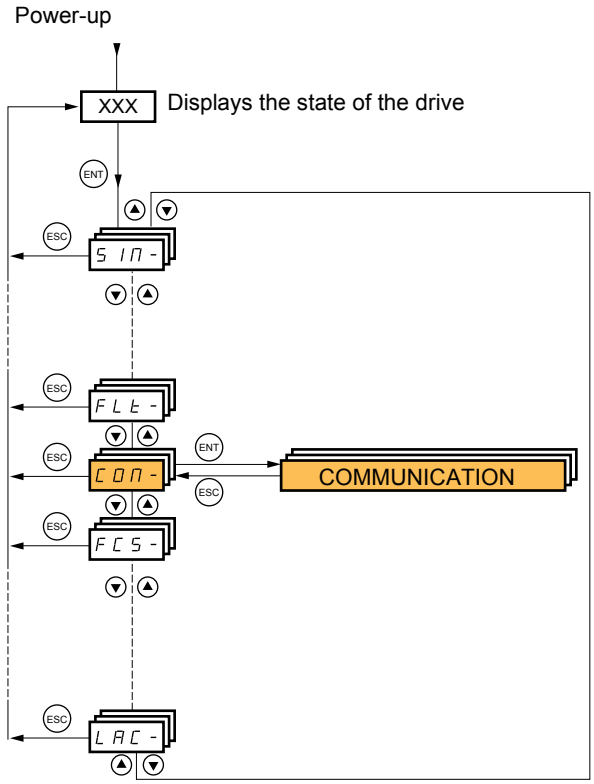


Code	Name/Description	Adjustment range	Factory setting
	■ [COM. SCANNER INPUT] **Only accessible via graphic display terminal**		
nMA1	❑ **[Scan. IN1 address]** Address of the 1st input word.		3201
nMA2	❑ **[Scan. IN2 address]** Address of the 2nd input word.		8604
nMA3	❑ **[Scan. IN3 address]** Address of the 3rd input word.		0
nMA4	❑ **[Scan. IN4 address]** Address of the 4th input word.		0
nMA5	❑ **[Scan. IN5 address]** Address of the 5th input word.		0
nMA6	❑ **[Scan. IN6 address]** Address of the 6th input word.		0
nMA7	❑ **[Scan. IN7 address]** Address of the 7th input word.		0
nMA8	❑ **[Scan. IN8 address]** Address of the 8th input word.		0
	■ [COM. SCANNER OUTPUT] **Only accessible via graphic display terminal**		
nCA1	❑ **[Scan.Out1 address]** Address of the 1st output word.		8501
nCA2	❑ **[Scan.Out2 address]** Address of the 2nd output word.		8602
nCA3	❑ **[Scan.Out3 address]** Address of the 3rd output word.		0
nCA4	❑ **[Scan.Out4 address]** Address of the 4th output word.		0
nCA5	❑ **[Scan.Out5 address]** Address of the 5th output word.		0
nCA6	❑ **[Scan.Out6 address]** Address of the 6th output word.		0
nCA7	❑ **[Scan.Out7 address]** Address of the 7th output word.		0
nCA8	❑ **[Scan.Out8 address]** Address of the 8th output word.		0


Code	Name/Description	Adjustment range	Factory setting
Md2-	**[MODBUS HMI]** Communication with the graphic display terminal		
tbr2	**[HMI baud rate]** 9.6 or 19.2 kbps via the integrated display terminal. 9600 or 19200 bauds via the graphic display terminal. The graphic display terminal only operates if [HMI baud rate] (tbr2) = 19200 bauds (19.2 kbps). In order for any change in the assignment of [HMI baud rate] (tbr2) to be taken into account you must: - Provide confirmation in a confirmation window if using the graphic display terminal - Press the ENT key for 2 s if using the integrated display terminal		19.2 kbps
tFo2	**[HMI format]** Read-only parameter, cannot be modified.		8E1
Md1-	**[MODBUS NETWORK]**		
Add	**[Modbus Address]** OFF to 247		OFF
AMoA	**[Modbus add Prg C.]** Modbus address of the Controller Inside card OFF at 247 The parameter can be accessed if the Controller Inside card has been inserted and depending on its configuration (please consult the specific documentation).		OFF
AMoC	**[Modbus add Com.C.]** Modbus address of the communication card OFF to 247 The parameter can be accessed if a communication card has been inserted and depending on its configuration (please consult the specific documentation).		OFF
tbr	**[Modbus baud rate]** 4.8 - 9.6 - 19.2 - 38.4 kbps on the integrated display terminal. 4800, 9600, 19200 or 38400 bauds on the graphic display terminal.		19.2 kbps
tFo	**[Modbus format]** 8O1 - 8E1 - 8n1, 8n2		8E1
ttO	**[Modbus time out]** 0.1 to 30 s		10.0 s
CnO-	**[CANopen]**		
AdCo	**[CANopen address]** OFF to 127		OFF
bdCo	**[CANopen bit rate]** 50 - 125 - 250 - 500 kbps - 1 Mbps		125 kbps
ErCo	**[Error code]** Read-only parameter, cannot be modified.		

Code	Name/Description	Adjustment range	Factory setting
-	**[COMMUNICATION CARD]**		
	See the specific documentation for the card used.		
LCF-	**[FORCED LOCAL]**		
FLO	**[Forced local assign.]**		[No] (nO)
nO	☐ **[No]** (nO): Function inactive		
LI1	☐ **[LI1]** (LI1) to **[LI6]** (LI6)		
-	☐ **[LI7]** (LI7) to **[LI10]** (LI10): If VW3A3201 logic I/O card has been inserted		
LI14	☐ **[LI11]** (LI11) to **[LI14]** (LI14): If VW3A3202 extended I/O card has been inserted		
	Forced local mode is active when the input is at state 1. [Forced local assign.] (FLO) is forced to [No] (nO) if [Profile] (CHCF) page 128 = [I/O profile] (IO).		
FLOC	**[Forced local Ref.]**		[No] (nO)
nO	☐ **[No]** (nO): Not assigned (control via the terminals with zero reference).		
AI1	☐ **[AI1]** (AI1): Analog input		
AI2	☐ **[AI2]** (AI2): Analog input		
AI3	☐ **[AI3]** (AI3): Analog input, if VW3A3202 extension card has been inserted		
AI4	☐ **[AI4]** (AI4): Analog input, if VW3A3202 extension card has been inserted		
LCC	☐ **[HMI]** (LCC): Assignment of the reference and command to the graphic display terminal. Reference: [Frequency ref.] (LFr), page 51, command: RUN/STOP/FWD/REV buttons.		
PI	☐ **[RP]** (PI): Frequency input, if VW3A3202 extension card has been inserted		
PG	☐ **[Encoder]** (PG): Encoder input, if encoder card has been inserted If the reference is assigned to an analog input, [RP] (PI) or [Encoder] (PG) the command is automatically assigned to the terminals as well (logic inputs)		
FLOT	**[Time-out forc. local]**		10.0 s
	0.1 to 30 s The parameter can be accessed if [Forced local assign.] (FLO) is not [No] (nO). Time delay before communication monitoring is resumed on leaving forced local mode.		


[1.10 DIAGNOSTICS]

This menu can only be accessed with the graphic display terminal.

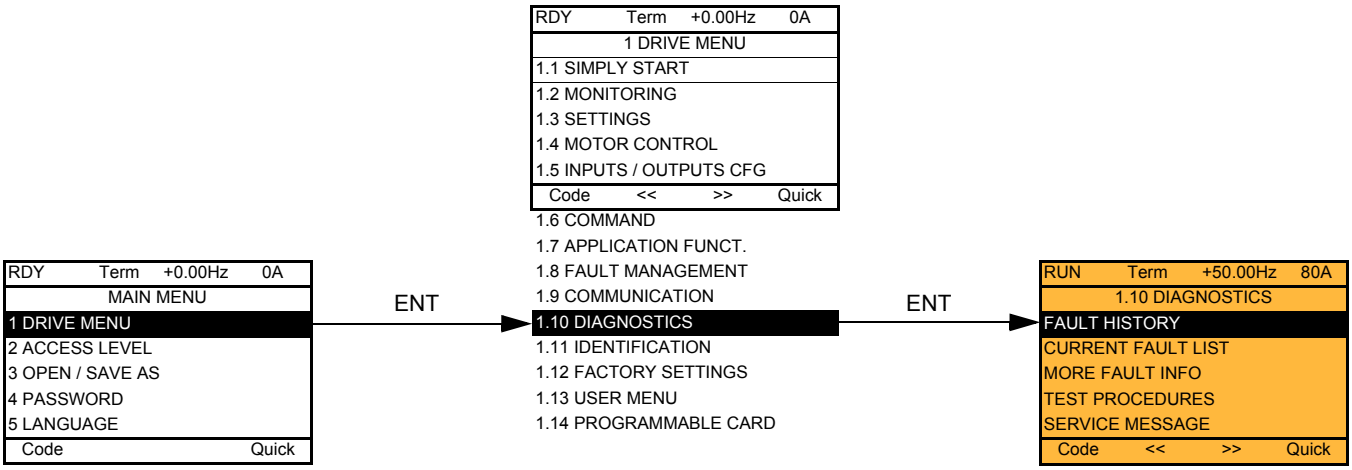

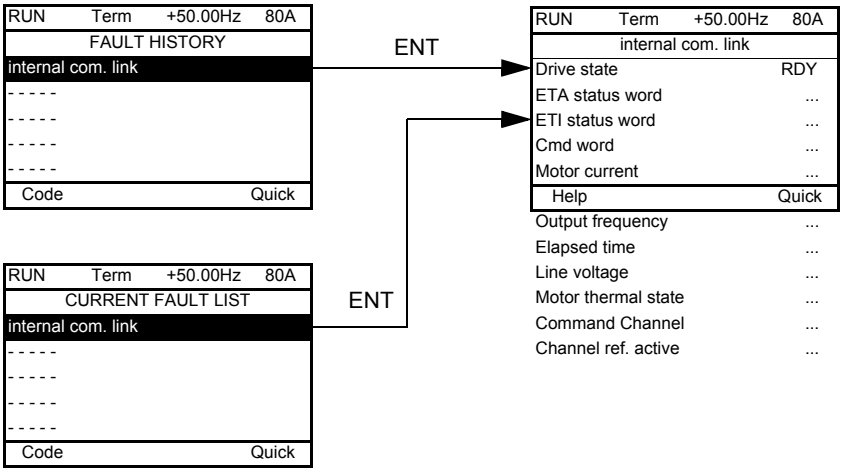


This screen indicates the state of the drive at the moment the selected fault occurred.

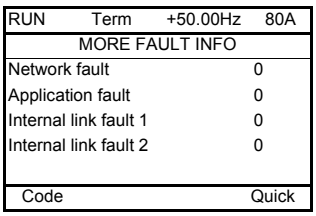

This screen indicates the number of communication faults, for example, with the option cards.
Number: from 0 to 65535

[1.10 DIAGNOSTICS]


[THYRISTORS TEST] is only accessible for ATV71●●●M3 drives ≥ 18.5 kW, ATV71●●●N4 drives > 18.5 kW and all ratings of ATV71●●●Y drives.

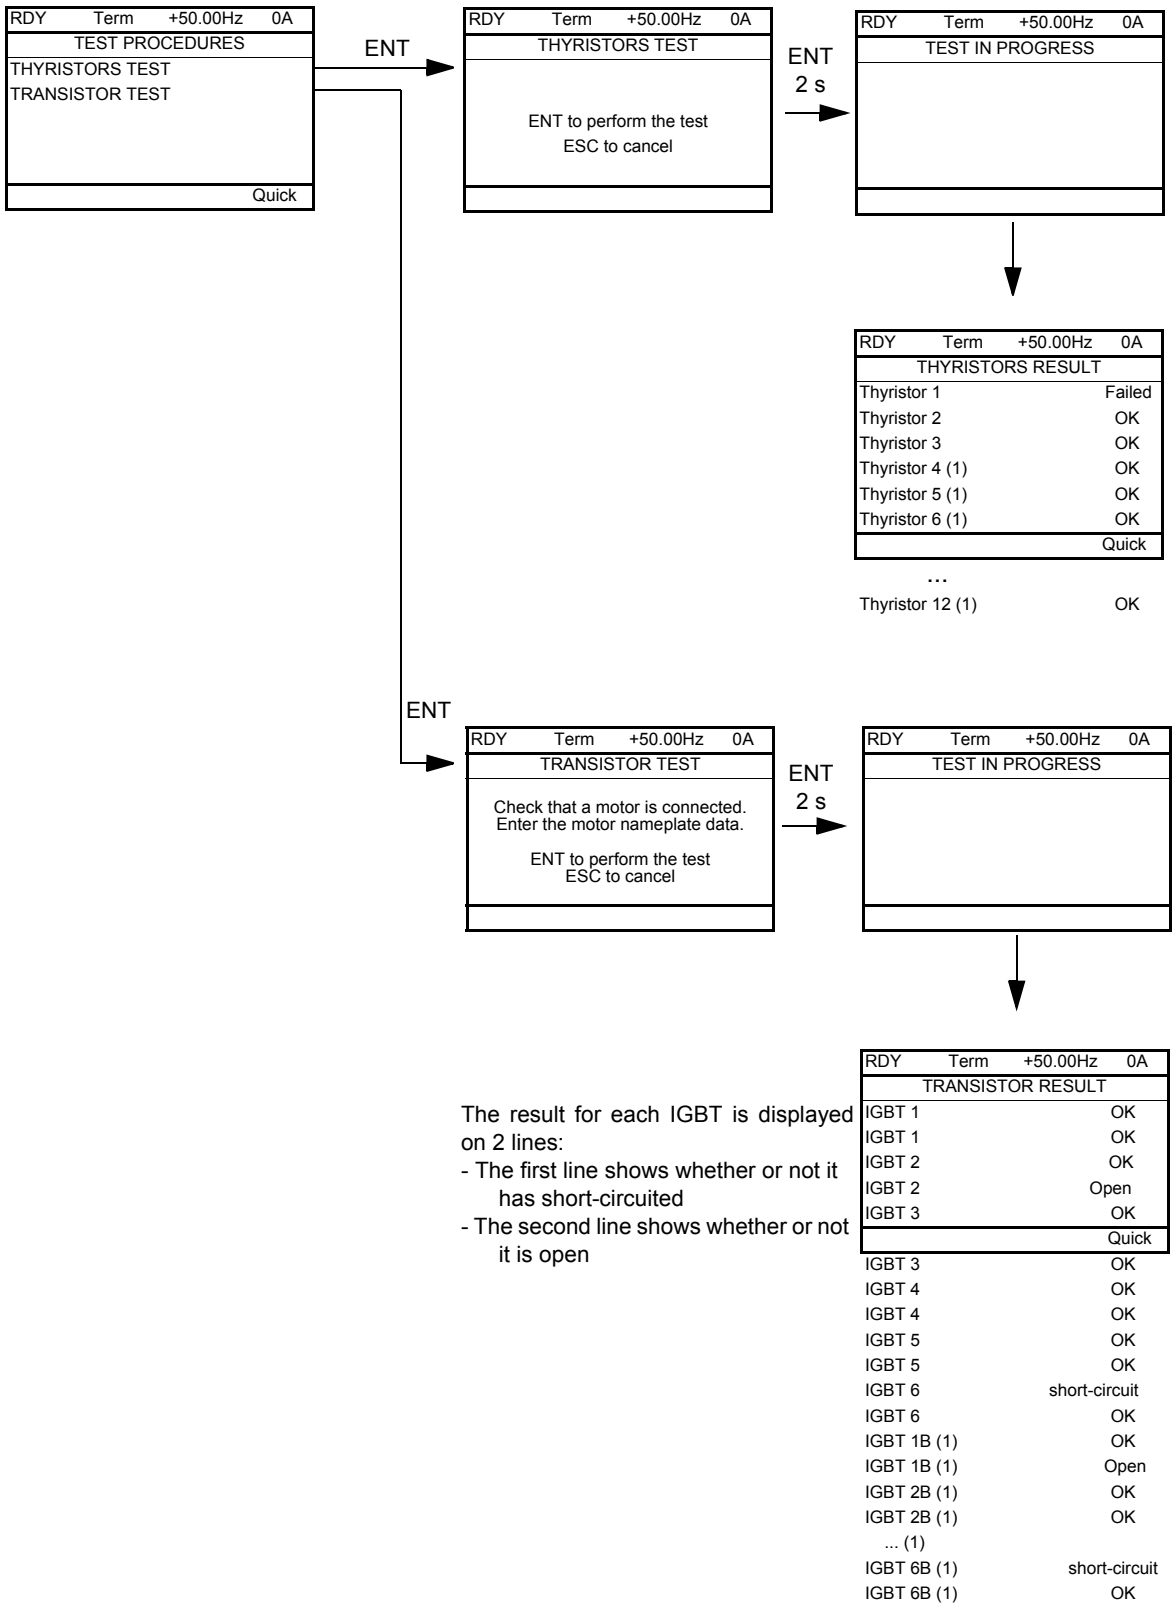

Note: To start the tests, press and hold down (2 s) the ENT key.

(1) Test results for Thyristor 4...12 and IGBT 1B ... 6B are olny accessible for ATV71EC71N4 to M13N4 and ATV71EM12Y to M20Y.

[1.11 IDENTIFICATION]

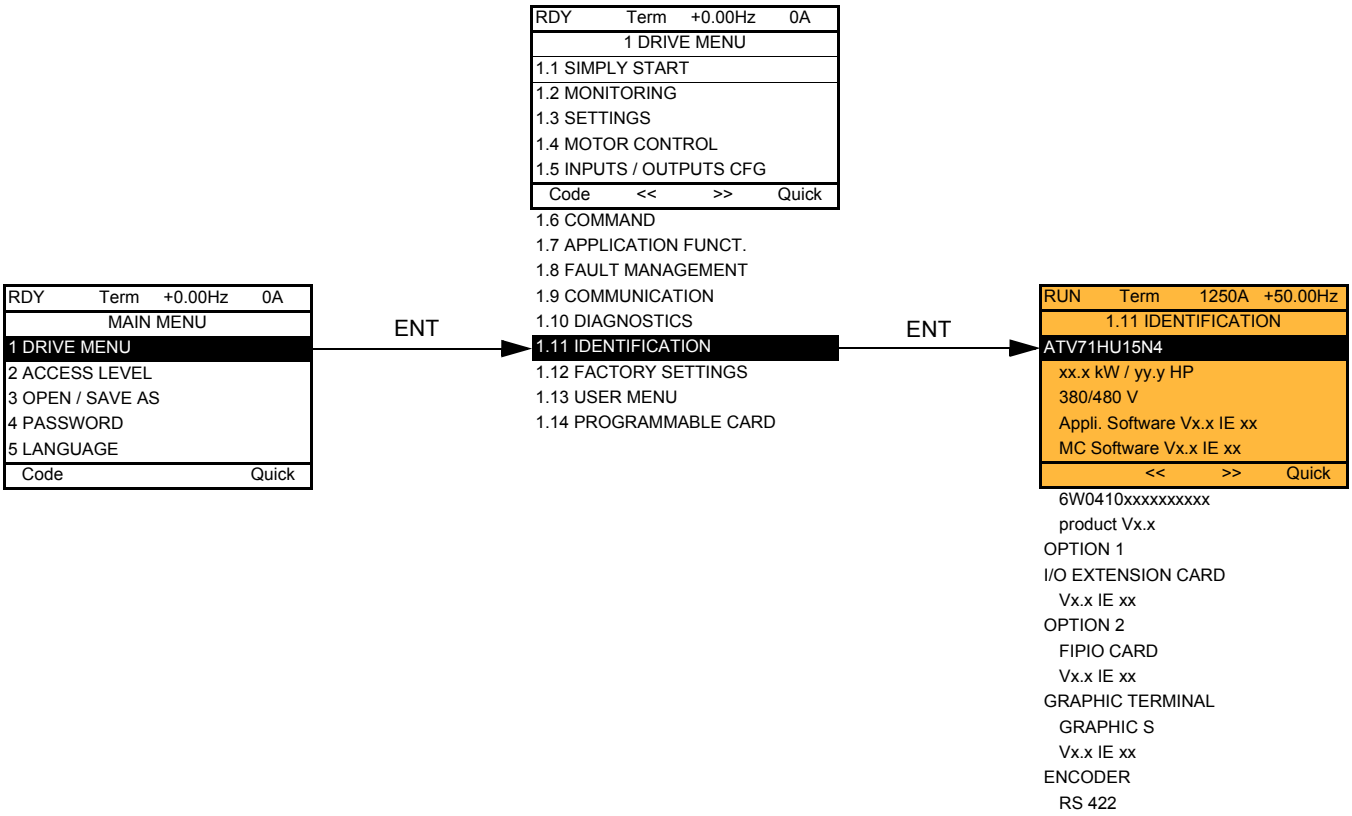


The [1.11 IDENTIFICATION] menu can only be accessed on the graphic display terminal.
This is a read-only menu that cannot be configured. It enables the following information to be displayed:


- Drive reference, power rating and voltage
- Drive software version
- Drive serial number
- Type of options present, with their software version

[1.12 FACTORY SETTINGS] (FCS-)

With graphic display terminal:

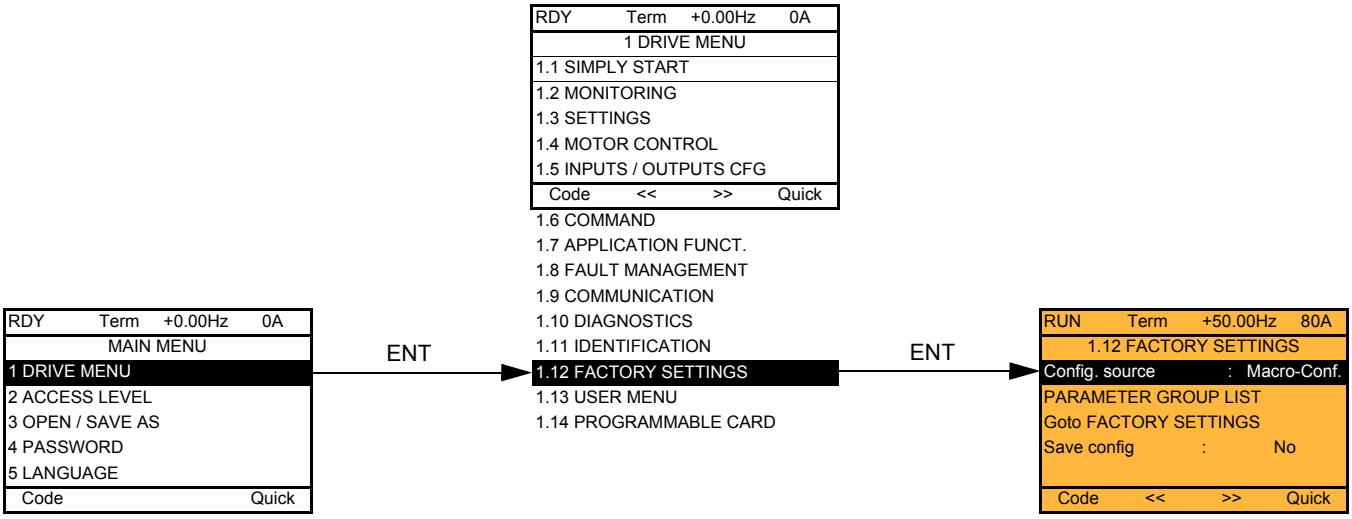


With integrated display terminal:

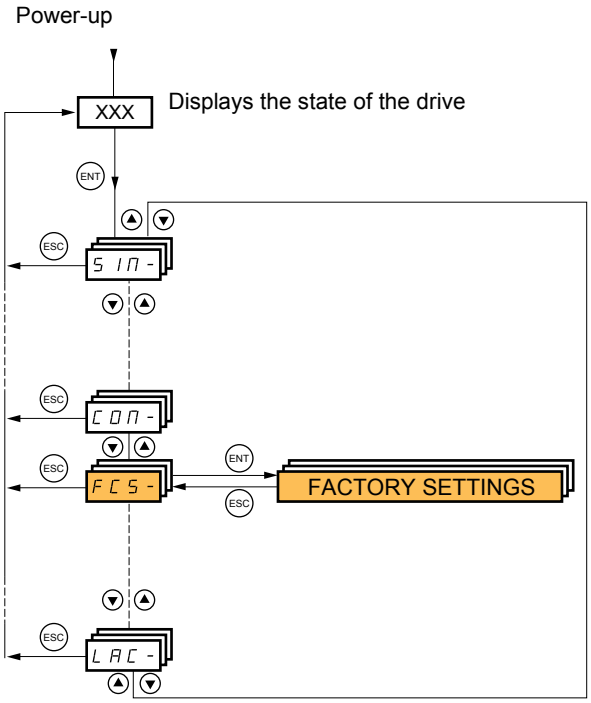

The [1.12 FACTORY SETTINGS] (FCS-) menu is used to:

- Replace the current configuration with the factory configuration or a previously saved configuration.
  All or part of the current configuration can be replaced: select a group of parameters in order to select the menus you wish to load with the selected source configuration.
- Save the current configuration to a file.

[1.12 FACTORY SETTINGS] (FCS-)

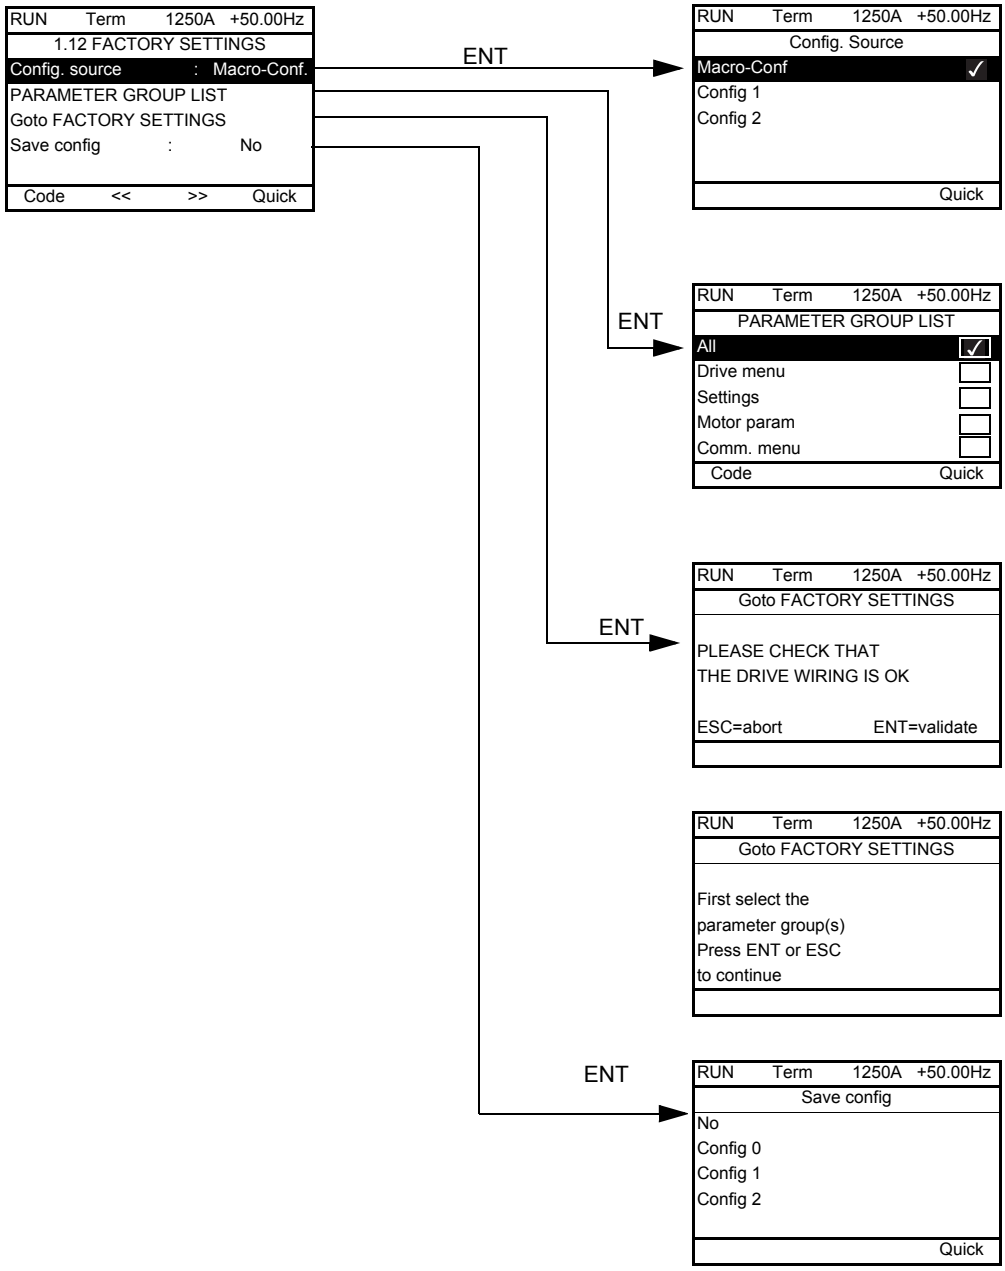

Selection of source configuration

Selection of the menus to be replaced

Note: In factory configuration and after a return to "factory settings", [PARAMETER GROUP LIST] will be empty.

Command to return to "factory settings"

This window appears if no group of parameters is selected.

[1.12 FACTORY SETTINGS] (FCS-)

Code	Name/Description
FCS,	**❑ [Config. Source]** Choice of source configuration. ☐ **[Macro-Conf]** (InI) Factory configuration, return to selected macro configuration. ☐ **[Config 1]** (CFG1) ☐ **[Config 2]** (CFG2) If the configuration switching function is configured, it will not be possible to access [Config 1] (CFG1) and [Config 2] (CFG2).
FrY-	**❑ [PARAMETER GROUP LIST]** Selection of menus to be loaded ☐ **[All]** (ALL): All parameters. ☐ **[Drive configuration]** (drM): The [1 DRIVE MENU] menu without [1.9 COMMUNICATION] and [1.14 PROGRAMMABLE CARD]. In the[7 DISPLAY CONFIG.]menu, [Return std name] page 266 returns to [No]. ☐ **[Settings]** (SEt): The [1.3 SETTINGS] menu without the [IR compensation] (UFr), [Slip compensation (SLP) and [Mot. therm. current] (ItH) parameters ☐ **[Motor param]** (MOt):motor parameters, see list below. The following selections can only be accessed if [Config. Source] (FCSI) = [Macro-Conf.] (InI): ☐ **[Comm. menu]** (COM): The [1.9 COMMUNICATION] menu without either [Scan. In1 address] (nMA1) to [Scan. In8 address] (nMA8) or [Scan.Out1 address] (nCA1) to [Scan.Out8 address] (nCA8). ☐ **[Prog. card menu]** (PLC): the [1.14 PROGRAMMABLE CARD] menu. ☐ **[Monitor config.]** (MOn): the [6 MONITORING CONFIG.] menu. ☐ **[Display config.]** (dIS): the [7 DISPLAY CONFIG.] menu. See the multiple selection procedure on page 30 for the integrated display terminal and page 21 for the graphic display terminal. **Note:** In factory configuration and after a return to "factory settings", [PARAMETER GROUP LIST] will be empty.
GFS	**❑ [Goto FACTORY SETTINGS]** It is only possible to revert to the factory settings if at least one group of parameters has previously been selected. With the integrated display terminal: - No - Yes: The parameter changes back to nO automatically as soon as the operation is complete. With the graphic display terminal: see previous page
SCS,	**❑ [Save config]** ☐ **[No]** (nO): ☐ **[Config 0]** (Str0): Press and hold down the "ENT" key for 2 s. ☐ **[Config 1]** (Str0): Press and hold down the "ENT" key for 2 s. ☐ **[Config 2]** (Str0): Press and hold down the "ENT" key for 2 s. The active configuration to be saved does not appear for selection. For example, if it is [Config 0] (Str0), only [Config 1] (Str1) and [Config 2] (Str2) appear. The parameter changes back to[No] (nO) as soon as the operation is complete.

List of motor parameters

[1.4 MOTOR CONTROL] (drC-) menu:

[Rated motor power] (nPr) - [Rated motor volt.] (UnS) - [Rated mot current] (nCr) - [Rated motor freq.] (FrS) - [Rated motor speed] (nSP) - [Auto tuning] (tUn) - [Auto tuning status] (tUS) - [U0] (U0) to [U5] (U5) - [F1] (F1) to [F5] (F5) - [V. constant power] (UCP) - [Freq. Const Power] (FCP) - [Nominal I sync] (nCrS) - [Nom motor spdsync] (nSPS) - [Pole pairs.] (PPnS) - [Syn. EMF constant] (PHS) - [Autotune L d-axis] (LdS) - [Autotune L q-axis] (LqS) - [Cust. stator R syn] (rSAS) - [IR compensation] (UFr) - [Slip compensation] (SLP) - motor parameters that can be accessed in[Expert] mode page 77.

[1.3 SETTINGS] (SEt-) menu:

[Mot. therm. current] (ItH)


Example of total return to factory settings

1. [Config. Source] (FCSI) = [Macro-Conf] (InI)
2. [PARAMETER GROUP LIST] (FrY-) = [All] (ALL)
3. [Goto FACTORY SETTINGS] (GFS = YES)


[1.13 USER MENU] (USr-)

This menu contains the parameters selected in the [7 DISPLAY CONFIG.] menu on page 265.

With graphic display terminal:

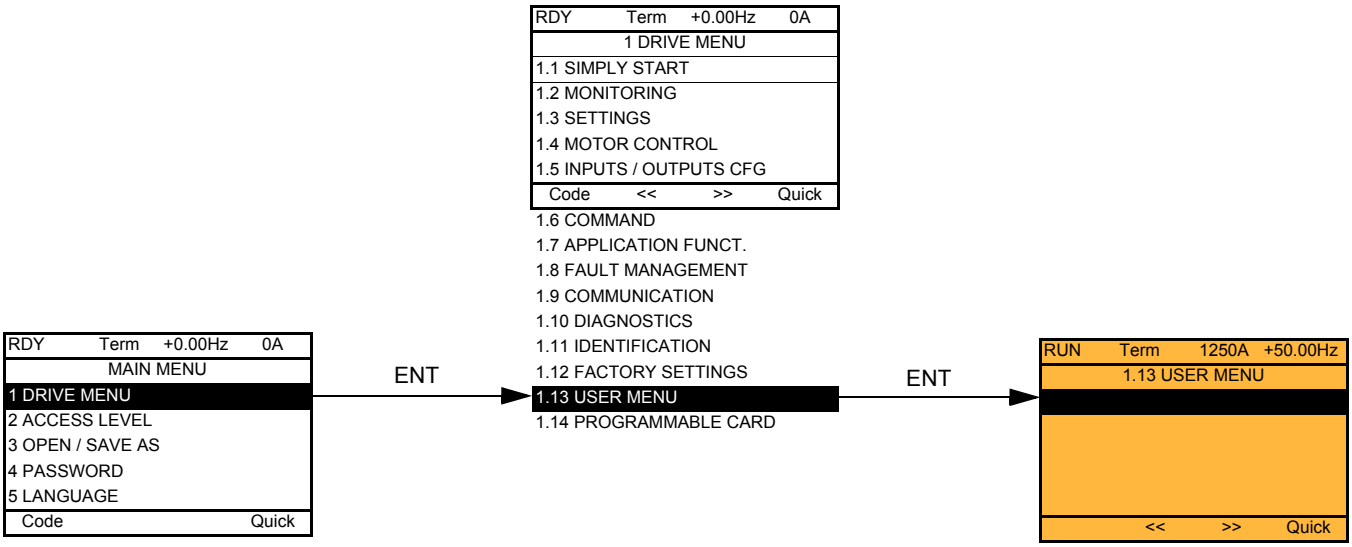


With integrated display terminal:

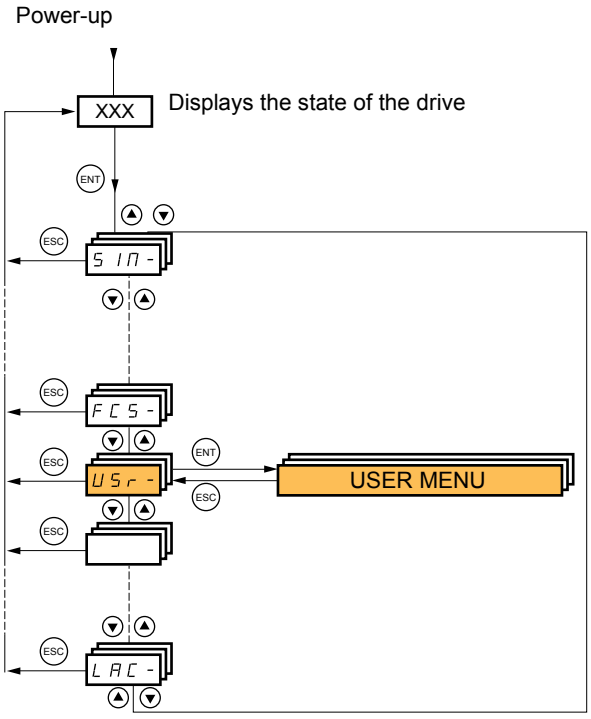


[1.14 PROGRAMMABLE CARD] (PLC-)

This menu can only be accessed if a Controller Inside card has been inserted. Please refer to the documentation specific to this card.

With graphic display terminal:

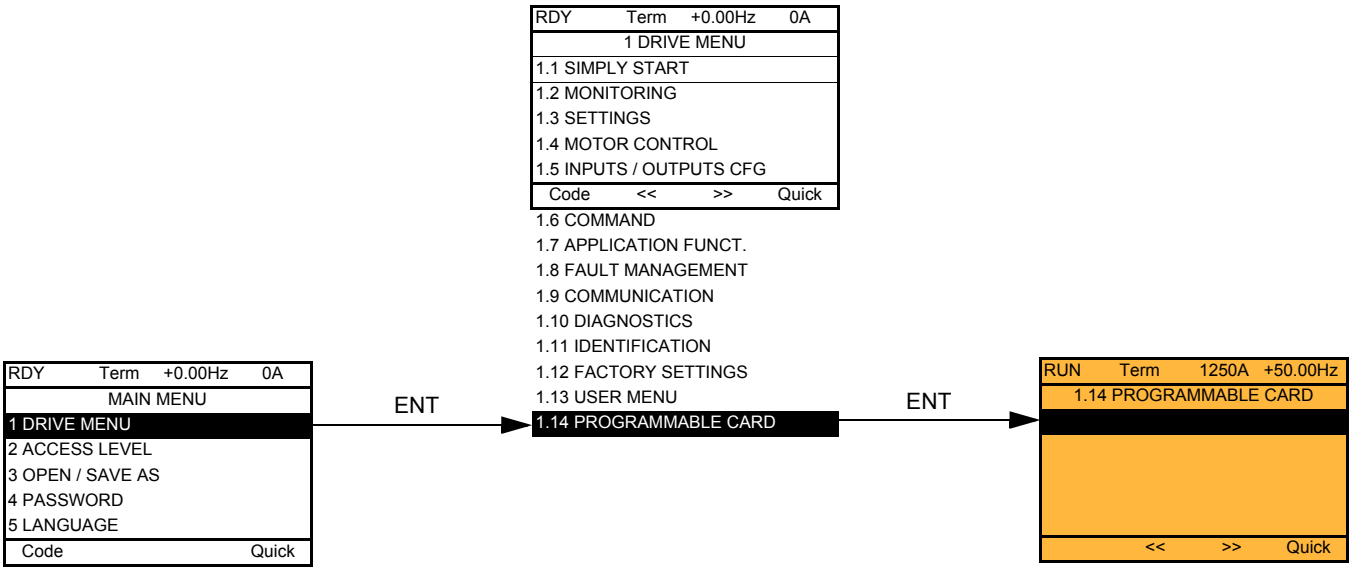


With integrated display terminal:

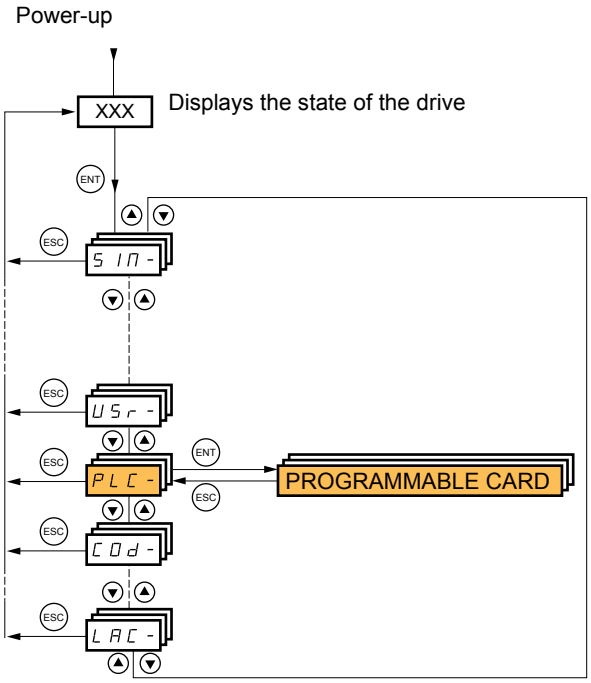


[3. OPEN/SAVE AS]

This menu can only be accessed with the graphic display terminal.

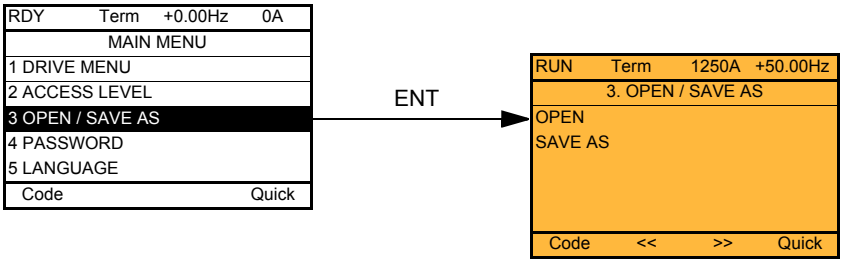

[Open]: To download one of the 4 files from the graphic display terminal to the drive.
[SAVE AS]: To download the current drive configuration to the graphic display terminal.

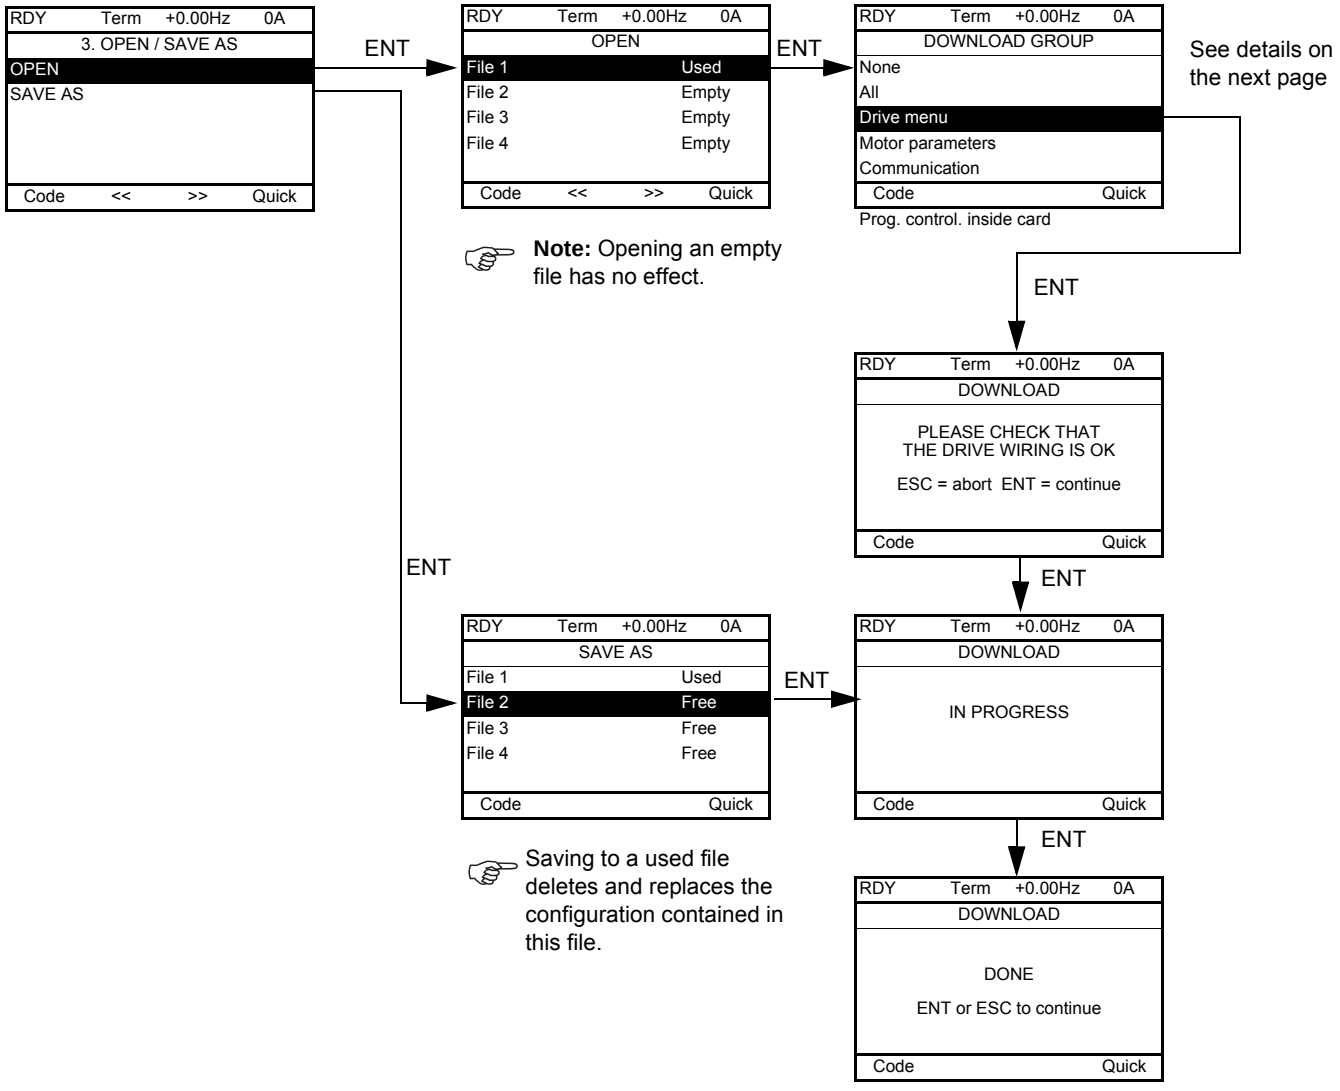

Various messages may appear when the download is requested:

- [IN PROGRESS]
- [DONE]
- Error messages if download not possible
- [Motor parameters are NOT COMPATIBLE. Do you want to continue?]: In this case the download is possible, but the parameters will be restricted.


[3. OPEN/SAVE AS]

[DOWNLOAD GROUP]


[None] :		No parameters
[All]:		All parameters in all menus
[Drive configuration] :		The entire [1 DRIVE MENU] without [1.9 COMMUNICATION] and [1.14 PROGRAMMABLE CARD].
[Motor parameters]:	[Rated motor power] (nPr)	in the [1.4 MOTOR CONTROL] (drC-) menu
	[Rated motor volt.] (UnS)	
	[Rated mot. current] (nCr)	
	[Rated motor freq.] (FrS)	
	[Rated motor speed] (nSP)	
	[Auto tuning] (tUn)	
	[Auto tuning status] (tUS)	
	[U0] (U0) to [U5] (U5)	
	[F1] (F1) to [F5] (F5)	
	[V. constant power] (UCP)	
	[Freq. Const Power] (FCP)	
	[Nominal I sync.] (nCrS)	
	[Nom motor spdsync] (nSPS)	
	[Pole pairs] (PPnS)	
	[Syn. EMF constant] (PHS)	
	[Autotune L d-axis] (LdS)	
	[Autotune L q-axis] (LqS)	
	[Cust. stator R syn] (rSAS)	
	[IR compensation] (UFr)	
	[Slip compensation] (SLP)	
	The motor parameters that can be accessed in [Expert] mode, page 77	
	[Mot. therm. current] (ItH)	in the [1.3 SETTINGS] (SEt-) menu
[Communication] :		All the parameters in the [1.9 COMMUNICATION] menu
[Prog. control. inside card] :		All the parameters in the [1.14 PROGRAMMABLE CARD] menu

[4. PASSWORD] (COd-)

With graphic display terminal:

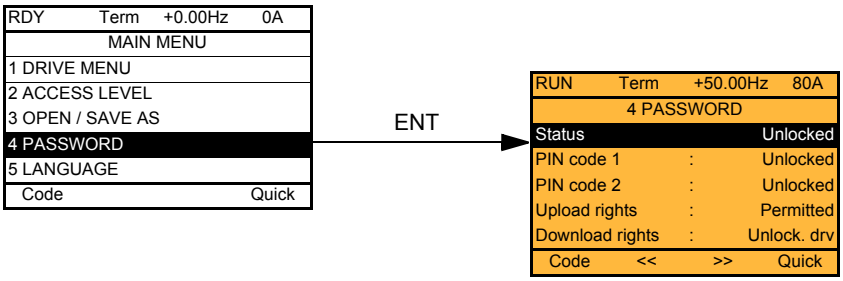


With integrated display terminal:

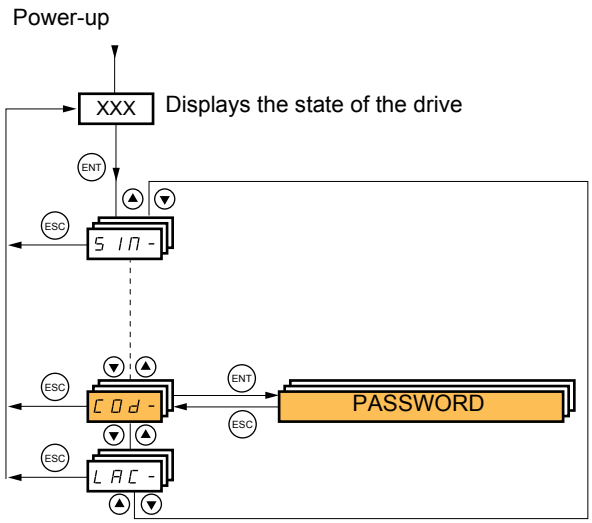

Enables the configuration to be protected with an access code or a password to be entered in order to access a protected configuration.

Example with graphic display terminal:

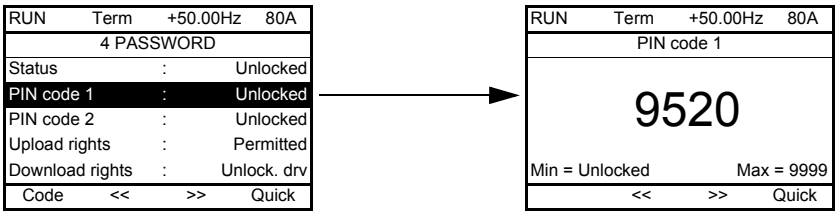

- The drive is unlocked when the PIN codes are set to [unlocked] (OFF) (no password) or when the correct code has been entered. All menus are visible.
- Before protecting the configuration with an access code, you must:
  - Define the [Upload rights] (ULr) and [Download rights] (dLr).
  - Make a careful note of the code and keep it in a safe place where you will always be able to find it.
- The drive has 2 access codes, enabling 2 access levels to be set up.
  - PIN code 1 is a public unlock code: 6969.
  - PIN code 2 is an unlock code known only to Schneider Electric Product Support. It can only be accessed in [Expert] mode.
  - Only one PIN1 or PIN2 code can be used - the other must remain set to [OFF] (OFF).

Note: When the unlock code is entered, the user access code appears.


The following items are access-protected:
- Return to factory settings ([1.12 FACTORY SETTINGS] (FCS-) menu.
- The channels and parameters protected by the [1.13 USER MENU] as well as the menu itself.
- The custom display settings ([7 DISPLAY CONFIG.] menu).

[4. PASSWORD] (COd-)


Code	Name/Description	Adjustment range	Factory setting
CSt	❑ **[Status]**		[Unlocked] (ULC)
	Information parameter, cannot be modified. ☐ **[Locked]** (LC): The drive is locked by a password. ☐ **[Unlocked]** (ULC): The drive is not locked by a password.		
Cod	❑ **[PIN code 1]**	OFF to 9999	[OFF] (OFF)
	1st access code. The value [OFF] (OFF) indicates that no password has been set [Unlocked]. The value [ON] (On) indicates that the drive is protected and an access code must be entered in order to unlock it. Once the correct code has been entered, it remains on the display and the drive is unlocked until the next time the power supply is disconnected. - PIN code 1 is a public unlock code: 6969.		
Cod2	❑ **[PIN code 2]**	OFF to 9999	[OFF] (OFF)
	Parameter can only be accessed in [Expert] mode. 2nd access code. The value [OFF] (OFF) indicates that no password has been set [Unlocked]. The value [ON] (On) indicates that the drive is protected and an access code must be entered in order to unlock it. Once the correct code has been entered, it remains on the display and the drive is unlocked until the next time the power supply is disconnected. PIN code 2 is an unlock code known only to Schneider Electric Product Support. When [PIN code 2] (COd2) is not set to OFF, the [1.2 MONITORING] (SUP-) menu is the only one visible. Then if [PIN code 2] (COd2) is set to OFF (drive unlocked), all menus are visible. If the display settings are modified in [7 DISPLAY CONFIG.] menu, and if [PIN code 2] (COd2) is not set to OFF, the visibility configured is kept. Then if [PIN code 2] (COd2) is set to OFF (drive unlocked), the visibility configured in [7 DISPLAY CONFIG.] menu is kept.		
ULr	❑ **[Upload rights]**		[Permitted] (ULr0)
	Read or copy the current configuration to the drive. ☐ **[Permitted]** (ULr0): The current drive configuration can always be uploaded to the graphic display terminal or PC-Software. ☐ **[Not allowed]** (ULr1): The current drive configuration can only be uploaded to the graphic display terminal or PC-Software if the drive is not protected by an access code or if the correct code has been entered.		
dLr	❑ **[Download rights]**		[Unlock. drv] (dLr1)
	Writes the current configuration to the drive or downloads a configuration to the drive ☐ **[Locked drv]** (dLr0): A configuration file can only be downloaded to the drive if the drive is protected by an access code, which is the same as the access code for the configuration to be downloaded. ☐ **[Unlock. drv]** (dLr1): A configuration file can be downloaded to the drive or a configuration in the drive can be modified if the drive is unlocked (access code entered) or is not protected by an access code. ☐ **[Not allowed]** (dLr2): Download not authorized. ☐ **[Lock/unlock]** (dLr3): Combination of [Locked drv.] (dLr0) and [Unlock. drv] (dLr1).		

[6 MONITORING CONFIG.]

This menu can only be accessed with the graphic display terminal.

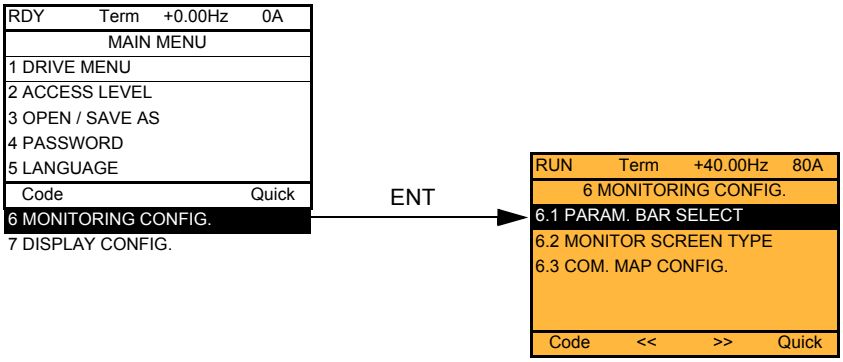

This can be used to configure the information displayed on the graphic display screen during operation.

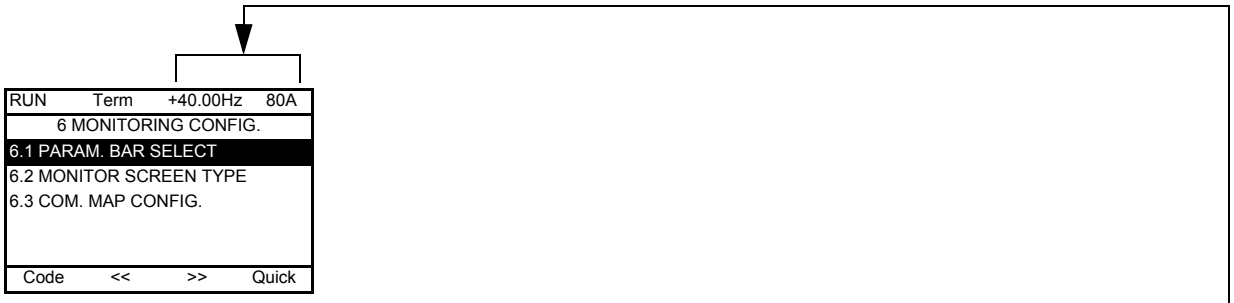

[6.1. PARAM. BAR SELECT]: Selection of 1 to 2 parameters displayed on the top line (the first 2 cannot be modified).

[6.2. MONITOR SCREEN TYPE]: Selection of parameters displayed in the centre of the screen and the display mode (digital values or bar graph format).

[6.3. COM. MAP CONFIG.]: Selection of the words displayed and their format.


Name/Description

[6.1 PARAM. BAR SELECT]

☐ [Alarm groups]	
☐ [Frequency ref.]	in Hz: parameter displayed in factory configuration.
☐ [Torque reference]	as a %
☐ [Output frequency]	in Hz
☐ [Motor current]	in A: parameter displayed in factory configuration.
☐ [ENA avg speed]	in Hz
☐ [Motor speed]	in rpm
☐ [Motor voltage]	in V
☐ [Motor power]	in W
☐ [Motor torque]	as a %
☐ [Mains voltage]	in V
☐ [Motor thermal state]	as a %
☐ [Drv. thermal state]	as a %
☐ [DBR thermal state]	as a % (can be accessed if [DB res. protection] (brO) has been enabled, see page 242)
☐ [Consumption]	in Wh or kWh depending on drive rating
☐ [Run time]	in hours (length of time the motor has been switched on)
☐ [Power on time]	in hours (length of time the drive has been switched on)
☐ [IGBT alarm counter]	in seconds (total time of IGBT overheating alarms)
☐ [PID reference]	as a %
☐ [PID feedback]	as a %
☐ [PID error]	as a %
☐ [PID Output]	in Hz
☐ [- - - - 02]	Word generated by the Controller Inside card (can be accessed if the card has been inserted)
to	
☐ [- - - - 06]	Word generated by the Controller Inside card (can be accessed if the card has been inserted)
☐ [Config. active]	CNFO, 1 or 2 (see page 205)
☐ [Utilised param. set]	SET1, 2 or 3 (see page 203)

Select the parameter using ENT (a ☑ then appears next to the parameter). Parameter(s) can also be deselected using ENT. 1 or 2 parameters can be selected.

Example:

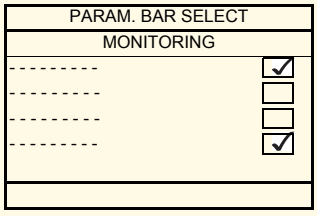

Name/Description

[6.2. MONITOR SCREEN TYPE]


[Display value type]

- [Digital]: Display of one or two digital values on the screen (factory configuration).
- [Bar graph]: Display of one or two bar graphs on the screen.
- [List]: Display a list of between one and five values on the screen.

[PARAMETER SELECTION]


[Alarm groups]	can only be accessed if [Display value type] = [List]
[Frequency ref.]	in Hz: parameter displayed in factory configuration.
[Torque reference]	as a %
[Output frequency]	in Hz
[Motor current]	in A
[ENA avg speed]	in Hz
[Motor speed]	in rpm
[Motor voltage]	in V
[Motor power]	in W
[Motor torque]	as a %
[Mains voltage]	in V
[Motor thermal state]	as a %
[Drv. thermal state]	as a %
[DBR thermal state]	as a %
[Consumption]	in Wh or kWh depending on drive rating
[Run time]	in hours (length of time the motor has been switched on)
[Power on time]	in hours (length of time the drive has been switched on)
[IGBT alarm counter]	in seconds (total time of IGBT overheating alarms)
[PID reference]	as a %
[PID feedback]	as a %
[PID error]	as a %
[PID Output]	in Hz
[- - - - 02] to [- - - - 06]	Word generated by the Controller Inside card (can be accessed if the card has been inserted)
[Config. active]	CNFO, 1 or 2 (see page 205), can only be accessed if [Display value type] = [List]
[Utilised param. set]	SET1, 2 or 3 (see page 203), can only be accessed if [Display value type] = [List]

Select the parameter(s) using ENT (a ☑ then appears next to the parameter). Parameter(s) can also be deselected using ENT.

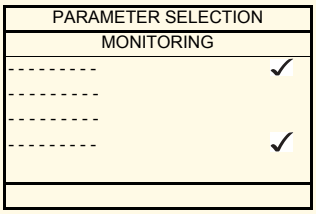


Examples include:


Display of 2 digital values

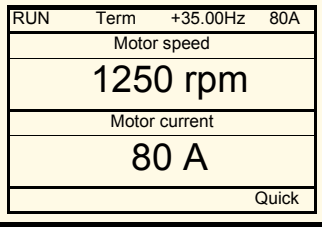

Display of 2 bar graphs

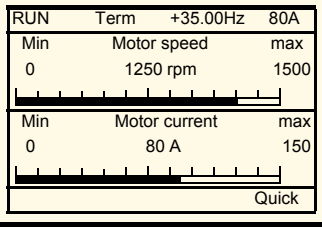

Display of a list of 5 values

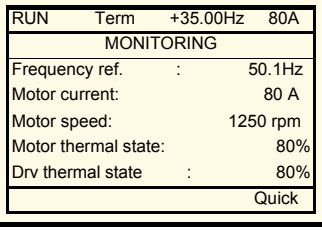

Name/Description

[6.3. COM. MAP CONFIG.]

[Word 1 add. select.]

Select the address of the word to be displayed by pressing the <<, >> (F2 and F3) keys and rotating the navigation button.

[Format word 1]

Format of word 1.

- **[Hex]**: Hexadecimal
- **[Signed]** : Decimal with sign
- **[Unsigned]** : Decimal without sign

[Word 2 add. select.]

Select the address of the word to be displayed by pressing the <<, >> (F2 and F3) keys and rotating the navigation button.

[Format word 2]

Format of word 2.

- **[Hex]**: Hexadecimal
- **[Signed]** : Decimal with sign
- **[Unsigned]** : Decimal without sign

[Word 3 add. select.]

Select the address of the word to be displayed by pressing the <<, >> (F2 and F3) keys and rotating the navigation button.

[Format word 3]

Format of word 3.

- **[Hex]**: Hexadecimal
- **[Signed]** : Decimal with sign
- **[Unsigned]** : Decimal without sign

[Word 4 add. select.]


Select the address of the word to be displayed by pressing the <<, >> (F2 and F3) keys and rotating the navigation button.

[Format word 4]

Format of word 4.


- **[Hex]**: Hexadecimal
- **[Signed]** : Decimal with sign
- **[Unsigned]** : Decimal without sign

It will then be possible to view the selected words in the [COMMUNICATION MAP] submenu of the [1.2 MONITORING] menu.
Example:

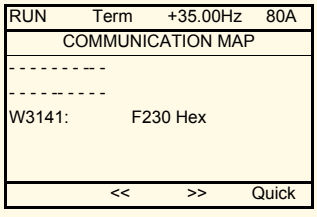

[7 DISPLAY CONFIG.]

This menu can only be accessed with the graphic display terminal. It can be used to customize parameters or a menu and to access parameters.

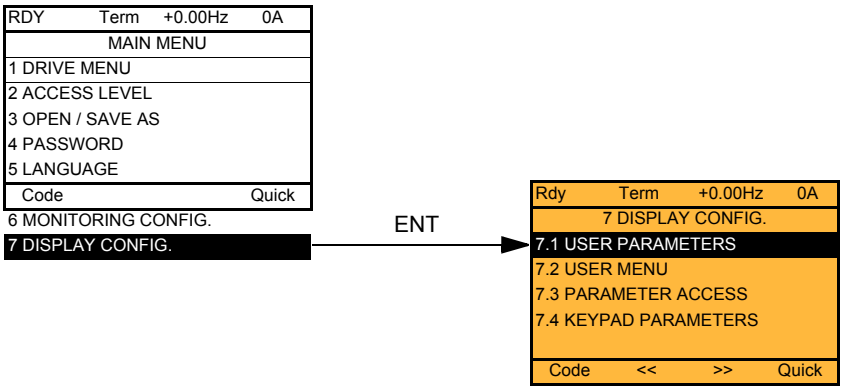


7.1: USER PARAMETERS: Customization of 1 to 15 parameters.


7.2 USER MENU: Creation of a customized menu.

7.3 PARAMETER ACCESS: Customization of the visibility and protection mechanisms of menus and parameters.

7.4 KEYPAD PARAMETERS: Adjustment of the contrast and stand-by mode of the graphic display terminal (parameters stored in the terminal rather than in the drive). Choice of the menu displayed on power up.

If [Return std name] = [Yes] the display reverts to standard but the custom settings remain stored.

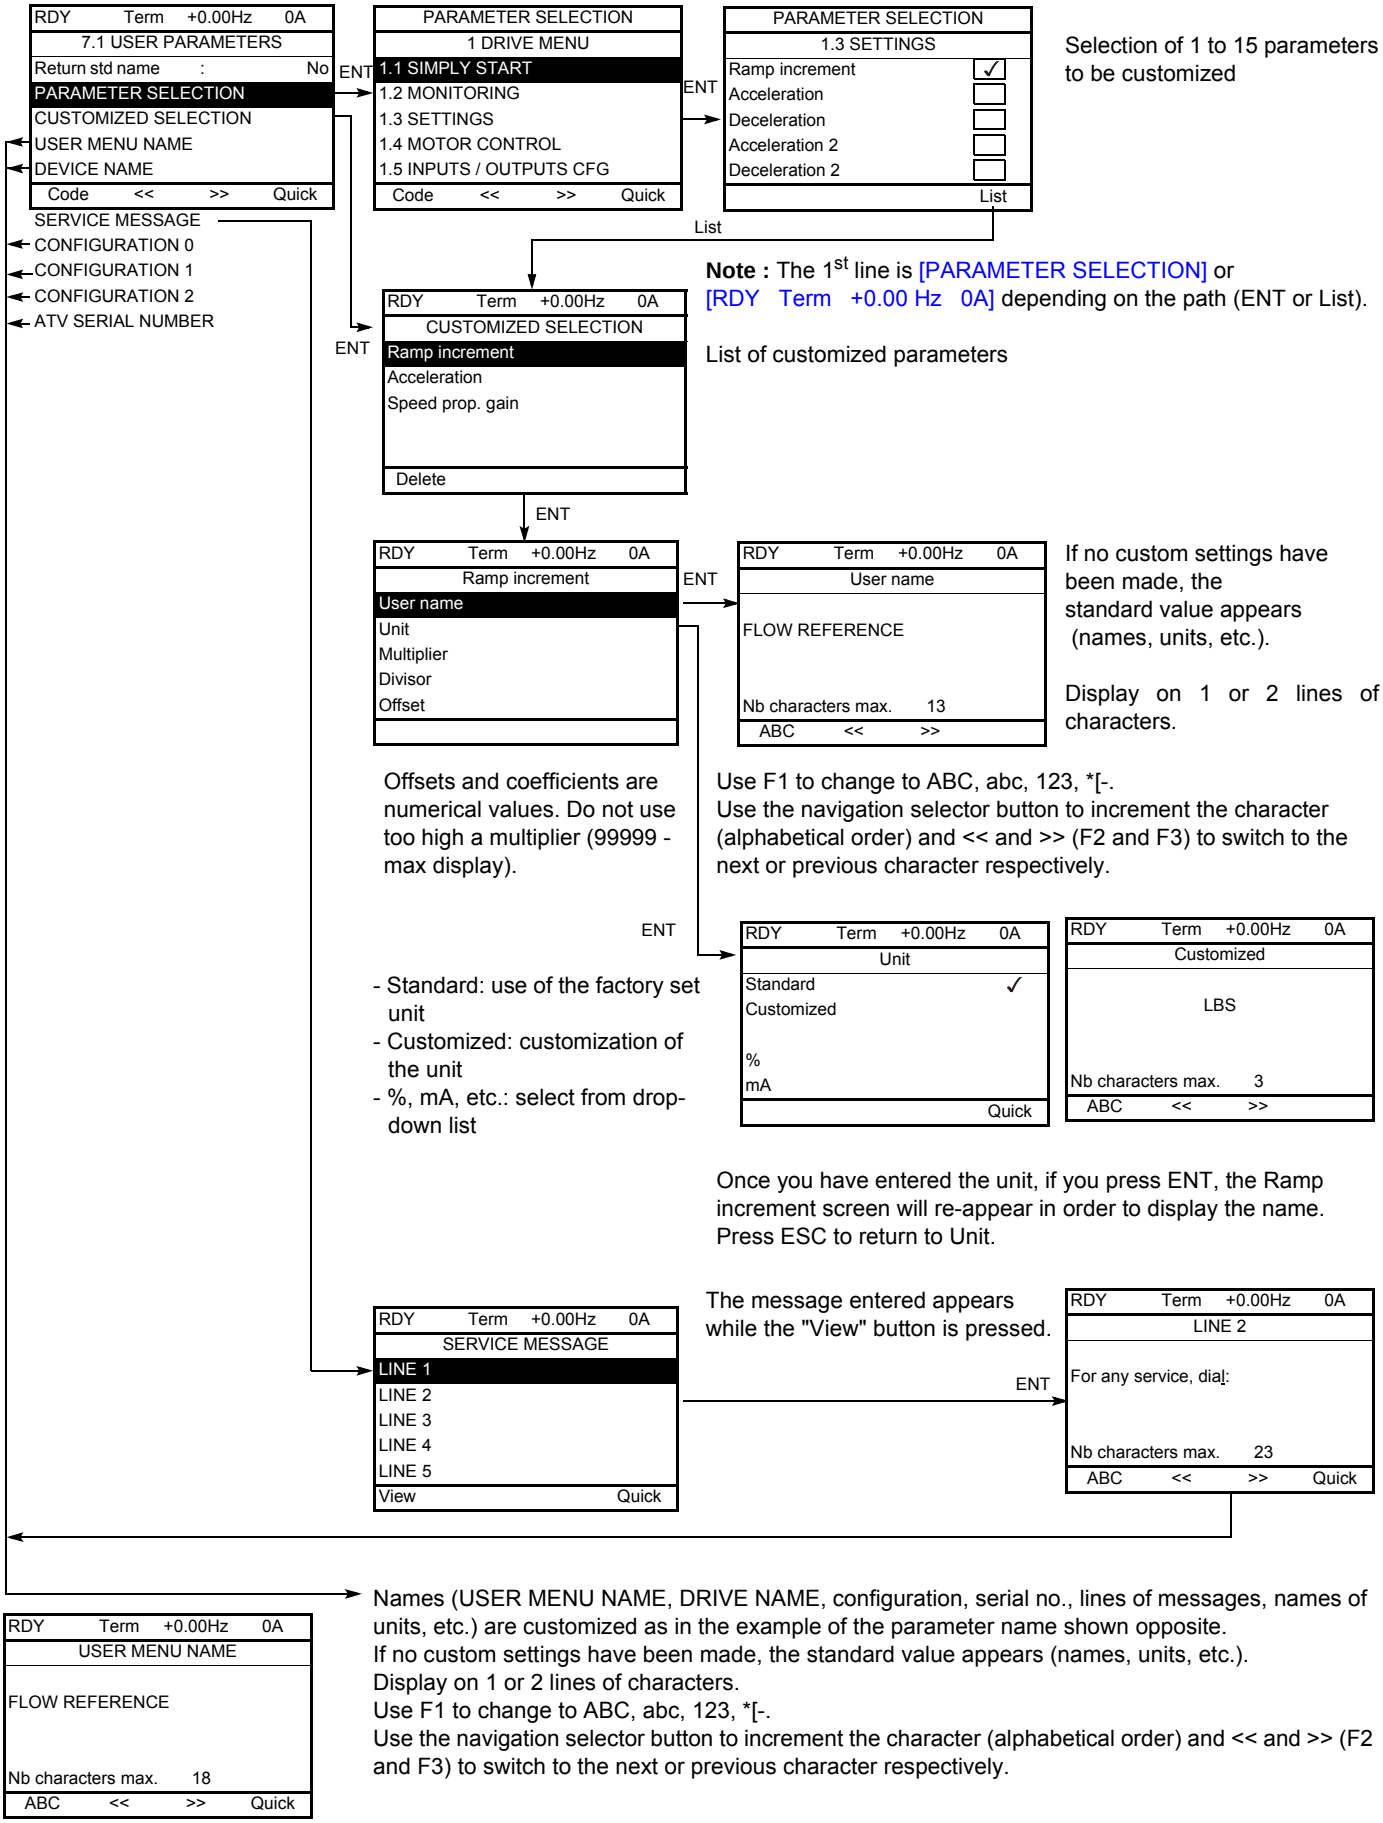

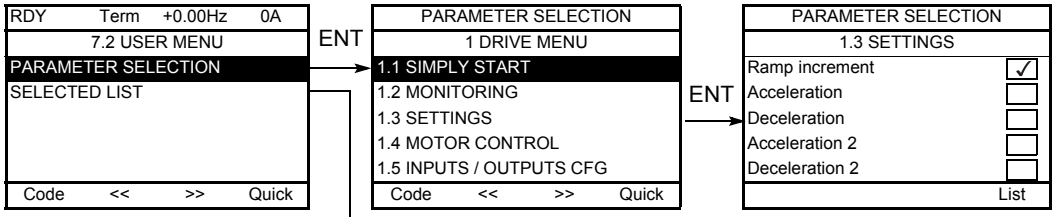


Selection of parameters included in the user menu

List


Note: The 1st line is [PARAMETER SELECTION] or [RDY Term +0.00 Hz 0A] depending on the path (ENT or List).


ENT

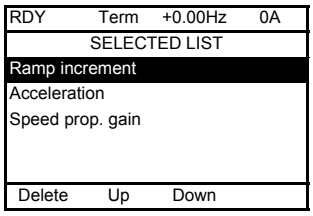


Parameter list making up the user menu.

Use the F2 and F3 keys to arrange the parameters in the list (example below using F3).

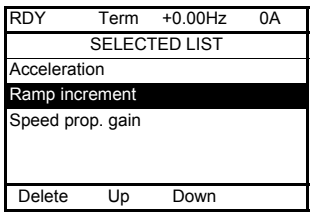

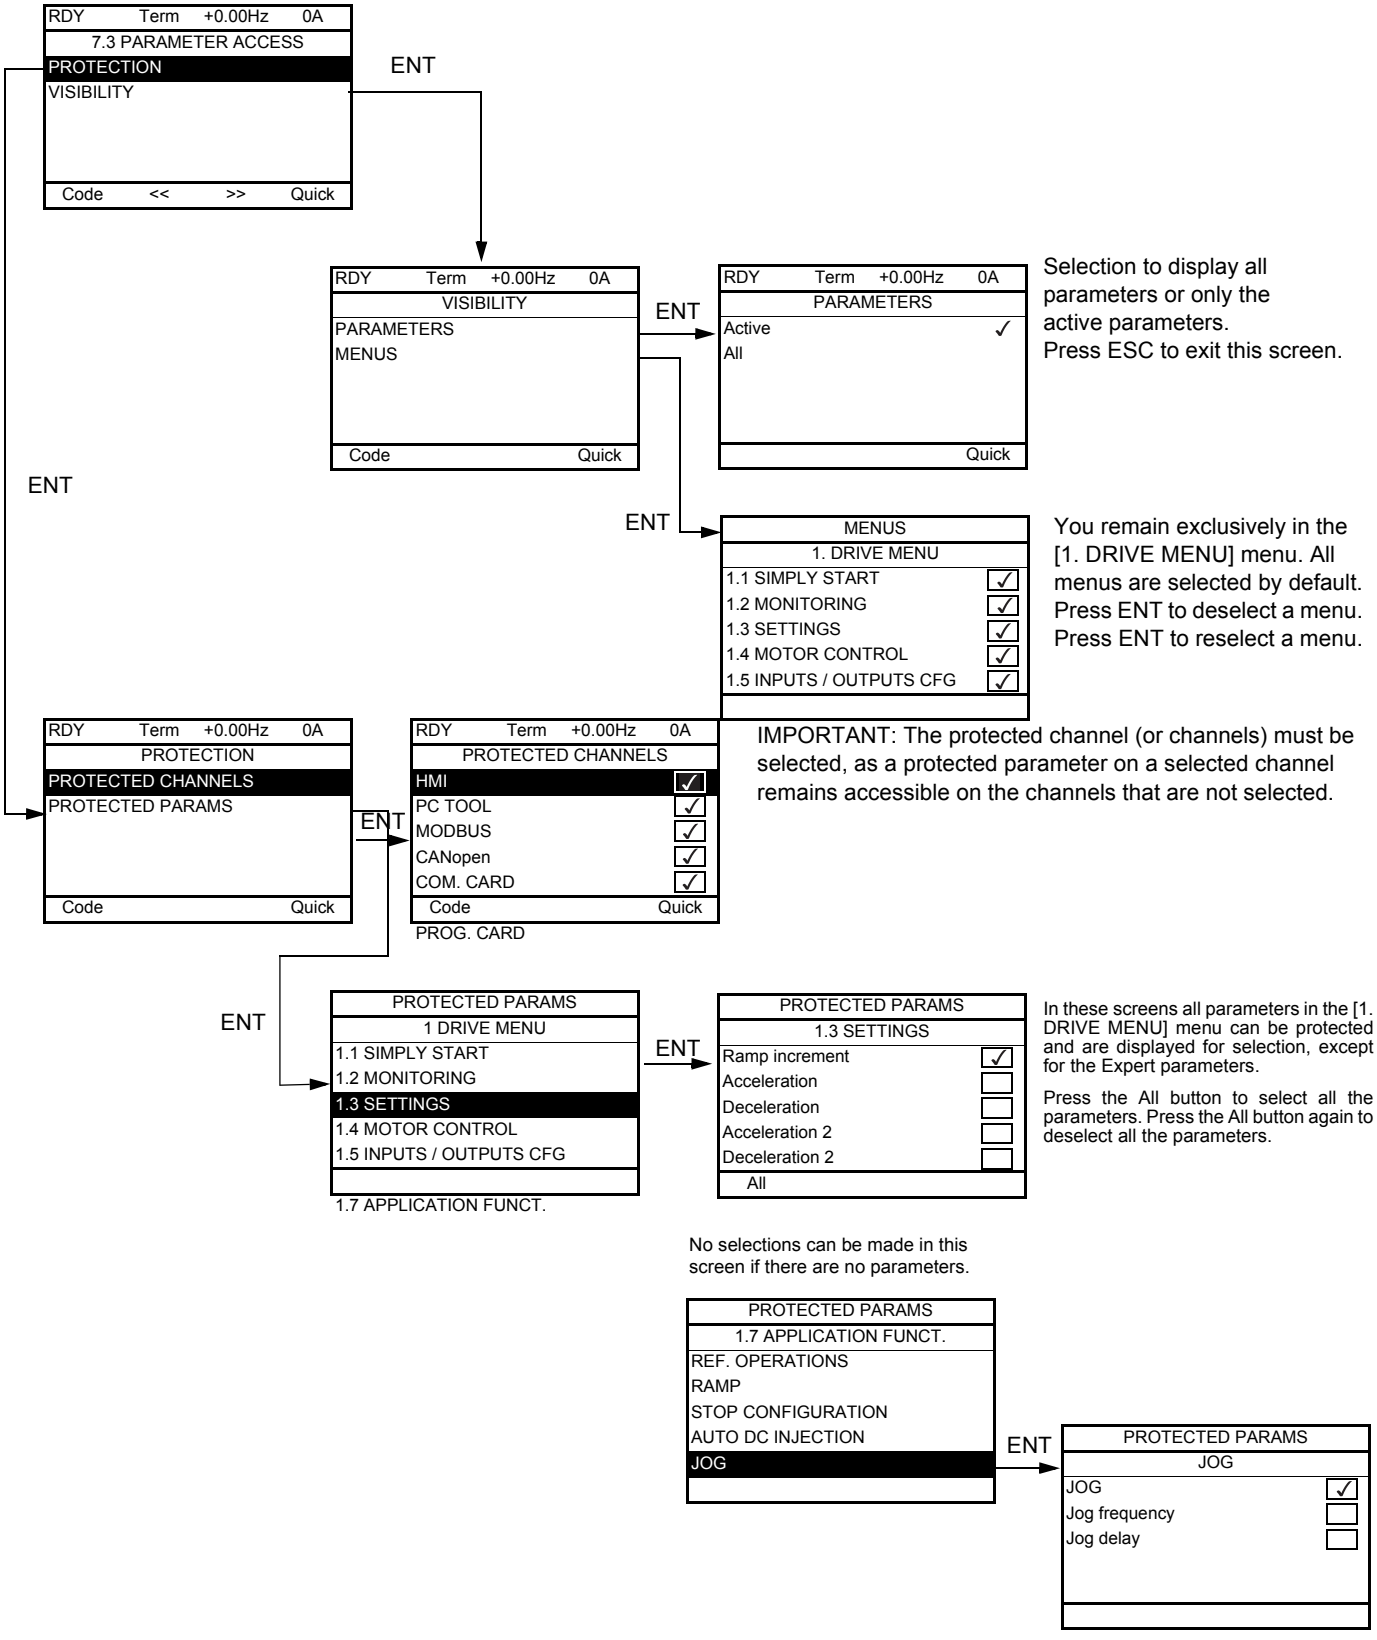

Note: The protected parameters are no longer accessible and are not, therefore, displayed for the selected channels.

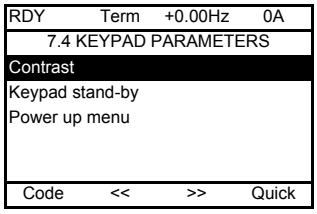


Name/Description	Adjustment range	Factory setting
❑ **[Keypad contrast]** Adjustment of contrast on graphic display unit.	0 to 100 %	50 %
❑ **[Keypad stand-by]** Configures and adjusts the stand-by mode of the graphic display unit. ☐ **[No]**: No stand-by mode. ☐ **[1]** to **[10]**: Adjusts the time during which the terminal is to remain idle before stand-by mode is triggered, in minutes. After this idle time, the display backlight turns off and the contrast is reduced. The screen returns to normal operation when a key or the navigation button is pressed. It also returns to normal operation if the terminal exits the normal display mode, for example, if a fault occurs.		[5]
❑ **[Power up menu]** Choice of menu which appears on the product on power-up ☐ **[Drive configuration]**: Displays the drive configuration. ☐ **[Sim. start]**: Displays the simply start menu. ☐ **[Monitoring]**: Displays the monitoring menu. ☐ **[Settings]**: Displays the settings menu. ☐ **[Mot. Ctrl]**: Displays the control motor menu. ☐ **[I/O Conf.]**: Displays the inputs / outputs configuration menu. ☐ **[Command]**: Displays the command menu. ☐ **[Appli. fun.]**: Displays the application function menu. ☐ **[Fault mgt]**: Displays the fault management menu. ☐ **[Com.]**: Displays the communication menu. ☐ **[Diagnostics]**: Displays the diagnostics menu. ☐ **[Ident.]**: Displays the identification menu. ☐ **[Factory Set]**: Displays the factory settings menu. ☐ **[User menu]**: Displays the user menu. ☐ **[CI menu]**: Displays the card CI menu. ☐ **[Main menu]**: Displays the main menu.		[Main menu]

[MULTIPOINT SCREEN]

Communication is possible between a graphic display terminal and a number of drives connected on the same bus. The addresses of the drives must be configured in advance in the [1.9 COMMUNICATION] menu using the [Modbus Address] (Add) parameter, page 247.

When a number of drives are connected to the same display terminal, the terminal automatically displays the following screens:

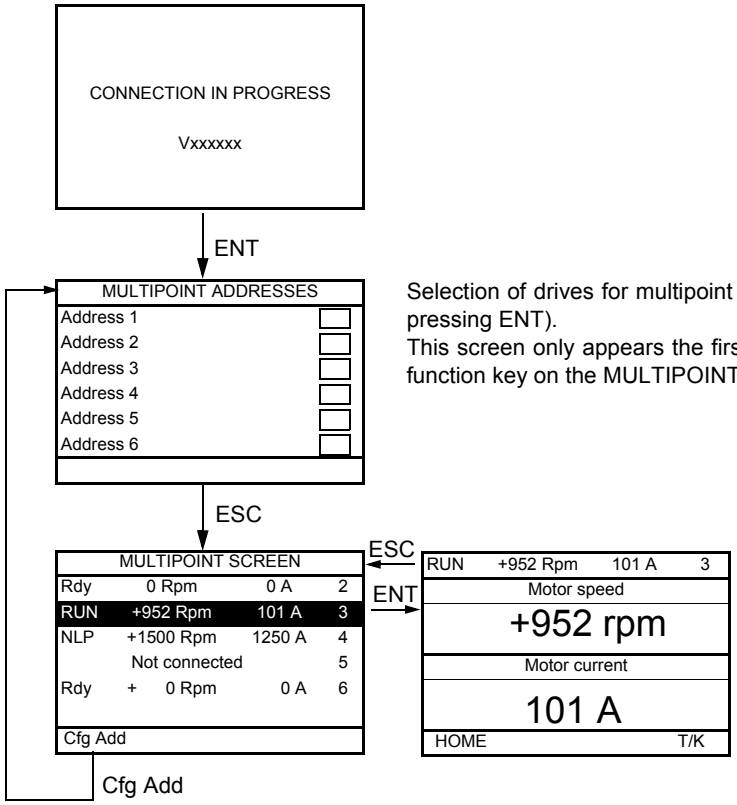

Selection of drives for multipoint dialog (select each address and check the box by pressing ENT).
This screen only appears the first time the drive is powered up, or if the "Cfg Add" function key on the MULTIPOINT SCREEN is pressed (see below).

Selection of a drive for multipoint dialog

In multipoint mode, the command channel is not displayed. From left to right, the state, then the 2 selected parameters and finally the drive address appear.

All menus can be accessed in multipoint mode. Only drive control via the graphic display terminal is not authorized, apart from the Stop key, which locks all the drives.
If there is a fault on a drive, this drive is displayed.

Servicing

The Altivar 71 does not require any preventive maintenance. It is nevertheless advisable to perform the following regularly:

- Check the condition and tightness of the connections.
- Ensure that the temperature around the unit remains at an acceptable level and that ventilation is effective (average service life of fans: 3 to 5 years, depending on the operating conditions).
- Remove any dust from the drive.

Assistance with maintenance, fault display

If a problem arises during setup or operation, first check that the recommendations relating to the environment, mounting and connections have been observed.

The first fault detected is saved and displayed, and the drive locks.
The drive switching to fault mode can be indicated remotely via a logic output or a relay, which can be configured in the [1.5 INPUTS / OUTPUTS CFG] (I-O-) menu, see, for example, [R1 CONFIGURATION] (r1-) page 106.

Menu [1.10 DIAGNOSTICS]

This menu can only be accessed with the graphic display terminal. It displays faults and their cause in plain text and can be used to carry out tests, see page 249.

Clearing the fault

Disconnect the drive power supply in the event of a non-resettable fault.
Wait for the display to disappear completely.
Find the cause of the fault in order to correct it.

The drive is unlocked after a fault:

- By switching off the drive until the display disappears completely, then switching on again
- Automatically in the scenarios described for the[AUTOMATIC RESTART] (Atr-) function, page 225
- By means of a logic input or control bit assigned to the [FAULT RESET] (rSt-) function, page 224
- By pressing the STOP/RESET button on the graphic display terminal

Menu [1.2 MONITORING] (SUP-):

This is used to prevent and find the causes of faults by displaying the drive state and its current values.
It can be accessed with the integrated display terminal.

Spares and repairs:

Consult Schneider Electric product support.

Faults - Causes - Remedies

Drive does not start, no fault displayed

- If the display does not light up, check the power supply to the drive.
- The assignment of the "Fast stop" or "Freewheel" functions will prevent the drive starting if the corresponding logic inputs are not powered up. The ATV71 then displays [Freewheel] (nSt) in freewheel stop and [Fast stop] (FSt) in fast stop. This is normal since these functions are active at zero so that the drive will be stopped safely if there is a wire break.
- Make sure that the run command input or inputs are activated in accordance with the selected control mode ([2/3 wire control] (tCC) and [2 wire type] (tCt) parameters, page 92).
- If an input is assigned to the limit switch function and this input is at zero, the drive can only be started up by sending a command for the opposite direction (see pages 158 and 197).
- If the reference channel or command channel is assigned to a communication bus, when the power supply is connected, the drive will display [Freewheel] (nSt) and remain in stop mode until the communication bus sends a command.

Faults, which cannot be reset automatically

The cause of the fault must be removed before resetting by turning off and then back on.
AnF, brF, ECF, EnF, SOF, SPF and tnF faults can also be reset remotely by means of a logic input or control bit ([Fault reset] (rSF) parameter, page 224).
AnF, EnF, InFA, InFb, SOF, SPF, and tnF faults can be inhibited and cleared remotely by means of a logic input or control bit ([Fault inhibit assign.] (InH) parameter, page 235).

Fault	Name	Probable cause	Remedy
AI2F	[AI2 input]	• Non-conforming signal on analog input AI2	• Check the wiring of analog input AI2 and the value of the signal.
AnF	[Load slipping]	• The encoder speed feedback does not match the reference	• Check the motor, gain and stability parameters. • Add a braking resistor. • Check the size of the motor/drive/load. • Check the encoder's mechanical coupling and its wiring. • If the "torque control" function is used, see "Note" on page 188.
boF	[DBR overload]	• The braking resistor is under excessive stress	• Check the size of the resistor and wait for it to cool down • Check the [DB Resistor Power] (brP) and [DB Resistor value] (brU) parameters, page 242.
brF	[Brake feedback]	• The brake feedback contact does not match the brake logic control • The brake does not stop the motor quickly enough (detected by measuring the speed on the "Pulse input" input).	• Check the feedback circuit and the brake logic control circuit • Check the mechanical state of the brake • Check the brake linings
buF	[DB unit sh. Circuit]	• Short-circuit output from braking unit • Braking unit not connected	• Check the wiring of the braking unit and the resistor. • Check the braking resistor • The monitoring of this fault must be disabled by the [Brake res. fault Mgt.] (bUb) parameter, page 242 if there is no resistor or braking unit connected to the drive, at and above 55 kW (75 HP) for ATV71●●●M3X and at and above 90 kW (120 HP) for ATV71●●●N4.
CrF1	[Precharge]	• Charging relay control fault or charging resistor damaged	• Turn the drive off and then back on again • Check the internal connections • Inspect/repair the drive
CrF2	[Thyr. soft charge]	• DC bus charging fault (thyristors)	
dCF	[Differential curent Fault]	• Current difference between power block A and B (ATV71EC71N4 ... M13N4 or ATV71EM12Y...M20Y only)	• Check thyristor with [TEST THYRISTORS] • Check IGBT with [TRANSISTOR TEST] • Check current transformer
ECF	[Encoder coupling]	• Break in encoder's mechanical coupling	• Check the encoder's mechanical coupling
EEF1	[Control Eeprom]	• Internal memory fault, control card	• Check the environment (electromagnetic compatibility) • Turn off, reset, return to factory settings • Inspect/repair the drive
EEF2	[Power Eeprom]	• Internal memory fault, power card	
EnF	[Encoder]	• Encoder feedback fault	• Check [Number of pulses] (PGI) and [Encoder type] (EnS) page 79. • Check that the encoder's mechanical and electrical operation, its power supply and connections are all correct • If necessary, reverse the direction of rotation of the motor ([Output Ph rotation] (PHr) parameter, page 72) or the encoder signals
FCF1	[Out. contact. stuck]	• The output contactor remains closed although the opening conditions have been met	• Check the contactor and its wiring • Check the feedback circuit

Faults, which cannot be reset automatically (continued)

Fault	Name	Probable cause	Remedy
HdF	[IGBT desaturation]	• Short-circuit or grounding at the drive output	• Check the cables connecting the drive to the motor, and the motor insulation. • Perform the diagnostic tests via the [1.10 DIAGNOSTICS] menu.
iLF	[internal com. link]	• Communication fault between option card and drive	• Check the environment (electromagnetic compatibility) • Check the connections • Check that no more than 2 option cards (max. permitted) have been installed on the drive • Replace the option card • Inspect/repair the drive
inF1	[Rating error]	• The power card is different from the card stored	• Check the reference of the power card
inF2	[Incompatible PB]	• The power card is incompatible with the control card	• Check the reference of the power card and its compatibility.
inF3	[Internal serial link]	• Communication fault between the internal cards	• Check the internal connections • Inspect/repair the drive
inF4	[Internal-mftg zone]	• Internal data inconsistent	• Recalibrate the drive (performed by Schneider Electric Product Support).
inF6	[Internal - fault option]	• The option installed in the drive is not recognized	• Check the reference and compatibility of the option.
inF7	[Internal-hard init.]	• Initialization of the drive is incomplete	• Turn off and reset.
inF8	[Internal-ctrl supply]	• The control power supply is incorrect	• Check the control section power supply
inF9	[Internal- I measure]	• The current measurements are incorrect	• Replace the current sensors or the power card. • Inspect/repair the drive
inFA	[Internal-mains circuit]	• The input stage is not operating correctly	• Perform the diagnostic tests via the [1.10 DIAGNOSTICS] menu. • Inspect/repair the drive
inFb	[Internal- th. sensor]	• The drive temperature sensor is not operating correctly • The braking unit's temperature sensor is not operating correctly.	• Replace the drive temperature sensor • Inspect/repair the drive • Replace the braking unit's temperature sensor • Inspect/repair the braking unit • The monitoring of this fault must be disabled by the [Brake res. fault Mgt.] (bUb) parameter, page 242 if there is no braking unit connected to the drive.
inFC	[Internal-time meas.]	• Fault on the electronic time measurement component	• Inspect/repair the drive
inFE	[internal- CPU]	• Internal microprocessor fault	• Turn off and reset. Inspect/repair the drive.
oCF	[Overcurrent]	• Parameters in the [SETTINGS] (SEt-) and [1.4 MOTOR CONTROL] (drC-) menus are not correct. • Inertia or load too high • Mechanical locking	• Check the parameters. • Check the size of the motor/drive/load. • Check the state of the mechanism.
PrF	[Power removal]	• Fault with the drive's "Power removal" safety function	• Inspect/repair the drive
SCF1	[Motor short circuit]	• Short-circuit or grounding at the drive output • Significant earth leakage current at the drive output if several motors are connected in parallel	• Check the cables connecting the drive to the motor, and the motor insulation. • Perform the diagnostic tests via the [1.10 DIAGNOSTICS] menu. • Reduce the switching frequency. • Connect chokes in series with the motor. • Check the adjustment of speed loop and brake. • Increase the [Time to restart] (ttr), page 66.
SCF2	[Impedant sh. circuit]		
SCF3	[Ground short circuit]		
SoF	[Overspeed]	• Instability or driving load too high	• Check the motor, gain and stability parameters. • Add a braking resistor. • Check the size of the motor/drive/load. • Check the parameters settings for the [FREQUENCY METER] (FqF-) function, page 239, if it is configured

Faults, which cannot be reset automatically (continued)

Fault	Name	Probable cause	Remedy
SPF	[Speed fdback loss]	• Encoder feedback signal missing • Signal on "Pulse input" missing, if the input is used for speed measurement	• Check the wiring between the encoder and the drive • Check the encoder • Check the wiring of the input cable and the detector used
tnF	[Auto-tuning]	• Special motor or motor whose power is not suitable for the drive • Motor not connected to the drive	• Check that the motor/drive are compatible • Check that the motor is present during auto-tuning • If an output contactor is being used, close it during auto-tuning

Faults that can be reset with the automatic restart function, after the cause has disappeared

These faults can also be reset by turning on and off or by means of a logic input or control bit ([Fault reset] (rSF) parameter, page 224). APF, CnF, COF, EPF1, EPF2, FCF2, LFF2, LFF3, LFF4, ObF, OHF, OLF, OPF1, OPF2, OSF, OtF1, OtF2, OtFL, PHF, PtF1, PtF2, PtFL, SLF1, SLF2, SLF3, SrF, SSF and tJF faults can be inhibited and cleared remotely by means of a logic input or control bit ([Fault inhibit assign.] (InH) parameter, page 235).

Fault	Name	Probable cause	Remedy
APF	[Application fault]	• Controller Inside card fault	• Please refer to the card documentation
bLF	[Brake control]	• Brake release current not reached • Brake engage frequency threshold [Brake engage freq] (bEn) only regulated when brake logic control is assigned	• Check the drive/motor connection • Check the motor windings • Check the [Brake release I FW] (Ibr) and [Brake release I Rev] (Ird) settings, page 165 • Apply the recommended settings for [Brake engage freq] (bEn).
CnF	[Com. network]	• Communication fault on communication card	• Check the environment (electromagnetic compatibility) • Check the wiring. • Check the time-out • Replace the option card • Inspect/repair the drive
CoF	[CANopen com.]	• Interruption in communication on the CANopen bus	• Check the communication bus. • Check the time-out • Refer to the CANopen User's Manual
EPF1	[External flt-LI/Bit]	• Fault triggered by an external device, depending on user	• Check the device which caused the fault, and reset
EPF2	[External fault com.]	• Fault triggered by a communication network	• Check for the cause of the fault and reset
FCF2	[Out. contact. open.]	• The output contactor remains open although the closing conditions have been met	• Check the contactor and its wiring • Check the feedback circuit
LCF	[input contactor]	• The drive is not turned on even though [Mains V. time out] (LCt) has elapsed.	• Check the contactor and its wiring • Check the time-out • Check the line/contactor/drive connection
LFF2 LFF3 LFF4	[AI2 4-20mA loss] [AI3 4-20mA loss] [AI4 4-20mA loss]	• Loss of the 4-20 mA reference on analog input AI2, AI3 or AI4	• Check the connection on the analog inputs.
obF	[Overbraking]	• Braking too sudden or driving load	• Increase the deceleration time • Install a braking resistor if necessary • Activate the [Dec ramp adapt.] (brA) function, page 143, if it is compatible with the application
oHF	[Drive overheat]	• Power board -PCB over temperature • Braking unit over temperature • Phase module over temperature • Rectifier over temperature	• Check the motor load, the drive ventilation and the ambient temperature. Wait for the drive to cool down before restarting
oLF	[Motor overload]	• Triggered by excessive motor current	• Check the setting of the motor thermal protection, check the motor load. Wait for the drive to cool down before restarting.
oPF1	[1 output phase loss]	• Loss of one phase at drive output	• Check the connections from the drive to the motor

Faults that can be reset with the automatic restart function, after the cause has disappeared (continued)

Fault	Name	Probable cause	Remedy
oPF2	[3 motor phase loss]	• Motor not connected or motor power too low • Output contactor open • Instantaneous instability in the motor current	• Check the connections from the drive to the motor • If an output contactor is being used, parameterize [Output Phase Loss] (OPL) = [Output cut] (OAC), page 228. • Test on a low power motor or without a motor:In factory settings mode, motor phase loss detection is active [Output Phase Loss] (OPL) = [Yes] (YES). To check the drive in a test or maintenance environment, without having to use a motor with the same rating as the drive (in particular for high power drives), deactivate motor phase loss detection [Output Phase Loss] (OPL) = [No] (nO) • Check and optimize the following parameters: [IR compensation] (UFr), page 76, [Rated motor volt.] (UnS) and [Rated mot. current] (nCr) page 70 and perform [Auto-tuning] (tUn) page 71.
oSF	[Mains overvoltage]	• Line voltage too high • Disturbed mains supply	• Check the line voltage
otF1	[PTC1 overheat]	• Overheating of the PTC1 probes detected	• Check the motor load and motor size. • Check the motor ventilation. • Wait for the motor to cool before restarting • Check the type and state of the PTC probes
otF2	[PTC2 overheat]	• Overheating of the PTC2 probes detected	
otFL	[LI6=PTC overheat]	• Overheating of PTC probes detected on input LI6	
PtF1	[PTC1 probe]	• PTC1 probes open or short-circuited	• Check the PTC probes and the wiring between them and the motor/drive
PtF2	[PTC2 probe]	• PTC2 probes open or short-circuited	
PtFL	[LI6=PTC probe]	• PTC probes on input LI6 open or short-circuited	
SCF4	[IGBT short circuit]	• Power component fault	• Perform a test via the [1.10 DIAGNOSTICS] menu. • Inspect/repair the drive
SCF5	[Motor short circuit]	• Short-circuit at drive output	• Check the cables connecting the drive to the motor, and the motor's insulation • Perform tests via the [1.10 DIAGNOSTICS] menu. • Inspect/repair the drive
SLF1	[Modbus com.]	• Interruption in communication on the Modbus bus	• Check the communication bus. • Check the time-out • Refer to the Modbus User's Manual
SLF2	[PC com.]	• Fault communicating with PC-Software	• Check the PC-Software connecting cable. • Check the time-out
SLF3	[HMI com.]	• Fault communicating with the graphic display terminal	• Check the terminal connection • Check the time-out
SrF	[TORQUE TIME OUT FLT]	• The time-out of the torque control function is attained	• Check the function's settings • Check the state of the mechanism
SSF	[Torque/current lim]	• Switch to torque limitation	• Check if there are any mechanical problems • Check the parameters of [TORQUE LIMITATION] (tLA-) page 190 and the parameters of the [TORQUE OR I LIM. DETECT.] (tId-) fault, page 237).
tJF	[IGBT overheat]	• Drive overheated	• Check the size of the load/motor/drive. • Reduce the switching frequency. • Wait for the motor to cool before restarting

Faults - Causes - Remedies

Faults that can be reset as soon as their causes disappear

The USF fault can be inhibited and cleared remotely by means of a logic input or control bit ([Fault inhibit assign.] (InH) parameter, page 235).

Fault	Name	Probable cause	Remedy
CFF	[Incorrect config.]	• Option card changed or removed	• Check that there are no card errors. • In the event of the option card being changed/removed deliberately, see the remarks below
		• Control card replaced by a control card configured on a drive with a different rating	• Check that there are no card errors. • In the event of the control card being changed deliberately, see the remarks below
		• The current configuration is inconsistent	• Return to factory settings or retrieve the backup configuration, if it is valid (see page 254)
CFI	[Invalid config.]	• Invalid configuration The configuration loaded in the drive via the bus or communication network is inconsistent.	• Check the configuration loaded previously. • Load a compatible configuration
		• [Max frequency] (tFr) has been set at a value higher than 599Hz	• Set [Max frequency] (tFr) at a value lower or equal to 599 Hz
dLF	[Dynamic load fault]	• Abnormal load variation	• Check that the load is not blocked by an obstacle • Removal of a run command causes a reset
HCF	[Cards pairing]	• The [CARDS PAIRING] (PPI-) function, page 243, has been configured and a drive card has been changed	• In the event of a card error, reinsert the original card • Confirm the configuration by entering the [Pairing password] (PPI) if the card was changed deliberately
PHF	[Input phase loss]	• Drive incorrectly supplied or a fuse blown • Failure of one phase • 3-phase ATV71 used on a single-phase line supply • Unbalanced load This protection only operates with the drive on load	• Check the power connection and the fuses. • Use a 3-phase line supply. • Disable the fault by[Input phase loss] (IPL) = [No] (nO). (page 229)
USF	[Undervoltage]	• Line supply too low • Transient voltage dip • This protection only operates with the drive running in motor mode	• Check the voltage and the parameters of [UNDERVOLTAGE MGT] (USb-), page 232

Option card changed or removed

When an option card is removed or replaced by another, the drive locks in [Incorrect config.] (CFF) fault mode on power-up. If the card has been deliberately changed or removed, the fault can be cleared by pressing the ENT key twice, which **causes the factory settings to be restored** (see page 254) for the parameter groups affected by the card. These are as follows:

Card replaced by a card of the same type

- I/O cards: [Drive configuration] (drM)
- Encoder cards: [Drive configuration] (drM)
- Communication cards: only the parameters that are specific to communication cards
- Controller Inside cards: [Prog. card menu] (PLC)

Card removed (or replaced by a different type of card)

- I/O card: [Drive configuration] (drM)
- Encoder card: [Drive configuration] (drM)
- Communication card: [Drive configuration] (drM) and parameters specific to communication cards
- Controller Inside card: [Drive configuration] (drM) and [Prog. card menu] (PLC)

Control card changed

When a control card is replaced by a control card configured on a drive with a different rating, the drive locks in [Incorrect config.] (CFF) fault mode on power-up. If the card has been deliberately changed, the fault can be cleared by pressing the ENT key twice, which **causes all the factory settings to be restored.**

Menu [1.1 SIMPLY START] (SIM-)

Code	Name	Factory setting	Customer setting
tCC	**[2/3 wire control]**	[2 wire] (2C)	
CFG	**[Macro configuration]**	[Start/Stop] (StS)	
bFr	**[Standard mot. freq]**	[50 Hz] (50)	
nPr	**[Rated motor power]**	According to drive rating	
UnS	**[Rated motor volt.]**	According to drive rating	
nCr	**[Rated mot. current]**	According to drive rating	
FrS	**[Rated motor freq.]**	50 Hz	
nSP	**[Rated motor speed]**	According to drive rating	
tFr	**[Max frequency]**	60 Hz	
PHr	**[Output Ph rotation]**	ABC	
ItH	**[Mot. therm. current]**	According to drive rating	
ACC	**[Acceleration]**	3.0 s	
dEC	**[Deceleration]**	3.0 s	
LSP	**[Low speed]**	0	
HSP	**[High speed]**	50 Hz	

Functions assigned to I/O

Inputs Outputs	Functions assigned
LI1	
LI2	
LI3	
LI4	
LI5	
LI6	
LI7	
LI8	
LI9	
LI10	
LI11	
LI12	
LI13	
LI14	

Inputs Outputs	Functions assigned
LO1	
LO2	
LO3	
LO4	
AI1	
AI2	
AI3	
AI4	
R1	
R2	
R3	
R4	
RP	
Encoder	

Other parameters (table to be created by the user)

Code	Name	Customer setting

Index of functions

[2 wire] (2C)	41
[2nd CURRENT LIMIT.]	192
[3 wire] (3C)	41
+/- speed	152
+/- speed around a reference	154
[AUTO DC INJECTION]	146
[AUTOMATIC RESTART]	225
[Auto tuning]	43
[AUTO TUNING BY LI]	208
Brake logic control	160
[CATCH ON THE FLY]	226
Command and reference channels	120
Deferred stop on thermal alarm	230
Direct power supply via DC bus	218
[DRIVE OVERHEAT]	229
[ENA SYSTEM]	82
[ENCODER CONFIGURATION]	104
[EVACUATION]	216
[1.12 FACTORY SETTINGS] (FCS-)	252
[FAULT RESET]	224
[FLUXING BY LI]	157
Half floor	217
High-speed hoisting	172
[JOG]	148
Limit switch management	158
Line contactor command	193
Load measurement	170
[Load sharing]	88
Load variation detection	240
Motor or configuration switching [MULTIMOTORS/CONFIG.]	205
Motor thermal protection	227
[Noise reduction]	85
Output contactor command	195
Parameter set switching [PARAM. SET SWITCHING]	202
[4. PASSWORD] (COd-)	259
PID regulator	177
Positioning by sensors or limit switches	197
Preset speeds	149
PTC probes	222
[RAMP]	140
[REFERENCE SWITCH.]	138
[REGEN CONNECTION]	219
Rope slack	175
[RP CONFIGURATION]	102
Save reference	156
[STOP CONFIGURATION]	144
Stop at distance calculated after deceleration limit switch	199
Summing input/Subtracting input/Multiplier	137
Synchronous motor	78
Torque limitation	189
Torque regulation	186
Traverse control	209
Use of the "Pulse input" input to measure the speed of rotation of the motor.	238

Index of parameter codes

Code	Page										
	[1.1 SIMPLY START] (SIM-)	[1.2 MONITORING] (SUP-)	[1.3 SETTINGS] (SET-)	[1.4 MOTOR CONTROL] (drC-)	[1.5 INPUTS / OUTPUTS CFG] (I-O-)	[1.6 COMMAND] (CtL-)	[1.7 APPLICATION FUNCT.] (Fun-)	[1.8 FAULT MANAGEMENT] (FLt-)	[1.9 COMMUNICATION] (CoM-)	[1.12 FACTORY SETTINGS] (FCS-)	[4 PASSWORD] (Cod-)
AI1C-					118						
AI2C-					118						
AI3C-					118						
ACC2			55				142 155 183				
ACC	44		55				140				
AdC							146				
AdCo									247		
Add									247		
AI1A		52			97						
AI1E					97						
AI1F					97						
AI1S					97						
AI1t					97						
AI2A		52			98						
AI2E					98						
AI2F					98						
AI2L					98						
AI2S					98						
AI2t					98						
AI3A		52			99						
AI3E					99						
AI3F					99						
AI3L					99						
AI3S					99						
AI3t					99						
AI4A		52			100						
AI4E					100						
AI4F					100						
AI4L					100						
AI4S					100						
AI4t					100						
AIC1					101		181				
ALGr		51, 53									
AMoA									247		
AMoC									247		

Index of parameter codes

Code	Page										
	[1.1 SIMPLY START] (SIM-)	[1.2 MONITORING] (SUP-)	[1.3 SETTINGS] (SET-)	[1.4 MOTOR CONTROL] (drC-)	[1.5 INPUTS / OUTPUTS CFG] (I-O-)	[1.6 COMMAND] (CtL-)	[1.7 APPLICATION FUNCT.] (Fun-)	[1.8 FAULT MANAGEMENT] (FLt-)	[1.9 COMMUNICATION] (CoM-)	[1.12 FACTORY SETTINGS] (FCS-)	[4 PASSWORD] (Cod-)
AO1					114						
AO1F					115						
AO1t					114						
AO2					116						
AO2F					116						
AO2t					116						
AO3					117						
AO3F					117						
AO3t					117						
AOH1					114						
AOH2					116						
AOH3					117						
AOL1					114						
AOL2					116						
AOL3					117						
APH		51, 53									
ASH1					115						
ASH2					116						
ASH3					117						
ASL1					115						
ASL2					116						
ASL3					117						
Atr								225			
AU1-					101						
AUS		51, 53									
AUt				71							
bbA				88							
bC1							164				
bdCo									247		
bECd							165				
bEd							166				
bEn			65				165				
bEt			66				165				
bFr	42		70								
biP							164				
bir			65				165				

Index of parameter codes

Code	Page										
	[1.1 SIMPLY START] (SIM-)	[1.2 MONITORING] (SUP-)	[1.3 SETTINGS] (SET-)	[1.4 MOTOR CONTROL] (drC-)	[1.5 INPUTS / OUTPUTS CFG] (I-O-)	[1.6 COMMAND] (CtL-)	[1.7 APPLICATION FUNCT.] (Fun-)	[1.8 FAULT MANAGEMENT] (FLt-)	[1.9 COMMUNICATION] (CoM-)	[1.12 FACTORY SETTINGS] (FCS-)	[4 PASSWORD] (Cod-)
bLC							164				
brA							143				
brH0							167				
brH1							167				
brH2							168				
brH3							168				
brH4							169				
bFtd			66				169				
bro								242			
brP								242			
brr							169				
brt			65				165				
bru								242			
bSP					95						
bSt							164				
bub								242			
CCFG	41										
CCS						129					
Cd1						129					
Cd2						129					
CFG	41										
CFPS		51, 53									
CHA1							203				
CHA2							203				
CHCF						128					
CHM							208				
CL2			61				192				
CL1			61	85			192				
CLL								236			
CLo							176				
CLS							201				
CnF1							208				
CnF2							208				
CnFS		51, 53									
Cod											260
Cod2											260

Index of parameter codes

Code	Page										
	[1.1 SIMPLY START] (SIM-)	[1.2 MONITORING] (SUP-)	[1.3 SETTINGS] (SET-)	[1.4 MOTOR CONTROL] (drC-)	[1.5 INPUTS / OUTPUTS CFG] (I-O-)	[1.6 COMMAND] (CtL-)	[1.7 APPLICATION FUNCT.] (Fun-)	[1.8 FAULT MANAGEMENT] (FLt-)	[1.9 COMMUNICATION] (CoM-)	[1.12 FACTORY SETTINGS] (FCS-)	[4 PASSWORD] (Cod-)
CoF							176				
CoL								236			
CoP						130					
Cor							176				
CP1							171				
CP2							171				
CrH2					98						
CrH3					99						
CrH4					100						
CrL2					98						
CrL3					99						
CrL4					100						
CSt											260
Ctd			67								
Ctt				73							
dA2							139				
dA3							139				
dAF							200				
dAL							200				
dAr							200				
dAS							196				
dbn							188				
dbP							188				
dbS							196				
dCF			59				144	244			
dCI							145				
dCo							218				
dE2			55				142, 155				
dEC	44		55				140				
dLb								241			
dLd								241			
dLr											260
dol					111						
dold					111						
doIH					111						

Index of parameter codes

Code	Page										
	[1.1 SIMPLY START] (SIM-)	[1.2 MONITORING] (SUP-)	[1.3 SETTINGS] (SET-)	[1.4 MOTOR CONTROL] (drC-)	[1.5 INPUTS / OUTPUTS CFG] (I-O-)	[1.6 COMMAND] (CtL-)	[1.7 APPLICATION FUNCT.] (Fun-)	[1.8 FAULT MANAGEMENT] (FLt-)	[1.9 COMMUNICATION] (CoM-)	[1.12 FACTORY SETTINGS] (FCS-)	[4 PASSWORD] (Cod-)
doIS					111						
dotd			145								
dSF							201				
dSI							155				
dSP							153				
dtF							215				
Ebo							214				
ECC								237			
ECt								237			
EFI					105						
EFr					105						
EIL					105						
EnA				83							
EnC				81	104						
EnS				79	104						
Enu				81	105						
EPL								231			
ErCo									247		
EtF								231			
F1				74							
F2				74							
F2d			68								
F3				74							
F4				74							
F5				74							
FbCI							164				
FCP				75							
FCSI										254	
Fdt								239			
FFt			68				144				
FLI							157				
FLo									248		
FLoC									248		
FLot									248		
FLr								226			
FLu			62				157				

Index of parameter codes

Code	Page										
	[1.1 SIMPLY START] (SIM-)	[1.2 MONITORING] (SUP-)	[1.3 SETTINGS] (SET-)	[1.4 MOTOR CONTROL] (drC-)	[1.5 INPUTS / OUTPUTS CFG] (I-O-)	[1.6 COMMAND] (CtL-)	[1.7 APPLICATION FUNCT.] (Fun-)	[1.8 FAULT MANAGEMENT] (FLt-)	[1.9 COMMUNICATION] (CoM-)	[1.12 FACTORY SETTINGS] (FCS-)	[4 PASSWORD] (Cod-)
FPI							183				
F9A								239			
F9C								239			
F9F								239			
F9L			68								
F9S		51, 53									
F9t								239			
Fr1						128					
Fr1b							138				
Fr2						129					
FrH		51, 53									
FrS	42		70								
FrSS				78							
Frt							142				
FrY-										254	
FSt							144				
Ftd			68								
GFS										254	
GIE			59	83							
GPE			59	83							
HFF-							217				
HLS							217				
HSo							176				
HSP	44		56								
Ibr			65				165				
IbrA							171				
IdA				77							
IdC			59				145	244			
IdC2			59				145	244			
IdN				77							
InH								235			
Inr			55				140				
InSP				70							
IntP							190				
IPL	42							229			
Ird			65				165				

Index of parameter codes

Code	Page										
	[1.1 SIMPLY START] (SIM-)	[1.2 MONITORING] (SUP-)	[1.3 SETTINGS] (SET-)	[1.4 MOTOR CONTROL] (drC-)	[1.5 INPUTS / OUTPUTS CFG] (I-O-)	[1.6 COMMAND] (CtL-)	[1.7 APPLICATION FUNCT.] (Fun-)	[1.8 FAULT MANAGEMENT] (FLt-)	[1.9 COMMUNICATION] (CoM-)	[1.12 FACTORY SETTINGS] (FCS-)	[4 PASSWORD] (Cod-)
itH	44		56								
JdC			66				166				
JF2			68								
JF3			68								
JFH			68								
JGF			62				148				
JGt			62				148				
JoG							148				
JPF			68								
L IA to L I4A		52			93						
L Id to L I4d					93						
LAF							159				
LAr							159				
LAS							159				
LbA				88							
LbC			68	88							
LbC1				90							
LbC2				90							
LbC3				90							
LbF				90							
LC2							192				
LCr		51, 53									
LCt							194				
LdS				76							
LES							194				
LEt								231			
LFA				77							
LFF								244			
LFL2 LFL3 LFL4								234			
LFn				77							
LiS1		52									
LiS2		52									
LLC							194				
Lo1					109						
Lo1d					109						

Index of parameter codes

Code	Page										
	[1.1 SIMPLY START] (SIM-)	[1.2 MONITORING] (SUP-)	[1.3 SETTINGS] (SET-)	[1.4 MOTOR CONTROL] (drC-)	[1.5 INPUTS / OUTPUTS CFG] (I-O-)	[1.6 COMMAND] (CtL-)	[1.7 APPLICATION FUNCT.] (Fun-)	[1.8 FAULT MANAGEMENT] (FLt-)	[1.9 COMMUNICATION] (CoM-)	[1.12 FACTORY SETTINGS] (FCS-)	[4 PASSWORD] (Cod-)
LoIH					109						
LoIS					109						
Lo2					109						
Lo2d					109						
Lo2H					109						
Lo2S					109						
Lo3					110						
Lo3d					110						
Lo3H					110						
Lo3S					110						
Lo4					110						
Lo4d					110						
Lo4H					110						
Lo4S					110						
LPI							171				
LP2							171				
L9S				76							
LSP	44		56								
MA2							139				
MA3							139				
MFr		51, 53	64								
MMF		51, 53									
nCAI									246		
nCA2									246		
nCA3									246		
nCA4									246		
nCA5									246		
nCA6									246		
nCA7									246		
nCA8									246		
nCr	42		70								
nCrS				76							
nLS							201				
nMAI									246		
nMA2									246		
nMA3									246		

Index of parameter codes

Code	Page										
	[1.1 SIMPLY START] (SIM-)	[1.2 MONITORING] (SUP-)	[1.3 SETTINGS] (SET-)	[1.4 MOTOR CONTROL] (drC-)	[1.5 INPUTS / OUTPUTS CFG] (I-O-)	[1.6 COMMAND] (CtL-)	[1.7 APPLICATION FUNCT.] (Fun-)	[1.8 FAULT MANAGEMENT] (FLt-)	[1.9 COMMUNICATION] (CoM-)	[1.12 FACTORY SETTINGS] (FCS-)	[4 PASSWORD] (Cod-)
nMA4									246		
nMA5									246		
nMA6									246		
nMA7									246		
nMA8									246		
nPr	42		70								
nrd				85							
nSL				77							
nSP	42		70								
nSPS				76							
nSt							144				
oO2		51, 53									
oO3		51, 53									
oO4		51, 53									
oO5		51, 53									
oO6		51, 53									
oCC							196				
odt								228			
oFI				84							
oHL								229			
oIr							219				
oLL								228			
oPL								228			
oPr		51, 53									
oSP							176				
PAH			64				182				
PAL			64				182				
PAS							201				
PAu							183				
PEr			65				182				
PES							171				
PFI					102						
PFr					102						
PGA					105						
PGI				79	105						
PHS				76							

Index of parameter codes

Code	Page										
	[1.1 SIMPLY START] (SIM-)	[1.2 MONITORING] (SUP-)	[1.3 SETTINGS] (SET-)	[1.4 MOTOR CONTROL] (drC-)	[1.5 INPUTS / OUTPUTS CFG] (I-O-)	[1.6 COMMAND] (CtL-)	[1.7 APPLICATION FUNCT.] (Fun-)	[1.8 FAULT MANAGEMENT] (FLt-)	[1.9 COMMUNICATION] (CoM-)	[1.12 FACTORY SETTINGS] (FCS-)	[4 PASSWORD] (Cod-)
PHr	43			72							
PIA					102						
PIC							182				
PIF							181				
PIF1							181				
PIF2							181				
PII							181				
PIL					102						
PIM							183				
PIP1							181				
PIP2							181				
PIS							182				
PoH			64				182				
PoL			64				182				
PPI								243			
PPn				77							
PPnS				76							
Pr2							185				
Pr4							185				
PrP			64				182				
PS1-							203				
PS2-							204				
PS3-							204				
PS2							150				
PS4							150				
PS8							150				
PS16							150				
PSr			65				183				
PSt						128					
PtC1								223			
PtC2								223			
PtCL								223			
PtH		51, 53									
9SH			67				214				
9SL			67				214				
r1					106						

Index of parameter codes

Code	Page										
	[1.1 SIMPLY START] (SIM-)	[1.2 MONITORING] (SUP-)	[1.3 SETTINGS] (SET-)	[1.4 MOTOR CONTROL] (drC-)	[1.5 INPUTS / OUTPUTS CFG] (I-O-)	[1.6 COMMAND] (CtL-)	[1.7 APPLICATION FUNCT.] (Fun-)	[1.8 FAULT MANAGEMENT] (FLt-)	[1.9 COMMUNICATION] (CoM-)	[1.12 FACTORY SETTINGS] (FCS-)	[4 PASSWORD] (Cod-)
rId					107						
rIH					107						
rIS					107						
r2					107						
r2d					107						
r2H					107						
r2S					107						
r3					108						
r3d					108						
r3H					108						
r3S					108						
r4					108						
r4d					108						
r4H					108						
r4S					108						
rAP				83							
rCA							196				
rCb							138				
rdG			64				182				
rFC						129					
rFr		51, 53									
rFt							216				
riG			64				182				
rin						128					
rP								224			
rP2			65				185				
rP3			65				185				
rP4			65				185				
rPA								224			
rPC		51, 53									
rPE		51, 53									
rPF		51, 53									
rPG			64				181				
rPI							181				
rPo		51, 53									
rPS							142				

Index of parameter codes

Code	Page										
	[1.1 SIMPLY START] (SIM-)	[1.2 MONITORING] (SUP-)	[1.3 SETTINGS] (SET-)	[1.4 MOTOR CONTROL] (drC-)	[1.5 INPUTS / OUTPUTS CFG] (I-O-)	[1.6 COMMAND] (CtL-)	[1.7 APPLICATION FUNCT.] (Fun-)	[1.8 FAULT MANAGEMENT] (FLt-)	[1.9 COMMUNICATION] (CoM-)	[1.12 FACTORY SETTINGS] (FCS-)	[4 PASSWORD] (Cod-)
rPt							140				
rrS					92						
rSA				77							
rSAS				76							
rSd							176				
rSF								224			
rSL							184				
rSM				77							
rSMS				78							
rSP							216				
rStL							176				
rSu							216				
rtH		51, 53									
rto							188				
rtr							215				
SA2							139				
SA3							139				
SAF							200				
SAL							200				
SAr							200				
SAt								230			
SCL							176				
SCS1										254	
SdC1			60				146, 166				
SdC2			60				146				
Sdd								237			
SFC			56								
SFd							201				
SFr			61	84							
Sit			56								
SLL								236			
SLP			59	76							
SnC							215				
SoP				85							
SP2			63				151				

Index of parameter codes

Code	Page										
	[1.1 SIMPLY START] (SIM-)	[1.2 MONITORING] (SUP-)	[1.3 SETTINGS] (SET-)	[1.4 MOTOR CONTROL] (drC-)	[1.5 INPUTS / OUTPUTS CFG] (I-O-)	[1.6 COMMAND] (CtL-)	[1.7 APPLICATION FUNCT.] (Fun-)	[1.8 FAULT MANAGEMENT] (FLt-)	[1.9 COMMUNICATION] (CoM-)	[1.12 FACTORY SETTINGS] (FCS-)	[4 PASSWORD] (Cod-)
SP3			63				151				
SP4			63				151				
SP5			63				151				
SP6			63				151				
SP7			63				151				
SP8			63				151				
SP9			63				151				
SP10			63				151				
SP11			63				151				
SP12			63				151				
SP13			63				151				
SP14			63				151				
SP15			64				151				
SP16			64				151				
SPd		51, 53									
SPG			56								
SPM							156				
SPt							187				
SrP			64				155				
Srt							153				
SSb								237			
Std							201				
StM								233			
Sto								237			
StP								232			
Str							153				
Strt								233			
Stt							144				
SuL				85							
tA1			55				141				
tA2			55				141				
tA3			55				141				
tA4			56				141				
tAA							190				
tAC		51, 53									
tAr								225			

Index of parameter codes

Code	Page										
	[1.1 SIMPLY START] (SIM-)	[1.2 MONITORING] (SUP-)	[1.3 SETTINGS] (SET-)	[1.4 MOTOR CONTROL] (drC-)	[1.5 INPUTS / OUTPUTS CFG] (I-O-)	[1.6 COMMAND] (CTL-)	[1.7 APPLICATION FUNCT.] (Fun-)	[1.8 FAULT MANAGEMENT] (FLt-)	[1.9 COMMUNICATION] (CoM-)	[1.12 FACTORY SETTINGS] (FCS-)	[4 PASSWORD] (Cod-)
tbE			65				165				
tbo							214				
tbr									247		
tbr2									247		
tbS								233			
tCC	41				92						
tCt					92						
td1			59				145	244			
tdC			59				145	244			
tdC1			60				146				
tdC2			60				147				
tdn							214				
tdS								239			
tFo									247		
tFo2									247		
tFr	42		71								
tHA								229, 230			
tHd		51, 53									
tHr		51, 53									
tHt								228			
tLA							190				
tLC							191				
tLd								241			
tL1G			66				190				
tL1M			66				190				
tLS			62				184				
tnL								242			
tob							188				
toS							176				
tPMG							191				
tPMM							191				
tqb								239			
tr1							187				
trA				77							
trC							214				

Index of parameter codes

Code	Page										
	[1.1 SIMPLY START] (SIM-)	[1.2 MONITORING] (SUP-)	[1.3 SETTINGS] (SET-)	[1.4 MOTOR CONTROL] (drC-)	[1.5 INPUTS / OUTPUTS CFG] (I-O-)	[1.6 COMMAND] (CtL-)	[1.7 APPLICATION FUNCT.] (Fun-)	[1.8 FAULT MANAGEMENT] (FLt-)	[1.9 COMMUNICATION] (CoM-)	[1.12 FACTORY SETTINGS] (FCS-)	[4 PASSWORD] (Cod-)
trH			66				214				
trL			66				214				
trn				77							
trP							187				
trr		51, 53									
trt			68				187				
tSd							187				
tSn								233			
tSS							187				
tSt							187				
tSY							215				
ttd			68					228, 230			
ttd2								228, 230			
ttd3								228, 230			
ttH			67								
ttL			67								
tto								247			
ttr			66				166				
tuL							208				
tun	43			71							
tuP							214				
tuS	43			72							
u0				74							
u1				74							
u2				74							
u3				74							
u4				74							
u5				74							
ubr				88							
uC2				75							
uCb								226			
uCP				75							
uFr			59	76							
uiHI					97						

Index of parameter codes

Code	Page										
	[1.1 SIMPLY START] (SIM-)	[1.2 MONITORING] (SUP-)	[1.3 SETTINGS] (SET-)	[1.4 MOTOR CONTROL] (drC-)	[1.5 INPUTS / OUTPUTS CFG] (I-O-)	[1.6 COMMAND] (CtL-)	[1.7 APPLICATION FUNCT.] (Fun-)	[1.8 FAULT MANAGEMENT] (FLt-)	[1.9 COMMUNICATION] (CoM-)	[1.12 FACTORY SETTINGS] (FCS-)	[4 PASSWORD] (Cod-)
uiH2					98						
uiH4					100						
uiL1					97						
uiL2					98						
uiL4					100						
uLn		51, 53									
uLr											260
unS	42		70								
uoH1					114						
uoH2					116						
uoH3					117						
uoL1					114						
uoL2					116						
uoL3					117						
uoP		51, 53									
uPL								233			
urES								232			
uSb								232			
uSi							155				
uSL								232			
uSP							153				
uSt								232			